

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P845503

Luminaire Tested: SQ2R-FA-075D-935-UNV-STD-W-4

Issue Date: 6/14/2024

Test Information

Test Method: LM-79-2019
Report Number: P845503
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2308-131-11)
Test Lab: INNOVATION CENTER
Issue Date: 6/14/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ2R-FA-075D-935-UNV-STD-W-4
Description: CONTINUA SQ2 RECESSED, ASYMMETRIC LENS
750 LUMENS PER FOOT
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2790.7 lumens
Efficiency: N/A
Efficacy: 104.5 lumens/watt
Spacing Criteria (0/90/45): 1.23 / 0.95 / 0.93
Luminous Opening: Rectangular (W 0.17' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 26.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P845503
CATALOG NUMBER: SQ2R-FA-075D-935-UNV-STD-W-4

Luminous Intensity Polar Plot

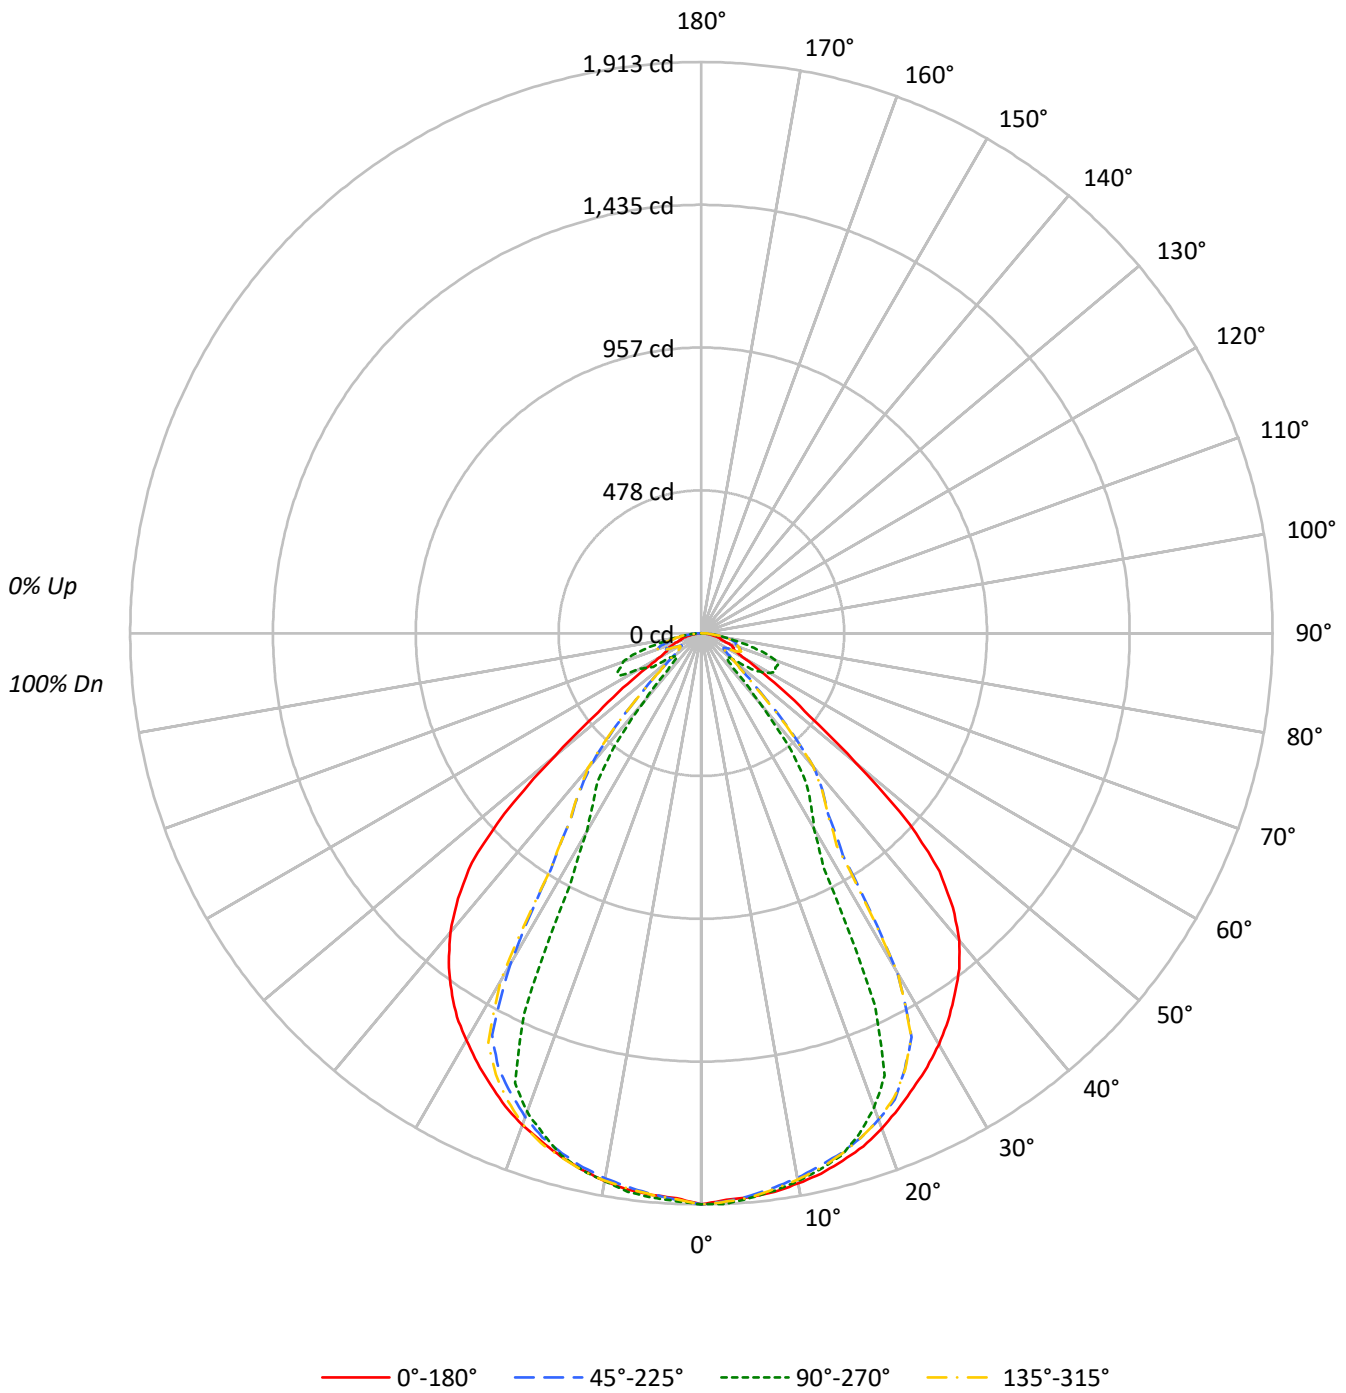



TEST NUMBER: P845503

CATALOG NUMBER: SQ2R-FA-075D-935-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	107	104	101	108	105	102	99	101	98	96	97	95	93	94	92	90	88				88
2	103	97	91	87	101	95	90	86	92	87	84	88	85	82	86	83	80	78				78
3	96	88	81	76	94	86	80	75	84	78	74	81	77	73	79	75	72	70				70
4	90	80	73	68	88	79	72	67	77	71	66	75	70	66	73	68	65	63				63
5	84	74	66	61	82	73	66	61	71	65	60	69	64	59	67	63	59	57				57
6	79	68	61	55	77	67	60	55	65	59	55	64	58	54	62	58	54	52				52
7	74	63	56	50	73	62	55	50	61	55	50	60	54	50	58	53	49	48				48
8	70	59	51	46	69	58	51	46	57	50	46	56	50	46	55	49	46	44				44
9	66	55	48	43	65	54	47	43	53	47	43	52	46	42	51	46	42	41				41
10	63	51	44	40	61	51	44	40	50	44	40	49	43	39	48	43	39	38				38

AVERAGE LUMINANCE (cd/sqm):

	0°	90°	180°	270°
0°	30885	30885	30885	30885
5°	30721	30768	30605	30746
10°	30675	30557	30557	30557
15°	30576	30262	30335	30262
20°	30338	29050	30115	29323
25°	29940	24517	29735	25032
30°	29666	14067	29343	14255
35°	29144	12084	28775	11913
40°	28338	6355	27548	6294
45°	25759	2733	24836	2733
50°	16995	3298	16124	3080
55°	9503	6092	9016	5523
60°	5125	8570	5031	7685
65°	4520	10414	4741	11851
70°	4220	12463	4017	13143
75°	3961	10711	4049	11067
80°	3357	7643	3357	8052
85°	2946	4279	2668	5076

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 25759 cd/sqm



TEST NUMBER: P845503

CATALOG NUMBER: SQ2R-FA-075D-935-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	180.1	6.5
10°-20°	511.2	18.3
20°-30°	699.3	25.1
30°-40°	585.6	21.0
40°-50°	328.2	11.8
50°-60°	174.1	6.2
60°-70°	162.3	5.8
70°-80°	119.4	4.3
80°-90°	30.5	1.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1390.6	49.8
0°-40°	1976.2	70.8
0°-60°	2478.5	88.8
0°-90°	2790.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2790.7	100.0

CANDELA DISTRIBUTION:

	0°	90°	180°	270°	360°	Flux
0°	1913	1913	1913	1913	1913	
5°	1896	1898	1888	1897	1896	180
15°	1829	1810	1815	1810	1829	516
25°	1681	1376	1669	1405	1681	775
35°	1479	613	1460	604	1479	924
45°	1128	120	1088	120	1128	832
55°	338	216	320	196	338	319
65°	118	273	124	310	118	118
75°	64	172	65	177	64	65
85°	16	23	14	27	16	18
90°	0	0	0	0	0	



TEST NUMBER: P845503

CATALOG NUMBER: SQ2R-FA-075D-935-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°	112.5°	135°	157.5°	180°	202.5°	225°
0°	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9
2.5°	1899.9	1935.9	1904.2	1899.9	1912.9	1910.0	1905.6	1923.0	1894.1	1923.0	1899.9
5°	1895.5	1928.7	1891.2	1881.1	1898.4	1886.9	1897.0	1917.2	1888.3	1914.3	1885.4
7.5°	1886.9	1917.2	1872.5	1865.3	1882.6	1872.5	1876.8	1904.2	1879.7	1897.0	1871.0
10°	1871.0	1897.0	1852.3	1847.9	1863.8	1853.7	1858.0	1886.9	1863.8	1879.7	1853.7
12.5°	1853.7	1872.5	1827.7	1826.3	1839.3	1833.5	1835.0	1858.0	1840.7	1856.6	1832.1
15°	1829.2	1847.9	1803.2	1796.0	1810.4	1804.7	1807.6	1829.2	1814.8	1824.9	1803.2
17.5°	1801.8	1816.2	1772.9	1757.1	1758.5	1765.7	1772.9	1798.9	1784.5	1797.5	1770.0
20°	1765.7	1783.0	1734.0	1693.6	1690.7	1697.9	1734.0	1759.9	1752.7	1767.2	1723.9
22.5°	1723.9	1734.0	1690.7	1615.7	1604.1	1611.4	1684.9	1716.7	1715.2	1723.9	1667.6
25°	1680.6	1692.1	1611.4	1516.1	1376.2	1507.5	1614.2	1669.1	1669.1	1677.7	1607.0
27.5°	1637.3	1640.2	1524.8	1021.3	882.9	979.5	1521.9	1611.4	1622.9	1621.5	1517.6
30°	1591.2	1581.1	1314.2	786.2	754.5	774.7	1315.6	1550.8	1573.9	1558.0	1281.0
32.5°	1537.8	1504.6	884.3	706.9	682.3	699.7	843.9	1478.6	1523.4	1484.4	939.1
35°	1478.6	1403.6	740.0	639.1	613.1	636.2	734.3	1379.1	1459.9	1367.6	764.6
37.5°	1418.1	1171.4	667.9	543.9	491.9	535.2	665.0	1167.0	1389.2	1118.0	670.8
40°	1344.5	867.0	585.7	373.6	301.5	352.0	581.4	826.6	1307.0	891.5	571.3
42.5°	1246.4	732.8	441.4	203.4	155.8	183.2	418.3	721.3	1206.0	740.0	425.6
45°	1128.1	652.0	278.4	129.8	119.7	125.5	256.8	640.5	1087.7	626.1	284.2
47.5°	947.8	523.7	189.0	109.6	118.3	109.6	183.2	507.8	894.4	497.7	189.0
50°	676.6	388.1	138.5	111.1	131.3	111.1	134.2	375.1	641.9	411.1	137.0
52.5°	457.3	310.2	106.8	124.1	164.5	126.9	103.9	302.9	434.2	313.0	99.5
55°	337.6	256.8	90.9	160.1	216.4	164.5	90.9	249.6	320.3	246.7	88.0
57.5°	227.9	202.0	89.4	203.4	242.4	207.7	90.9	194.7	217.8	196.2	79.3
60°	158.7	151.5	102.4	219.3	265.4	222.2	103.9	145.7	155.8	144.3	86.6
62.5°	124.1	111.1	128.4	242.4	278.4	233.7	131.3	105.3	131.3	99.5	98.1
65°	118.3	76.5	145.7	240.9	272.6	240.9	147.1	72.1	124.1	77.9	129.8
67.5°	111.1	57.7	142.8	238.0	277.0	240.9	138.5	54.8	106.8	53.4	126.9
70°	89.4	50.5	132.7	243.8	264.0	235.1	132.7	49.0	85.1	47.6	155.8
72.5°	70.7	47.6	121.2	220.7	226.5	212.1	122.6	47.6	72.1	41.8	144.3
75°	63.5	47.6	118.3	180.3	171.7	171.7	115.4	46.2	64.9	43.3	114.0
77.5°	50.5	43.3	102.4	125.5	118.3	118.3	101.0	41.8	47.6	38.9	96.7
80°	36.1	38.9	80.8	86.6	82.2	82.2	77.9	37.5	36.1	36.1	76.5
82.5°	26.0	31.7	57.7	57.7	54.8	53.4	56.3	31.7	26.0	28.9	54.8
85°	15.9	23.1	33.2	27.4	23.1	21.6	31.7	21.6	14.4	21.6	31.7
87.5°	7.2	13.0	5.8	5.8	5.8	5.8	5.8	13.0	7.2	11.5	7.2
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P845503

CATALOG NUMBER: SQ2R-FA-075D-935-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	247.5°	270°	292.5°	315°	337.5°	360°
0°	1912.9	1912.9	1912.9	1912.9	1912.9	1912.9
2.5°	1894.1	1904.2	1904.2	1898.4	1927.3	1899.9
5°	1878.2	1897.0	1888.3	1888.3	1917.2	1895.5
7.5°	1868.1	1886.9	1878.2	1875.4	1904.2	1886.9
10°	1850.8	1863.8	1858.0	1862.4	1888.3	1871.0
12.5°	1826.3	1842.2	1836.4	1843.6	1866.7	1853.7
15°	1797.5	1810.4	1813.3	1816.2	1843.6	1829.2
17.5°	1752.7	1758.5	1774.4	1790.2	1817.6	1801.8
20°	1697.9	1706.6	1715.2	1749.8	1783.0	1765.7
22.5°	1635.9	1630.1	1653.2	1695.0	1738.3	1723.9
25°	1516.1	1405.1	1527.7	1630.1	1684.9	1680.6
27.5°	1113.7	952.1	1093.5	1545.0	1631.6	1637.3
30°	830.9	764.6	829.5	1343.0	1571.0	1591.2
32.5°	714.1	673.7	706.9	942.0	1494.5	1537.8
35°	636.2	604.4	636.2	764.6	1389.2	1478.6
37.5°	542.4	481.8	543.9	678.0	1175.7	1418.1
40°	380.8	298.6	369.3	591.5	888.6	1344.5
42.5°	222.2	165.9	207.7	434.2	735.7	1246.4
45°	137.0	119.7	131.3	281.3	623.2	1128.1
47.5°	108.2	111.1	108.2	187.5	496.2	947.8
50°	102.4	122.6	102.4	137.0	395.3	676.6
52.5°	114.0	135.6	112.5	101.0	305.8	457.3
55°	125.5	196.2	126.9	88.0	238.0	337.6
57.5°	178.9	216.4	181.8	82.2	194.7	227.9
60°	184.7	238.0	183.2	88.0	142.8	158.7
62.5°	226.5	308.7	226.5	103.9	96.7	124.1
65°	281.3	310.2	284.2	128.4	75.0	118.3
67.5°	268.3	290.0	265.4	132.7	51.9	111.1
70°	262.5	278.4	259.7	157.2	47.6	89.4
72.5°	240.9	239.5	235.1	142.8	41.8	70.7
75°	190.4	177.4	183.2	125.5	43.3	63.5
77.5°	125.5	119.7	121.2	99.5	38.9	50.5
80°	89.4	86.6	85.1	80.8	36.1	36.1
82.5°	60.6	57.7	56.3	57.7	28.9	26.0
85°	30.3	27.4	26.0	36.1	21.6	15.9
87.5°	7.2	7.2	5.8	7.2	10.1	7.2
90°	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P845503

CATALOG NUMBER: SQ2R-FA-075D-935-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.90	17.21	16.27	17.52	17.84	14.74	16.05	15.11	16.36	16.68
	3H	16.62	17.79	17.00	18.12	18.49	20.95	22.12	21.33	22.45	22.81
	4H	17.05	18.14	17.45	18.49	18.88	22.24	23.34	22.65	23.69	24.07
	6H	17.42	18.43	17.84	18.80	19.20	22.87	23.88	23.28	24.25	24.64
	8H	17.55	18.51	17.98	18.90	19.31	23.00	23.96	23.43	24.35	24.76
	12H	17.64	18.56	18.07	18.94	19.37	23.06	23.97	23.49	24.36	24.79
4H	2H	16.34	17.44	16.74	17.79	18.17	15.33	16.42	15.73	16.77	17.15
	3H	17.36	18.27	17.77	18.67	19.08	21.70	22.61	22.11	23.01	23.41
	4H	17.93	18.75	18.37	19.17	19.61	23.16	23.98	23.60	24.40	24.84
	6H	18.43	19.14	18.89	19.59	20.05	23.92	24.63	24.38	25.08	25.54
	8H	18.61	19.27	19.08	19.72	20.19	24.09	24.76	24.56	25.20	25.67
	12H	18.74	19.33	19.23	19.81	20.29	24.17	24.76	24.66	25.24	25.72
8H	4H	19.06	19.73	19.53	20.17	20.64	23.31	23.97	23.78	24.42	24.89
	6H	19.69	20.23	20.19	20.72	21.20	24.20	24.75	24.70	25.24	25.72
	8H	19.92	20.41	20.44	20.92	21.41	24.45	24.94	24.97	25.45	25.94
	12H	20.12	20.54	20.63	21.04	21.61	24.59	25.02	25.11	25.51	26.08
12H	4H	19.23	19.82	19.71	20.30	20.77	23.29	23.88	23.78	24.36	24.83
	6H	19.96	20.45	20.48	20.96	21.45	24.21	24.70	24.73	25.21	25.70
	8H	20.28	20.71	20.80	21.20	21.77	24.51	24.94	25.03	25.43	26.00