

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P824251

Luminaire Tested: CB2-D-125U-120D-835-1D-UNV-STD-W-4

Issue Date: 4/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P824251
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2312-242-13, G2-2312-242-18)
Test Lab: INNOVATION CENTER
Issue Date: 4/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: CB2-D-125U-120D-835-1D-UNV-STD-W-4
Description: CORELITE Bryx SLOT LED LUMINAIRE, UPLIGHT DIFFUSER DUST COVER
2-INCH APERTURE
DOWNLIGHT 1200 LUMENS PER FOOT
UPLIGHT 1250 LUMENS PER FOOT
Light Source: 80 CRI, 3500K CCT LEDS
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9846.6 lumens
Efficiency: N/A
Efficacy: 119.6 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.09 / 1.24
Luminous Opening: Rectangular (W 0.15' x L: 4' x H: 0')
CIE Type: General Diffuse


Input Watts (W): 82.3
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P824251

CATALOG NUMBER: CB2-D-125U-120D-835-1D-UNV-STD-W-4

Luminous Intensity Polar Plot

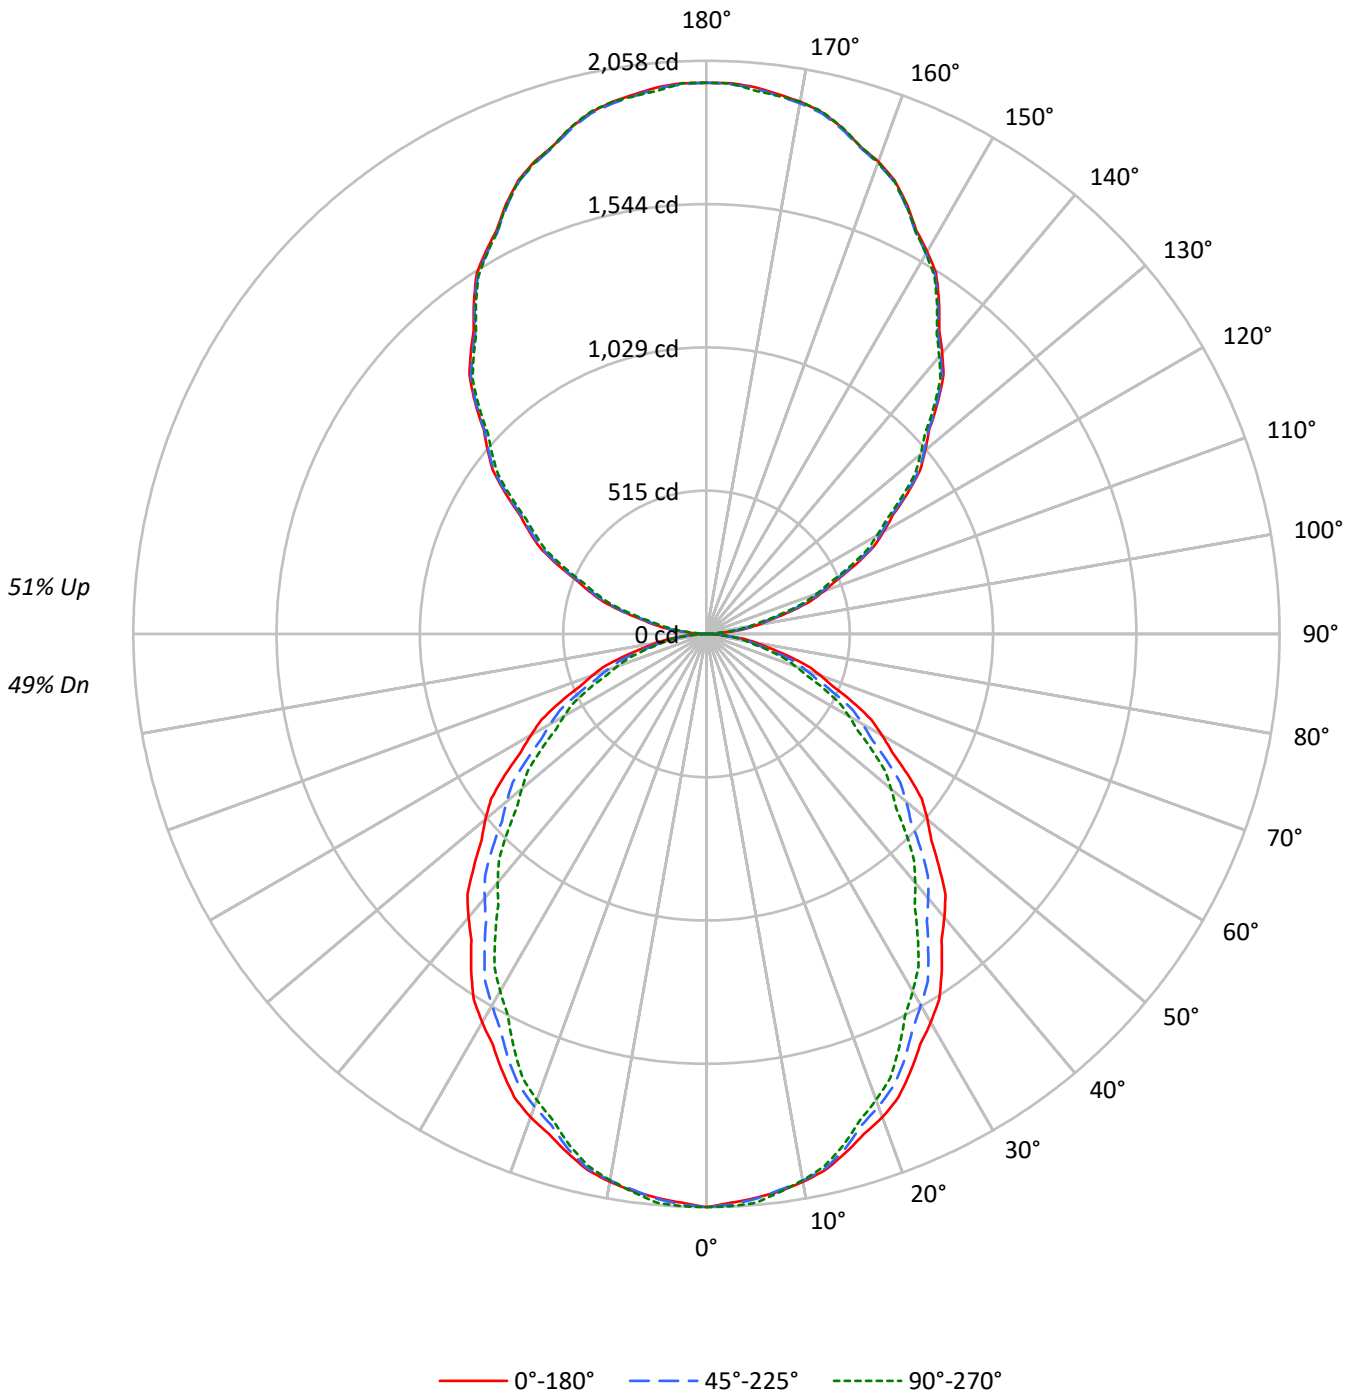



TEST NUMBER: P824251

CATALOG NUMBER: CB2-D-125U-120D-835-1D-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55	49					49			
1	98	93	90	86	90	86	83	80	73	70	68	60	59	57	49	48	47	41					41			
2	89	82	76	71	82	76	70	66	64	60	57	53	50	48	43	41	40	35					35			
3	81	72	65	59	75	67	60	55	57	52	48	47	44	41	38	36	34	30					30			
4	75	64	56	50	68	59	52	47	50	45	41	42	38	35	34	32	29	26					26			
5	68	57	49	43	63	53	46	40	45	40	35	38	34	31	31	28	26	22					22			
6	63	51	43	37	58	48	40	35	41	35	31	34	30	27	28	25	23	20					20			
7	58	46	38	33	54	43	36	31	37	31	27	31	27	24	26	23	20	18					18			
8	54	42	34	29	50	39	32	28	34	28	24	29	24	21	24	21	18	16					16			
9	51	38	31	26	47	36	29	25	31	26	22	26	22	19	22	19	17	14					14			
10	47	35	28	23	44	33	26	22	29	23	20	24	20	17	20	17	15	13					13			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	35845	35845	35845
5°	35541	35597	35844
10°	35338	35255	35227
15°	34780	34552	34268
20°	34233	33473	33006
25°	33312	32373	31465
30°	32390	30964	29792
35°	31328	29519	28111
40°	30203	28162	26513
45°	29073	26743	24959
50°	28053	25362	23441
55°	26798	23926	22012
60°	25360	22562	20584
65°	23833	21043	19160
70°	22147	19341	17335
75°	20148	17497	15693
80°	18014	15336	14223
85°	13849	12590	10392

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 29073 cd/sqm



TEST NUMBER: P824251

CATALOG NUMBER: CB2-D-125U-120D-835-1D-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	193.5	2.0
10°-20°	539.5	5.5
20°-30°	775.7	7.9
30°-40°	871.9	8.9
40°-50°	842.2	8.6
50°-60°	711.6	7.2
60°-70°	511.1	5.2
70°-80°	279.4	2.8
80°-90°	74.3	0.8
90°-100°	76.5	0.8
100°-110°	315.3	3.2
110°-120°	572.4	5.8
120°-130°	778.9	7.9
130°-140°	899.2	9.1
140°-150°	906.1	9.2
150°-160°	782.0	7.9
160°-170°	530.0	5.4
170°-180°	187.0	1.9
0°-30°	1508.7	15.3
0°-40°	2380.6	24.2
0°-60°	3934.4	40.0
0°-90°	4799.2	48.7
90°-120°	964.2	9.8
90°-150°	3548.5	36.0
90°-180°	5047.0	51.3
0°-180°	9846.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2058	2058	2058	2058	2058	
5°	2033	2060	2036	2036	2050	193
15°	1929	1946	1916	1897	1900	544
25°	1733	1735	1684	1646	1637	798
35°	1473	1456	1388	1334	1322	920
45°	1180	1156	1086	1029	1013	912
55°	882	850	788	739	725	789
65°	578	557	511	474	465	573
75°	299	281	260	239	233	320
85°	69	65	63	55	52	83
90°	0	0	2	0	2	5
95°	74	65	62	48	48	86
105°	312	307	300	282	279	331
115°	593	591	580	563	562	585
125°	882	891	872	854	855	787
135°	1175	1188	1169	1147	1155	905
145°	1456	1472	1450	1433	1443	910
155°	1703	1719	1695	1685	1698	783
165°	1882	1902	1877	1867	1883	530
175°	1971	1992	1967	1954	1959	187
180°	1979	1979	1979	1979	1979	



TEST NUMBER: P824251

CATALOG NUMBER: CB2-D-125U-120D-835-1D-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2058.0	2058.0	2058.0	2058.0	2058.0
2.5°	2044.1	2068.8	2050.5	2053.1	2056.8
5°	2032.8	2060.5	2036.0	2036.3	2050.1
7.5°	2018.3	2044.5	2013.6	2007.9	2020.8
10°	1998.1	2024.3	1993.4	1982.6	1991.8
12.5°	1971.7	1996.6	1966.9	1949.8	1957.8
15°	1928.8	1945.7	1916.2	1897.4	1900.4
17.5°	1882.2	1892.6	1850.0	1834.2	1831.1
20°	1846.9	1856.1	1805.9	1783.8	1780.7
22.5°	1801.5	1809.5	1756.7	1729.5	1725.2
25°	1733.4	1734.9	1684.5	1646.5	1637.3
27.5°	1662.2	1657.2	1601.3	1556.3	1544.3
30°	1610.5	1604.3	1539.6	1492.1	1481.3
32.5°	1555.0	1543.9	1479.1	1427.8	1417.0
35°	1473.4	1456.4	1388.3	1334.4	1322.1
37.5°	1386.4	1367.3	1300.4	1241.7	1227.9
40°	1328.4	1306.8	1238.6	1180.0	1166.1
42.5°	1270.4	1246.4	1176.8	1118.2	1103.1
45°	1180.3	1155.6	1085.7	1028.7	1013.3
47.5°	1094.6	1063.1	995.3	938.5	923.1
50°	1035.3	1001.4	936.0	880.5	865.1
52.5°	974.8	939.7	876.8	823.8	808.4
55°	882.5	850.1	787.9	738.7	724.9
57.5°	791.1	759.9	703.1	656.2	642.6
60°	728.0	701.8	647.7	603.3	590.9
62.5°	667.5	643.8	592.2	551.6	539.2
65°	578.3	556.8	510.6	474.1	464.9
67.5°	491.7	470.1	432.7	400.0	389.5
70°	434.9	413.4	379.8	349.6	340.4
72.5°	380.7	357.9	330.6	303.0	296.3
75°	299.4	280.9	260.0	239.4	233.2
77.5°	227.5	209.7	194.5	179.9	178.4
80°	179.6	164.2	152.9	143.4	141.8
82.5°	134.3	122.5	115.0	108.1	107.8
85°	69.3	64.7	63.0	55.1	52.0
87.5°	20.2	20.2	18.0	15.1	15.4
90°	0.0	0.0	1.5	0.0	1.5
92.5°	18.5	16.1	15.1	9.9	11.4
95°	74.1	65.0	61.8	47.9	47.9
97.5°	139.9	130.8	126.0	111.7	108.7
100°	186.8	177.7	172.9	157.4	154.4
102.5°	235.0	230.7	222.3	205.6	202.5
105°	311.8	307.3	299.5	282.4	279.4
107.5°	390.9	391.8	380.1	366.1	361.9
110°	447.7	446.2	436.9	422.9	419.9



TEST NUMBER: P824251

CATALOG NUMBER: CB2-D-125U-120D-835-1D-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	505.7	503.0	493.7	479.7	476.7
115°	592.8	591.3	580.5	563.4	561.9
117.5°	675.6	680.4	667.5	649.6	649.0
120°	734.8	740.9	725.6	710.1	707.1
122.5°	792.9	800.1	784.9	767.0	767.6
125°	881.5	890.6	872.2	853.7	855.3
127.5°	967.0	978.2	961.2	942.4	944.2
130°	1025.1	1038.7	1020.4	1000.4	1003.5
132.5°	1084.4	1097.9	1079.7	1058.5	1064.0
135°	1174.8	1188.4	1168.6	1147.2	1154.8
137.5°	1260.0	1273.6	1252.0	1234.0	1243.1
140°	1316.8	1330.4	1307.6	1290.8	1299.9
142.5°	1372.4	1388.4	1364.4	1346.4	1357.9
145°	1455.8	1472.4	1449.6	1432.9	1443.4
147.5°	1534.8	1551.4	1528.3	1512.2	1523.1
150°	1585.5	1602.1	1577.7	1564.1	1576.2
152.5°	1632.4	1651.4	1625.9	1612.4	1628.1
155°	1702.8	1719.4	1695.1	1684.6	1698.2
157.5°	1763.9	1783.2	1759.0	1750.0	1760.8
160°	1804.7	1822.8	1798.5	1789.5	1801.6
162.5°	1835.6	1854.9	1831.9	1821.7	1836.2
165°	1881.9	1901.5	1877.2	1866.8	1883.4
167.5°	1918.3	1939.1	1914.6	1903.9	1920.8
170°	1940.5	1960.2	1934.4	1922.4	1940.5
172.5°	1955.4	1976.2	1949.2	1937.1	1949.2
175°	1971.4	1992.5	1966.8	1954.5	1959.1
177.5°	1979.1	1996.0	1975.4	1964.6	1979.1
180°	1979.1	1979.1	1979.1	1979.1	1979.1



TEST NUMBER: P824251
 CATALOG NUMBER: CB2-D-125U-120D-835-1D-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.32	20.16	20.29	21.14	22.43	18.22	19.06	19.19	20.04	21.33
	3H	20.96	21.71	21.94	22.70	24.02	19.74	20.50	20.73	21.49	22.80
	4H	21.59	22.30	22.58	23.30	24.62	20.32	21.03	21.31	22.02	23.34
	6H	21.99	22.65	23.00	23.65	24.98	20.69	21.34	21.69	22.34	23.68
	8H	22.14	22.76	23.15	23.78	25.11	20.83	21.45	21.84	22.47	23.80
	12H	22.21	22.80	23.23	23.81	25.17	20.89	21.48	21.91	22.49	23.85
4H	2H	19.72	20.44	20.73	21.43	22.75	18.85	19.56	19.85	20.56	21.88
	3H	21.59	22.18	22.60	23.21	24.54	20.58	21.18	21.59	22.20	23.53
	4H	22.34	22.88	23.35	23.90	25.25	21.26	21.80	22.27	22.82	24.17
	6H	22.86	23.32	23.88	24.36	25.72	21.73	22.20	22.76	23.24	24.59
	8H	23.06	23.49	24.09	24.53	25.90	21.92	22.35	22.95	23.39	24.76
	12H	23.16	23.56	24.21	24.61	25.98	22.01	22.40	23.05	23.45	24.82
8H	4H	22.49	22.93	23.52	23.96	25.33	21.53	21.96	22.56	23.00	24.37
	6H	23.13	23.49	24.19	24.57	25.93	22.13	22.49	23.18	23.57	24.93
	8H	23.42	23.74	24.48	24.80	26.18	22.41	22.72	23.47	23.78	25.17
	12H	23.60	23.87	24.66	24.93	26.36	22.55	22.83	23.62	23.89	25.32
12H	4H	22.47	22.86	23.52	23.91	25.29	21.53	21.92	22.58	22.97	24.35
	6H	23.16	23.48	24.22	24.54	25.92	22.19	22.51	23.25	23.57	24.96
	8H	23.48	23.76	24.54	24.81	26.24	22.50	22.78	23.56	23.83	25.26