

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P854984

Luminaire Tested: SQ2-F-100U-075D-830-UNV-STD-W-4

Issue Date: 7/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P854984
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2104-222-12, G2-2308-131-13)
Test Lab: INNOVATION CENTER
Issue Date: 7/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ2-F-100U-075D-830-UNV-STD-W-4
Description: CORELITE SQ2 SUSPENDED LED LUMINAIRE
DOWNLIGHT 750 LUMENS PER FOOT
UPLIGHT 1000 LUMENS PER FOOT
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7822.8 lumens
Efficiency: N/A
Efficacy: 131.9 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.25 / 1.36
Luminous Opening: Rectangular (W 0.17' x L: 4' x H: 0')
CIE Type: General Diffuse

Input Watts (W): 59.3
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P854984
CATALOG NUMBER: SQ2-F-100U-075D-830-UNV-STD-W-4

Luminous Intensity Polar Plot

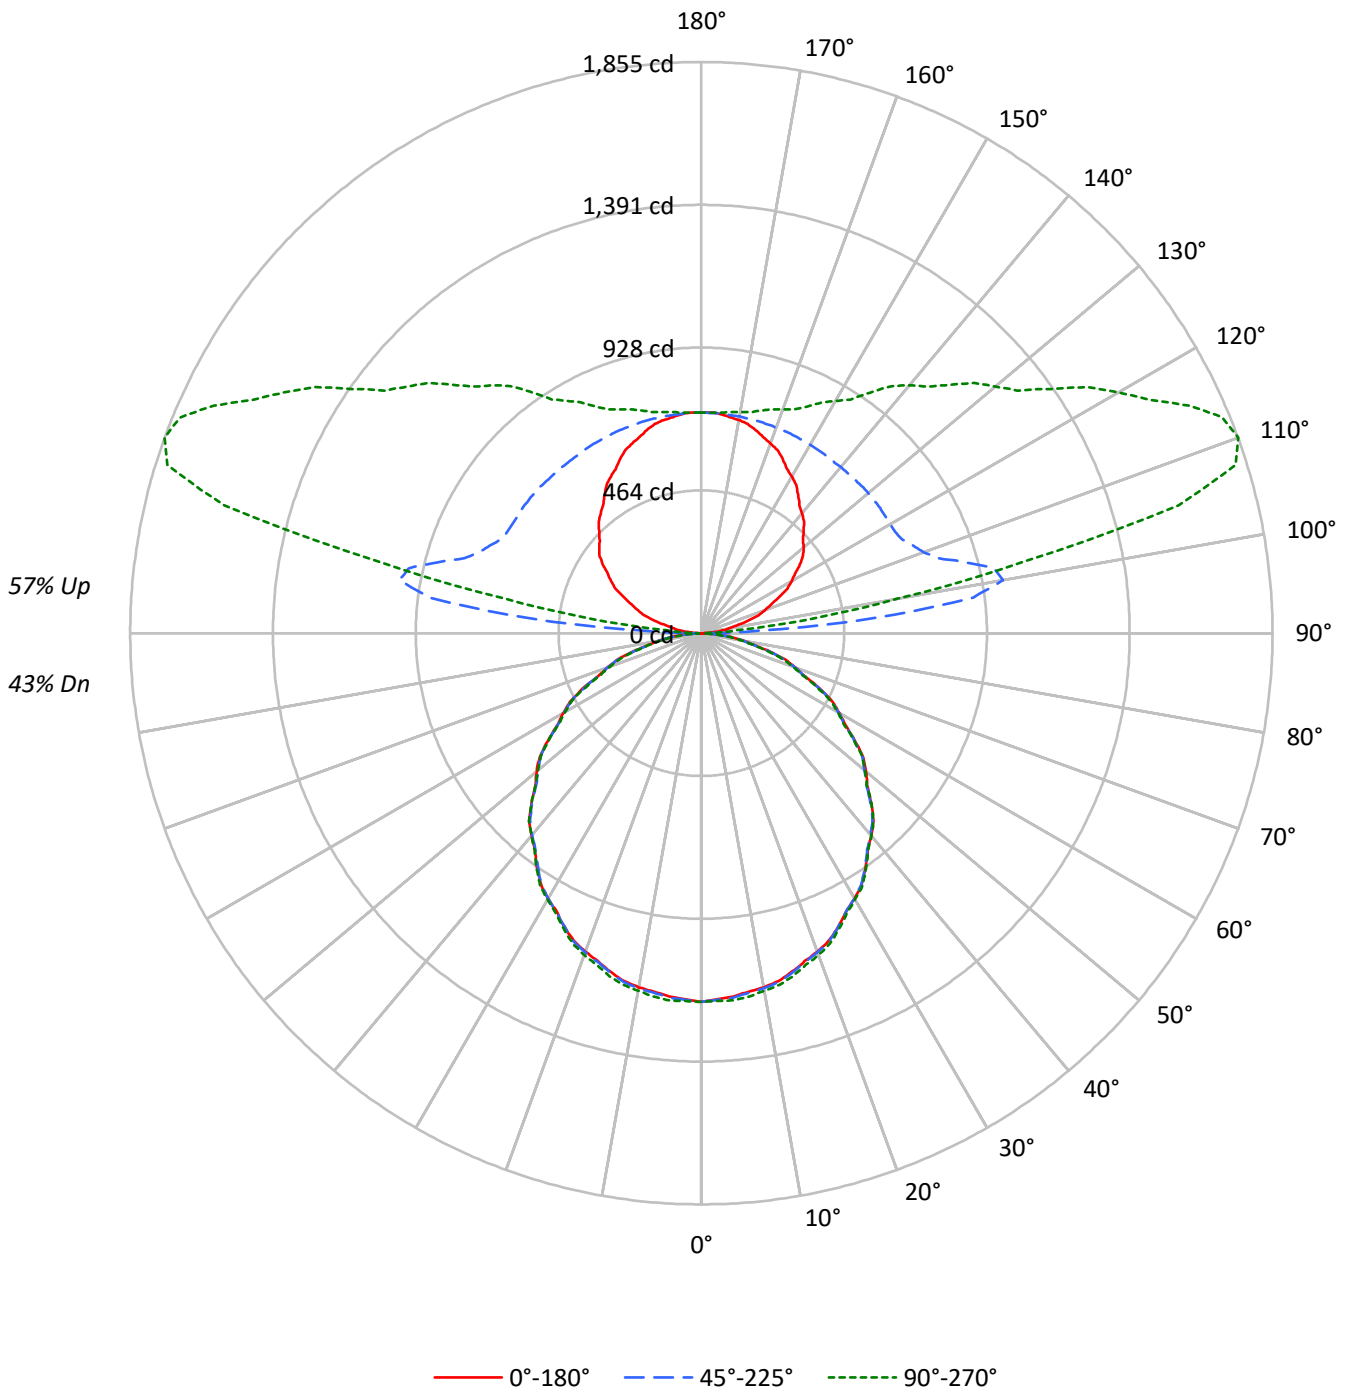



TEST NUMBER: P854984

CATALOG NUMBER: SQ2-F-100U-075D-830-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50	43
1	96	92	88	84	88	84	81	78	69	67	65	56	54	53	44	43	42	36
2	87	80	74	69	80	73	68	63	61	57	53	49	46	44	38	36	35	30
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	34	31	30	25
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25	21
5	67	55	47	41	61	51	43	38	42	37	33	34	30	27	27	24	22	19
6	61	49	41	35	56	45	38	33	38	32	28	31	27	24	24	22	19	16
7	57	44	36	31	52	41	34	29	34	29	25	28	24	21	22	19	17	14
8	52	40	33	27	48	37	30	25	31	26	22	26	22	19	20	17	15	13
9	49	37	29	24	45	34	27	23	29	23	20	24	20	17	19	16	14	11
10	46	34	26	22	42	31	25	20	26	21	18	22	18	15	17	15	12	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	19328	19328	19328
5°	19191	19245	19402
10°	19146	19200	19335
15°	19029	19084	19275
20°	18916	18945	19112
25°	18743	18743	18857
30°	18550	18550	18610
35°	18325	18260	18388
40°	18082	18014	18082
45°	17801	17728	17801
50°	17535	17369	17412
55°	17126	17078	16988
60°	16695	16591	16485
65°	16202	16011	15828
70°	15243	15168	14861
75°	14348	14042	13637
80°	12738	12441	11985
85°	10263	9355	8762

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 17911 cd/sqm



TEST NUMBER: P854984

CATALOG NUMBER: SQ2-F-100U-075D-830-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	113.2	1.4
10°-20°	323.3	4.1
20°-30°	486.5	6.2
30°-40°	582.1	7.4
40°-50°	600.6	7.7
50°-60°	541.8	6.9
60°-70°	413.5	5.3
70°-80°	237.7	3.0
80°-90°	63.3	0.8
90°-100°	299.3	3.8
100°-110°	905.3	11.6
110°-120°	883.8	11.3
120°-130°	722.2	9.2
130°-140°	589.5	7.5
140°-150°	458.9	5.9
150°-160°	330.8	4.2
160°-170°	202.5	2.6
170°-180°	68.4	0.9
0°-30°	923.0	11.8
0°-40°	1505.1	19.2
0°-60°	2647.5	33.8
0°-90°	3362.0	43.0
90°-120°	2088.5	26.7
90°-150°	3859.1	49.3
90°-180°	4461.0	57.0
0°-180°	7822.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1197	1197	1197	1197	1197	
5°	1184	1200	1187	1189	1197	112
15°	1138	1153	1142	1147	1153	321
25°	1052	1063	1052	1054	1058	484
35°	930	936	926	930	933	581
45°	780	784	776	778	780	601
55°	608	612	607	604	604	544
65°	424	422	419	416	414	417
75°	230	228	225	220	219	243
85°	55	52	50	46	47	64
90°	0	2	14	8	7	4
95°	37	118	565	209	132	44
105°	158	221	889	1688	1604	165
115°	280	334	719	1488	1747	277
125°	392	434	709	1175	1383	348
135°	469	519	704	1013	1140	363
145°	548	589	704	872	953	343
155°	624	645	709	782	811	287
165°	683	691	712	739	748	192
175°	714	714	716	721	719	68
180°	717	717	717	717	717	

TEST NUMBER: P854984

CATALOG NUMBER: SQ2-F-100U-075D-830-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1197.1	1197.1	1197.1	1197.1	1197.1
2.5°	1189.3	1203.3	1191.9	1194.6	1195.9
5°	1184.1	1200.1	1187.4	1189.2	1197.1
7.5°	1174.3	1191.6	1177.6	1180.7	1189.7
10°	1167.8	1183.8	1171.1	1172.8	1179.3
12.5°	1157.3	1173.4	1160.6	1163.8	1170.1
15°	1138.4	1152.8	1141.7	1146.8	1153.1
17.5°	1116.6	1131.9	1119.6	1123.9	1129.3
20°	1100.9	1113.7	1102.6	1104.4	1112.3
22.5°	1081.3	1094.1	1084.3	1084.7	1091.5
25°	1052.1	1063.1	1052.1	1053.8	1058.5
27.5°	1018.4	1028.0	1018.4	1020.2	1024.2
30°	995.0	1004.5	995.0	996.5	998.2
32.5°	968.8	977.1	967.5	969.3	973.4
35°	929.7	936.1	926.4	929.7	932.9
37.5°	887.9	892.8	884.6	886.3	889.3
40°	857.9	862.7	854.7	856.3	857.9
42.5°	827.9	831.5	823.3	825.0	827.9
45°	779.6	784.4	776.4	778.0	779.6
47.5°	730.7	733.6	726.8	725.5	728.5
50°	698.1	699.6	691.5	691.6	693.2
52.5°	662.9	664.5	658.9	656.3	657.9
55°	608.4	611.6	606.7	603.5	603.5
57.5°	553.6	556.4	550.3	548.7	548.4
60°	517.0	518.6	513.8	512.1	510.5
62.5°	480.5	480.9	475.9	474.3	472.7
65°	424.1	422.5	419.1	415.9	414.3
67.5°	360.8	362.4	359.2	353.9	353.9
70°	322.9	324.5	321.3	314.8	314.8
72.5°	286.4	285.5	283.5	278.3	275.7
75°	230.0	228.4	225.1	220.1	218.6
77.5°	173.6	172.0	170.3	164.1	165.4
80°	137.0	135.5	133.8	128.9	128.9
82.5°	104.4	101.5	99.8	95.0	95.0
85°	55.4	52.2	50.5	45.7	47.3
87.5°	15.6	14.8	15.7	12.0	11.8
90°	0.0	2.1	13.5	7.8	6.8
92.5°	12.6	50.9	182.7	60.6	43.6
95°	37.1	117.5	564.9	208.7	131.6
97.5°	71.8	149.5	890.3	589.1	358.8
100°	93.4	169.3	994.6	961.6	645.8
102.5°	117.7	191.0	973.0	1348.7	1075.2
105°	157.5	221.4	888.9	1688.2	1604.5
107.5°	195.4	256.3	807.8	1721.7	1818.5
110°	220.6	278.8	767.4	1679.5	1855.4



TEST NUMBER: P854984

CATALOG NUMBER: SQ2-F-100U-075D-830-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	244.9	301.4	743.1	1608.5	1831.2
115°	280.2	334.1	719.0	1487.8	1747.4
117.5°	315.2	366.3	710.5	1374.7	1640.6
120°	338.6	387.1	707.8	1308.7	1564.0
122.5°	360.3	406.0	707.8	1250.7	1486.6
125°	391.5	434.5	708.9	1175.0	1382.9
127.5°	417.0	461.4	707.8	1117.8	1295.0
130°	433.1	479.4	707.8	1085.0	1245.6
132.5°	447.6	494.7	706.9	1055.0	1203.2
135°	469.2	518.7	704.4	1013.3	1139.8
137.5°	493.3	540.3	704.4	968.7	1086.0
140°	508.6	554.8	704.4	939.8	1050.9
142.5°	523.9	568.4	703.5	913.3	1010.5
145°	548.0	588.7	704.4	871.6	953.0
147.5°	572.0	606.6	705.7	837.2	899.7
150°	587.4	619.3	706.7	818.1	870.9
152.5°	601.7	630.1	707.6	801.6	844.8
155°	624.5	645.4	708.9	781.5	811.2
157.5°	644.2	661.2	710.3	766.7	787.4
160°	656.0	670.2	711.2	757.6	773.0
162.5°	667.6	678.5	712.0	749.4	762.2
165°	683.0	690.7	712.2	739.4	748.3
167.5°	696.0	700.0	713.5	731.6	735.4
170°	703.3	705.4	714.5	728.0	729.2
172.5°	707.8	709.0	714.5	724.4	724.6
175°	714.5	714.5	715.6	721.2	719.0
177.5°	717.6	716.7	715.8	718.5	716.7
180°	716.7	716.7	716.7	716.7	716.7



TEST NUMBER: P854984

CATALOG NUMBER: SQ2-F-100U-075D-830-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.57	18.38	18.59	19.41	20.78	17.50	18.31	18.51	19.33	20.70
	3H	19.35	20.08	20.37	21.11	22.50	19.23	19.96	20.25	20.99	22.38
	4H	20.01	20.70	21.04	21.73	23.13	19.85	20.54	20.89	21.58	22.97
	6H	20.47	21.11	21.52	22.15	23.56	20.29	20.92	21.34	21.96	23.37
	8H	20.61	21.22	21.66	22.27	23.67	20.41	21.01	21.46	22.07	23.47
	12H	20.68	21.26	21.74	22.31	23.73	20.46	21.03	21.52	22.08	23.51
4H	2H	18.12	18.81	19.16	19.84	21.24	18.06	18.75	19.10	19.78	21.18
	3H	20.10	20.68	21.15	21.74	23.15	19.99	20.57	21.04	21.63	23.04
	4H	20.89	21.42	21.95	22.47	23.90	20.75	21.27	21.80	22.33	23.76
	6H	21.48	21.93	22.54	23.01	24.43	21.30	21.75	22.36	22.83	24.25
	8H	21.66	22.09	22.73	23.16	24.60	21.46	21.89	22.53	22.96	24.40
	12H	21.76	22.15	22.85	23.23	24.68	21.53	21.92	22.62	23.00	24.45
8H	4H	21.13	21.56	22.20	22.63	24.07	21.01	21.43	22.07	22.50	23.94
	6H	21.85	22.20	22.94	23.31	24.75	21.68	22.03	22.77	23.15	24.58
	8H	22.11	22.42	23.21	23.52	24.97	21.92	22.23	23.02	23.33	24.78
	12H	22.28	22.55	23.38	23.64	25.14	22.05	22.32	23.15	23.41	24.91
12H	4H	21.12	21.51	22.21	22.59	24.04	21.00	21.39	22.09	22.47	23.92
	6H	21.89	22.20	22.99	23.29	24.75	21.73	22.04	22.83	23.14	24.59
	8H	22.18	22.45	23.28	23.54	25.04	22.00	22.27	23.10	23.36	24.85