

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P854274

Luminaire Tested: SQ2-PW1-075U-100D-930-UNV-STD-W-4

Issue Date: 7/12/2024

Test Information

Test Method: LM-79-2019
Report Number: P854274
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2104-222-11, G2-2308-131-8)
Test Lab: INNOVATION CENTER
Issue Date: 7/12/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ2-PW1-075U-100D-930-UNV-STD-W-4
Description: CORELITE SQ2 SUSPENDED LED LUMINAIRE
DOWNLIGHT 1000 LUMENS PER FOOT
UPLIGHT 750 LUMENS PER FOOT
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7196.4 lumens
Efficiency: N/A
Efficacy: 118.2 lumens/watt
Spacing Criteria (0/90/45): 1.27 / 1.11 / 1.22
Luminous Opening: Rectangular (W 0.17' x L: 4' x H: 0')
CIE Type: Semi-Direct

Input Watts (W): 60.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P854274

CATALOG NUMBER: SQ2-PW1-075U-100D-930-UNV-STD-W-4

Luminous Intensity Polar Plot

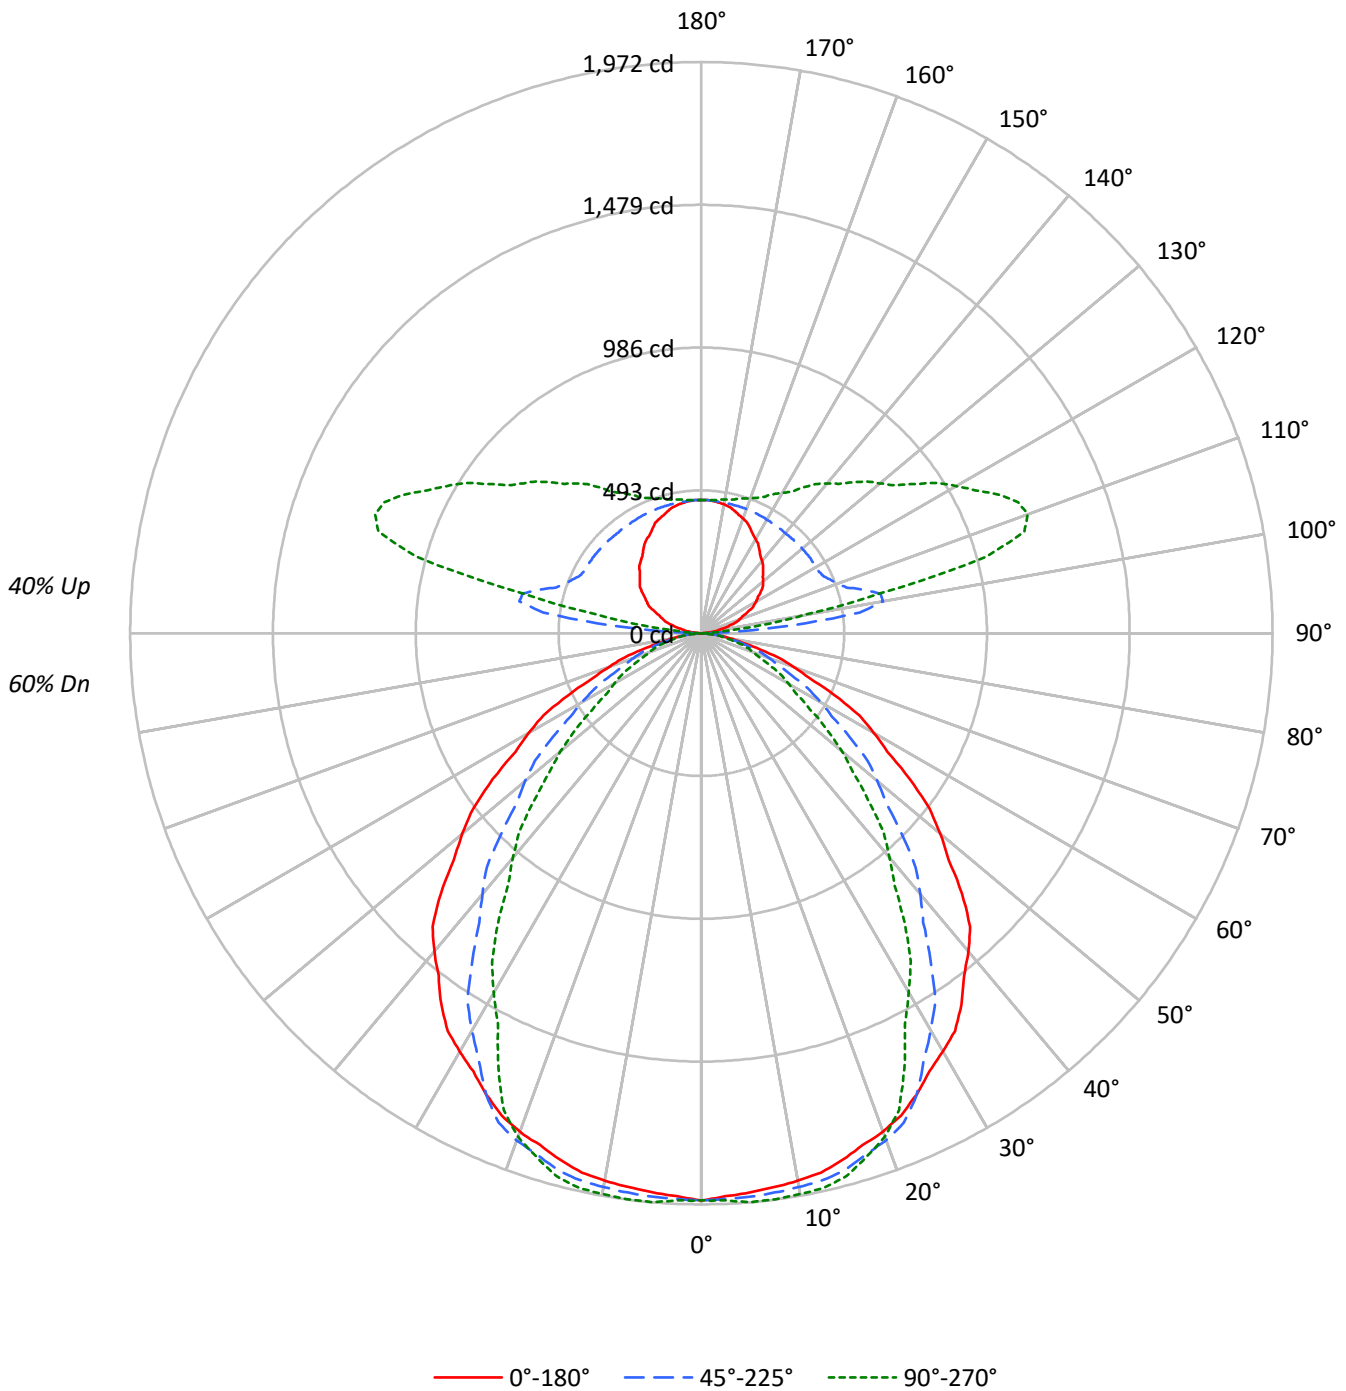



TEST NUMBER: P854274

CATALOG NUMBER: SQ2-PW1-075U-100D-930-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	66	66	66	60
1	101	97	93	90	94	91	87	85	79	77	75	69	67	66	59	58	57	52
2	92	85	79	74	86	80	75	71	70	66	63	61	58	56	53	51	49	45
3	85	76	68	63	79	71	65	60	63	58	54	55	51	48	47	45	42	39
4	78	67	60	54	73	63	57	51	56	51	46	49	45	42	43	40	37	34
5	72	60	52	47	67	57	50	45	51	45	41	45	40	37	39	36	33	30
6	66	54	47	41	62	52	44	39	46	40	36	41	36	32	36	32	29	27
7	62	49	42	36	58	47	40	35	42	36	32	37	32	29	33	29	26	24
8	57	45	37	32	54	43	36	31	38	33	28	34	29	26	30	26	24	21
9	53	41	34	29	50	39	32	28	35	30	26	31	27	24	28	24	21	19
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	31625	31625	31625
5°	31413	31657	31958
10°	31472	31839	32236
15°	31463	32055	32430
20°	31476	32020	31797
25°	31306	31338	29544
30°	31092	29528	26711
35°	30849	27173	24122
40°	30237	24770	21311
45°	29051	22277	18614
50°	27038	19914	15933
55°	24732	17591	12918
60°	22168	15300	11144
65°	19385	13184	9906
70°	15852	11712	8984
75°	12333	10125	8259
80°	9196	8675	7280
85°	6224	6558	4150

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 29051 cd/sqm

TEST NUMBER: P854274

CATALOG NUMBER: SQ2-PW1-075U-100D-930-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	186.5	2.6
10°-20°	540.4	7.5
20°-30°	795.3	11.1
30°-40°	869.5	12.1
40°-50°	780.0	10.8
50°-60°	581.8	8.1
60°-70°	367.7	5.1
70°-80°	182.2	2.5
80°-90°	43.1	0.6
90°-100°	174.1	2.4
100°-110°	577.1	8.0
110°-120°	572.7	8.0
120°-130°	466.5	6.5
130°-140°	379.1	5.3
140°-150°	294.4	4.1
150°-160°	212.1	2.9
160°-170°	129.9	1.8
170°-180°	43.9	0.6
0°-30°	1522.2	21.2
0°-40°	2391.7	33.2
0°-60°	3753.6	52.2
0°-90°	4346.5	60.4
90°-120°	1323.9	18.4
90°-150°	2463.9	34.2
90°-180°	2850.0	39.6
0°-180°	7196.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1959	1959	1959	1959	1959	
5°	1938	1969	1953	1955	1972	184
15°	1882	1919	1918	1931	1940	531
25°	1757	1796	1759	1686	1658	809
35°	1565	1549	1379	1258	1224	976
45°	1272	1170	976	854	815	976
55°	879	795	625	490	459	785
65°	507	466	345	278	259	503
75°	198	212	162	136	132	218
85°	34	43	35	24	22	43
90°	0	1	3	4	4	2
95°	25	73	315	113	75	28
105°	101	144	578	1090	1019	107
115°	180	216	465	968	1132	178
125°	252	280	456	761	897	224
135°	301	332	453	653	737	233
145°	350	376	452	562	615	219
155°	399	413	455	502	520	184
165°	438	443	456	475	479	124
175°	458	458	459	462	461	44
180°	460	460	460	460	460	



TEST NUMBER: P854274

CATALOG NUMBER: SQ2-PW1-075U-100D-930-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1958.7	1958.7	1958.7	1958.7	1958.7
2.5°	1945.3	1970.1	1954.3	1955.9	1960.2
5°	1938.2	1969.2	1953.2	1955.4	1971.8
7.5°	1928.5	1959.9	1947.9	1954.6	1970.7
10°	1919.6	1952.4	1942.0	1951.6	1966.2
12.5°	1907.6	1941.9	1934.5	1945.6	1960.2
15°	1882.3	1918.7	1917.7	1931.0	1940.1
17.5°	1852.8	1889.3	1887.5	1890.9	1895.3
20°	1831.9	1868.4	1863.6	1850.6	1850.6
22.5°	1802.0	1841.4	1829.3	1793.6	1781.9
25°	1757.3	1795.6	1759.1	1685.8	1658.4
27.5°	1705.0	1736.1	1662.9	1558.7	1520.7
30°	1667.7	1691.4	1583.8	1469.2	1432.7
32.5°	1628.9	1638.1	1503.2	1384.0	1344.6
35°	1565.1	1548.7	1378.6	1258.4	1223.8
37.5°	1489.8	1440.9	1258.8	1133.0	1094.7
40°	1434.6	1365.2	1175.2	1049.4	1011.1
42.5°	1373.4	1286.5	1096.2	970.3	930.5
45°	1272.3	1170.1	975.6	853.5	815.2
47.5°	1158.5	1057.0	863.0	744.7	711.9
50°	1076.4	977.9	792.8	674.4	634.3
52.5°	992.8	904.5	724.2	602.4	547.7
55°	878.6	794.7	624.9	489.9	458.9
57.5°	761.1	688.5	535.0	412.4	386.9
60°	686.5	622.7	473.8	370.6	345.1
62.5°	614.9	558.3	414.1	331.9	310.8
65°	507.4	465.5	345.1	277.5	259.3
67.5°	402.9	379.6	286.9	227.7	215.6
70°	335.8	328.5	248.1	199.4	190.3
72.5°	277.6	280.5	210.8	172.6	166.4
75°	197.7	212.3	162.3	136.1	132.4
77.5°	134.7	156.6	120.1	100.7	97.8
80°	98.9	120.8	93.3	78.3	78.3
82.5°	69.0	86.5	66.4	58.9	58.9
85°	33.6	42.7	35.4	24.2	22.4
87.5°	9.0	13.5	6.5	5.2	5.2
90°	0.0	0.9	2.9	3.8	3.8
92.5°	7.6	29.4	86.7	28.1	23.6
95°	24.8	73.2	315.4	112.6	75.3
97.5°	45.6	96.2	550.6	321.1	203.0
100°	60.0	108.5	637.5	547.6	363.1
102.5°	76.0	123.0	632.2	836.8	632.2
105°	101.0	143.9	577.5	1089.6	1018.7
107.5°	126.6	164.8	525.1	1115.3	1169.1
110°	141.0	179.2	498.4	1089.8	1198.9



TEST NUMBER: P854274

CATALOG NUMBER: SQ2-PW1-075U-100D-930-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	156.3	193.7	482.4	1044.8	1183.6
115°	180.1	215.5	465.1	968.1	1132.1
117.5°	203.7	235.2	458.8	894.9	1067.0
120°	218.2	249.0	456.5	849.1	1015.9
122.5°	231.2	261.2	456.5	811.4	965.6
125°	251.6	279.5	456.5	760.7	896.8
127.5°	268.4	295.8	455.3	722.3	838.6
130°	278.3	307.2	454.6	700.0	804.3
132.5°	287.4	317.1	453.8	681.4	775.3
135°	301.1	331.9	452.7	652.8	736.7
137.5°	316.0	345.6	451.5	625.1	699.1
140°	325.9	354.8	450.8	606.7	674.7
142.5°	335.1	363.2	451.5	588.2	648.8
145°	349.7	375.8	451.7	561.6	614.7
147.5°	365.6	387.4	451.9	539.0	578.5
150°	375.5	395.0	452.7	525.9	559.4
152.5°	384.6	403.4	453.4	515.0	541.9
155°	399.3	413.3	454.6	501.7	520.3
157.5°	413.6	424.4	455.7	492.2	505.5
160°	421.2	430.5	456.5	485.3	495.6
162.5°	428.8	435.9	456.5	480.7	488.7
165°	438.4	443.0	456.5	474.7	479.4
167.5°	447.1	449.6	457.4	469.3	471.7
170°	451.7	452.6	457.4	467.0	467.9
172.5°	454.8	455.7	458.2	464.7	464.9
175°	458.4	458.4	459.3	462.2	461.2
177.5°	460.3	460.3	459.5	461.0	459.5
180°	460.3	460.3	460.3	460.3	460.3



TEST NUMBER: P854274

CATALOG NUMBER: SQ2-PW1-075U-100D-930-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.98	20.89	20.85	21.78	22.89	16.46	17.38	17.33	18.26	19.38
	3H	21.30	22.12	22.19	23.01	24.16	17.67	18.49	18.56	19.38	20.53
	4H	21.68	22.45	22.58	23.35	24.51	18.12	18.89	19.02	19.79	20.95
	6H	21.88	22.59	22.80	23.50	24.67	18.44	19.15	19.35	20.06	21.22
	8H	21.92	22.59	22.84	23.52	24.69	18.52	19.19	19.44	20.12	21.28
	12H	21.92	22.56	22.84	23.48	24.67	18.53	19.17	19.45	20.09	21.28
4H	2H	20.09	20.86	20.99	21.76	22.91	17.15	17.92	18.06	18.82	19.98
	3H	21.64	22.28	22.55	23.21	24.38	18.54	19.18	19.46	20.12	21.29
	4H	22.15	22.73	23.07	23.66	24.85	19.09	19.67	20.02	20.60	21.80
	6H	22.48	22.98	23.42	23.93	25.13	19.50	20.00	20.44	20.95	22.15
	8H	22.56	23.03	23.50	23.97	25.18	19.61	20.07	20.55	21.02	22.23
	12H	22.58	23.00	23.54	23.96	25.18	19.63	20.05	20.59	21.01	22.23
8H	4H	22.19	22.66	23.13	23.60	24.81	19.42	19.89	20.36	20.84	22.05
	6H	22.63	23.01	23.59	24.00	25.21	19.93	20.32	20.90	21.30	22.51
	8H	22.77	23.11	23.75	24.09	25.32	20.09	20.43	21.07	21.41	22.64
	12H	22.84	23.14	23.82	24.11	25.39	20.16	20.46	21.14	21.43	22.70
12H	4H	22.15	22.57	23.11	23.53	24.75	19.44	19.86	20.40	20.83	22.04
	6H	22.62	22.96	23.60	23.94	25.16	20.00	20.34	20.97	21.31	22.54
	8H	22.78	23.08	23.76	24.05	25.33	20.18	20.48	21.16	21.45	22.73