

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P937921

Luminaire Tested: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

Issue Date: 12/17/2024

Test Information

Test Method: LM-79-2019
Report Number: P937921
REPORT IS A COMBINATION OF REPORTS P933590 AND P933786
Test Lab: INNOVATION CENTER
Issue Date: 12/17/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12
Description: CORELITE SQ4 SUSPENDED INDIRECT LED LUMINAIRE WITH Batwing Frosted Continuous Roll L
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 17117.1 lumens
Efficiency: N/A
Efficacy: 102.6 lumens/watt
Spacing Criteria (0/90/45): 0.71 / 2.69 / 2.33
Luminous Opening: Rectangular w/ Sides (W: 0.29' x L: 12' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 166.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P937921
CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

Luminous Intensity Polar Plot

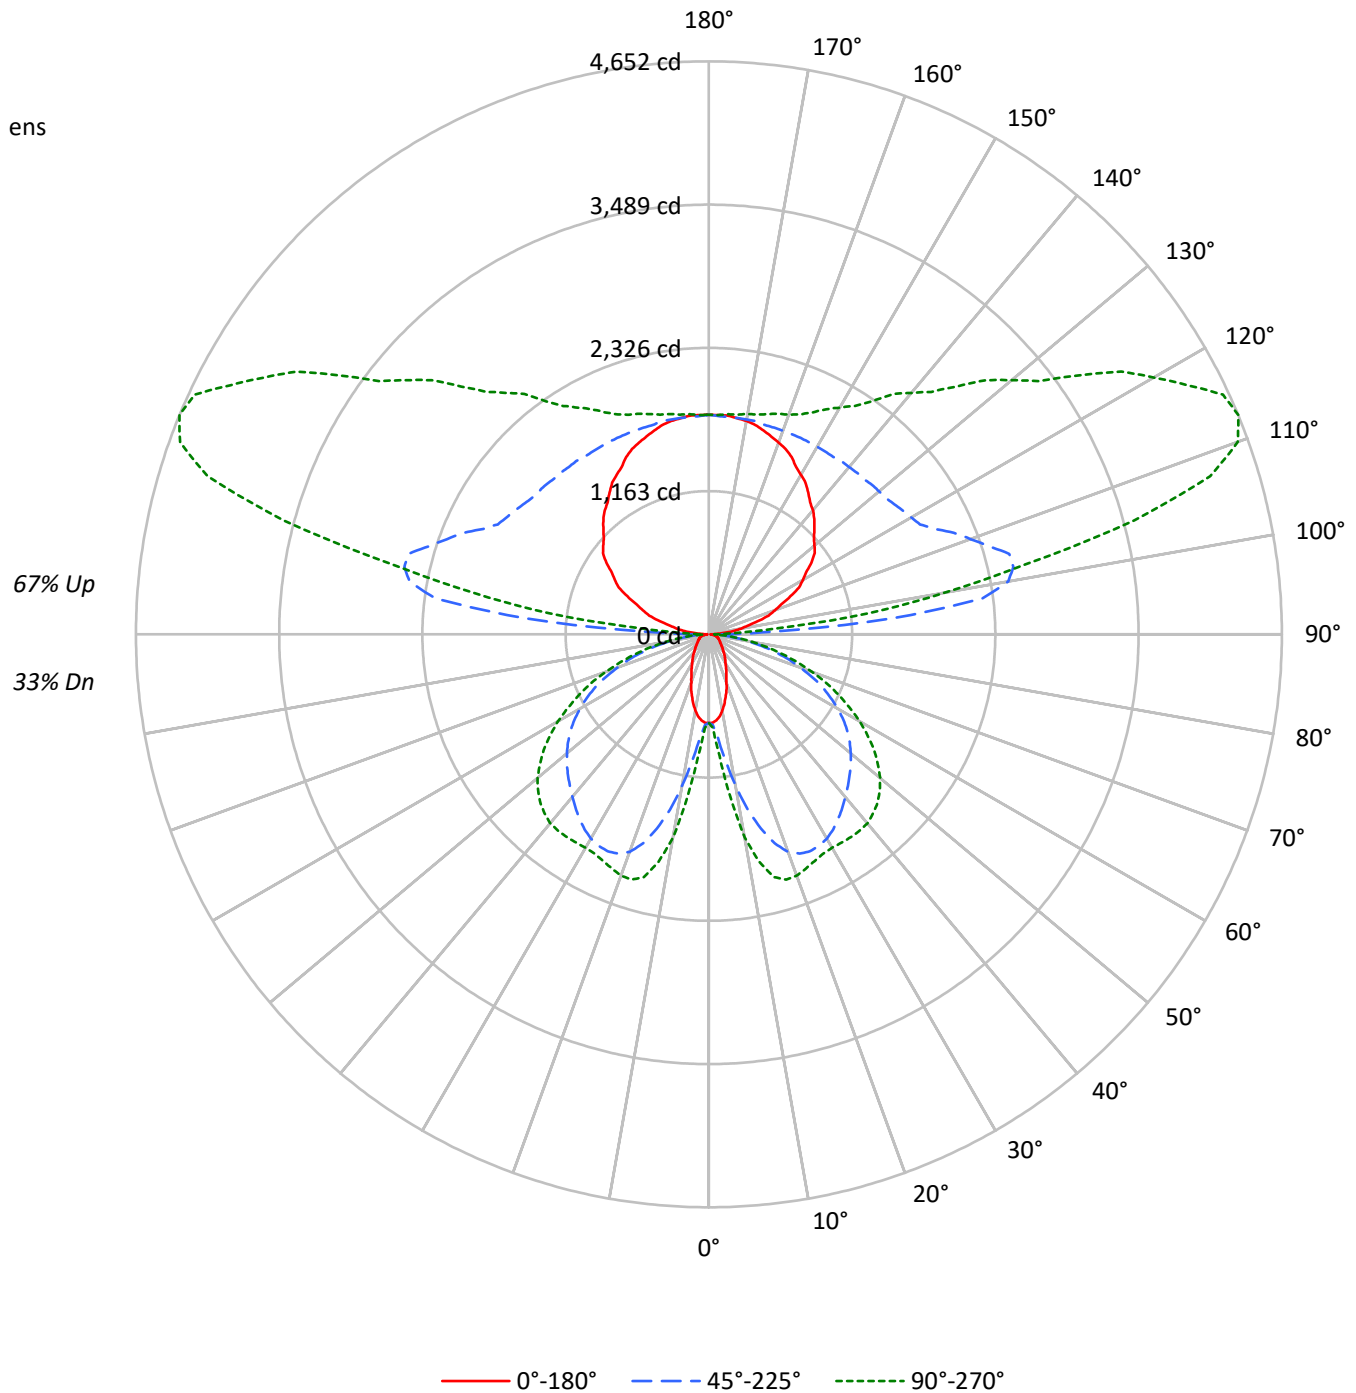



TEST NUMBER: P937921

CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20									
RC	80					70					50					30					10					0				
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0			
RCR																														
0	103	103	103	103	93	93	93	93	74	74	74	56	56	56	40	40	40	33	33	33	33	33	33	33	33	33	33			
1	94	89	85	82	84	80	77	74	64	62	60	49	47	46	35	34	33	27	27	27	27	27	27	27	27	27	27			
2	85	77	71	66	76	70	65	60	55	52	49	42	40	38	30	29	27	22	22	22	22	22	22	22	22	22	22			
3	77	68	60	54	69	61	55	50	49	44	40	37	34	31	26	24	23	18	18	18	18	18	18	18	18	18	18			
4	70	59	52	46	63	54	47	42	43	38	34	33	29	26	23	21	19	15	15	15	15	15	15	15	15	15	15			
5	64	53	45	39	57	48	41	35	38	33	29	29	25	23	21	18	16	13	13	13	13	13	13	13	13	13	13			
6	59	47	39	33	53	42	35	30	34	29	25	26	22	19	19	16	14	11	11	11	11	11	11	11	11	11	11			
7	54	42	34	29	49	38	31	26	31	25	22	23	20	17	17	14	12	10	10	10	10	10	10	10	10	10	10			
8	50	38	30	25	45	34	28	23	28	23	19	21	18	15	15	13	11	8	8	8	8	8	8	8	8	8	8			
9	47	34	27	22	42	31	25	20	25	20	17	19	16	13	14	12	10	7	7	7	7	7	7	7	7	7	7			
10	43	31	24	19	39	28	22	18	23	18	15	18	14	12	13	10	9	7	7	7	7	7	7	7	7	7	7			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2222	2222	2222
5°	2172	2569	2987
10°	1970	3746	4952
15°	1675	4895	5979
20°	1365	5674	6094
25°	1139	5939	5970
30°	961	5978	5959
35°	850	5880	6113
40°	741	5753	6272
45°	672	5660	6297
50°	617	5577	6192
55°	591	5454	5918
60°	606	5217	5485
65°	631	4856	4889
70°	674	4237	4130
75°	750	3458	3223
80°	825	2401	2172
85°	749	1276	1112

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 45°
 Luminance: 6297 cd/sqm



TEST NUMBER: P937921

CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	92.9	0.5
10°-20°	411.9	2.4
20°-30°	720.5	4.2
30°-40°	927.4	5.4
40°-50°	1035.9	6.1
50°-60°	992.2	5.8
60°-70°	786.3	4.6
70°-80°	462.3	2.7
80°-90°	135.2	0.8
90°-100°	868.7	5.1
100°-110°	2283.8	13.3
110°-120°	2368.0	13.8
120°-130°	1899.5	11.1
130°-140°	1490.4	8.7
140°-150°	1143.9	6.7
150°-160°	823.8	4.8
160°-170°	504.1	2.9
170°-180°	170.3	1.0
0°-30°	1225.3	7.2
0°-40°	2152.7	12.6
0°-60°	4180.8	24.4
0°-90°	5564.6	32.5
90°-120°	5520.5	32.3
90°-150°	10054.3	58.7
90°-180°	11552.0	67.5
0°-180°	17117.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	718	718	718	718	718	
5°	700	751	846	956	991	65
15°	524	968	1631	1977	2040	146
25°	335	1097	1943	2028	2031	154
35°	226	1049	1830	1934	2010	141
45°	155	836	1617	1853	1936	120
55°	111	531	1372	1594	1638	101
65°	88	282	1019	1146	1162	87
75°	65	173	559	614	617	68
85°	23	53	139	152	155	25
90°	12	34	91	45	45	11
95°	115	450	1496	772	525	127
105°	411	623	2525	3833	3576	436
115°	731	887	2022	4034	4605	722
125°	1017	1140	1840	3108	3667	903
135°	1212	1334	1782	2509	2845	937
145°	1405	1495	1759	2141	2308	880
155°	1588	1633	1759	1932	1988	730
165°	1714	1737	1759	1829	1852	484
175°	1782	1782	1771	1794	1794	169
180°	1782	1782	1782	1782	1782	



TEST NUMBER: P937921
 CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (FULL):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
0°	718.4	718.4	718.4	718.4	718.4	718.4	718.4	718.4	718.4	718.4	718.4
2.5°	718.4	718.4	723.0	725.3	730.0	732.3	736.9	741.5	755.4	757.7	762.3
5°	699.9	709.2	739.2	750.8	783.1	827.0	845.5	875.6	937.9	956.4	968.0
7.5°	672.2	693.0	766.9	785.4	866.2	981.8	1030.3	1095.0	1194.3	1242.9	1282.1
10°	628.3	672.2	803.9	847.8	979.5	1155.1	1245.2	1335.3	1485.4	1552.4	1577.8
12.5°	579.8	651.4	843.2	903.3	1092.7	1349.1	1457.7	1557.0	1728.0	1818.0	1831.9
15°	524.4	621.4	880.2	968.0	1212.8	1510.8	1630.9	1753.4	1912.8	1977.4	1993.6
17.5°	475.9	598.3	914.8	1007.2	1305.2	1656.3	1778.8	1880.4	2009.8	2053.7	2065.2
20°	415.8	561.3	937.9	1058.1	1402.2	1762.6	1880.4	1959.0	2046.7	2074.5	2079.1
22.5°	371.9	522.1	951.8	1076.5	1466.9	1827.3	1926.6	1989.0	2049.0	2058.3	2060.6
25°	335.0	478.2	949.5	1097.3	1522.4	1866.6	1942.8	1989.0	2023.6	2028.3	2028.3
27.5°	300.3	429.7	940.2	1101.9	1563.9	1875.8	1935.9	1968.2	1984.4	1993.6	1993.6
30°	270.3	383.5	917.1	1092.7	1582.4	1866.6	1915.1	1931.2	1947.4	1961.3	1968.2
32.5°	247.2	339.6	882.5	1074.2	1584.7	1843.5	1878.1	1887.3	1910.4	1942.8	1954.3
35°	226.4	295.7	843.2	1048.8	1570.9	1806.5	1829.6	1838.8	1885.0	1933.5	1949.7
37.5°	205.6	263.3	792.3	1004.9	1550.1	1762.6	1778.8	1794.9	1866.6	1924.3	1942.8
40°	184.8	235.6	732.3	956.4	1517.7	1709.5	1723.3	1748.7	1843.5	1910.4	1928.9
42.5°	168.6	212.5	667.6	905.6	1476.2	1649.4	1670.2	1707.2	1815.7	1887.3	1908.1
45°	154.8	189.4	598.3	836.2	1423.0	1587.0	1617.1	1667.9	1783.4	1852.7	1871.2
47.5°	140.9	173.2	526.7	764.6	1365.3	1524.7	1563.9	1621.7	1739.5	1806.5	1822.7
50°	129.4	157.1	455.1	688.4	1302.9	1457.7	1503.9	1563.9	1684.1	1746.4	1767.2
52.5°	120.1	143.2	388.1	612.2	1231.3	1388.4	1441.5	1503.9	1617.1	1677.1	1691.0
55°	110.9	131.7	330.3	531.3	1157.4	1314.5	1372.2	1432.3	1543.2	1594.0	1603.2
57.5°	106.3	122.4	281.8	455.1	1078.8	1231.3	1296.0	1351.4	1455.4	1494.6	1503.9
60°	99.3	115.5	244.9	390.4	993.4	1152.8	1208.2	1263.6	1351.4	1383.8	1390.7
62.5°	92.4	110.9	217.1	328.0	905.6	1060.4	1115.8	1166.6	1240.5	1263.6	1272.9
65°	87.8	106.3	196.4	281.8	815.4	963.3	1018.8	1062.7	1122.7	1145.8	1150.5
67.5°	83.2	101.6	180.2	242.6	725.3	866.2	907.9	949.5	995.7	1018.8	1021.1
70°	76.2	97.0	166.3	214.8	632.9	755.4	790.0	833.9	870.9	882.5	889.4
72.5°	71.6	90.1	157.1	194.0	538.2	649.1	681.4	706.9	739.2	750.8	750.8
75°	64.7	80.9	147.8	173.2	441.2	531.3	559.0	584.4	609.8	614.5	607.5
77.5°	57.8	71.6	127.0	145.5	344.2	420.4	443.5	457.4	478.2	482.8	485.1
80°	48.5	62.4	99.3	113.2	249.5	309.5	325.7	337.3	355.7	355.7	360.4
82.5°	37.0	48.5	71.6	80.9	168.6	212.5	226.4	233.3	244.9	244.9	244.9
85°	23.1	30.0	46.2	53.1	101.6	129.4	138.6	140.9	150.2	152.5	152.5
87.5°	11.6	16.2	30.0	32.3	53.1	67.0	67.0	71.6	71.6	69.3	67.0
90°	11.9	21.5	31.1	33.5	52.6	78.1	90.9	80.8	60.6	45.4	45.4
92.5°	47.8	129.1	210.5	230.8	324.6	449.4	511.9	448.6	322.1	227.2	218.2
95°	114.8	263.6	412.5	449.7	798.5	1263.6	1496.2	1335.1	1013.0	771.5	744.1
97.5°	198.5	329.8	461.2	494.0	1075.6	1851.2	2238.9	2137.1	1933.5	1780.9	1728.7
100°	263.1	382.2	501.3	531.1	1176.5	2037.1	2467.4	2474.9	2489.7	2500.9	2438.8
102.5°	318.2	429.3	540.3	568.1	1222.8	2095.6	2532.0	2661.7	2921.1	3115.7	3062.5
105°	411.4	505.5	599.6	623.2	1257.0	2102.2	2524.8	2815.5	3397.1	3833.2	3804.6
107.5°	507.1	594.8	682.5	704.5	1263.4	2008.7	2381.3	2786.9	3598.0	4206.4	4213.3
110°	571.7	650.9	730.1	749.9	1253.8	1925.7	2261.6	2715.1	3621.9	4302.1	4331.9



TEST NUMBER: P937921

CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (continued):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
112.5°	635.1	710.6	786.0	804.9	1254.2	1853.3	2152.8	2616.9	3545.0	4241.1	4286.8
115°	730.7	800.3	870.0	887.4	1265.8	1770.2	2022.5	2469.5	3363.6	4034.2	4097.6
117.5°	825.3	888.5	951.8	967.6	1289.3	1718.3	1932.8	2336.3	3143.1	3748.3	3818.6
120°	880.3	939.8	999.4	1014.2	1308.5	1700.8	1896.9	2265.6	3002.8	3555.8	3624.1
122.5°	934.1	994.1	1054.2	1069.2	1336.0	1691.6	1869.4	2201.4	2865.2	3363.2	3430.6
125°	1016.6	1071.4	1126.1	1139.8	1373.1	1684.0	1839.5	2121.4	2685.5	3108.4	3170.5
127.5°	1083.6	1138.9	1194.2	1208.0	1410.1	1679.6	1814.4	2056.4	2540.7	2903.9	2956.3
130°	1119.5	1179.0	1238.5	1253.4	1437.2	1682.3	1804.8	2020.3	2451.4	2774.8	2823.1
132.5°	1156.5	1216.1	1275.7	1290.5	1459.2	1684.0	1796.4	1989.4	2375.3	2664.7	2708.1
135°	1211.6	1265.8	1320.0	1333.6	1483.1	1682.4	1782.1	1943.7	2266.9	2509.3	2546.6
137.5°	1267.8	1321.5	1375.1	1388.5	1518.9	1692.8	1779.7	1916.3	2189.5	2394.4	2425.0
140°	1314.4	1363.8	1413.3	1425.7	1540.8	1694.5	1771.3	1889.3	2125.3	2302.3	2330.9
142.5°	1350.3	1396.0	1441.7	1453.1	1559.2	1700.6	1771.3	1875.0	2082.3	2237.8	2262.3
145°	1405.3	1445.2	1485.1	1495.0	1583.1	1700.6	1759.4	1844.2	2013.7	2140.8	2159.5
147.5°	1460.3	1499.1	1537.9	1547.6	1618.2	1712.3	1759.4	1826.1	1959.5	2059.5	2074.9
150°	1496.2	1531.3	1566.4	1575.2	1636.6	1718.4	1759.4	1815.7	1928.4	2012.9	2025.3
152.5°	1533.3	1559.9	1586.5	1593.1	1648.6	1722.4	1759.4	1807.5	1903.7	1975.8	1985.3
155°	1588.3	1608.0	1627.6	1632.6	1674.8	1731.2	1759.4	1797.6	1874.2	1931.5	1937.8
157.5°	1629.0	1648.1	1667.3	1672.1	1701.2	1740.0	1759.4	1789.1	1848.6	1893.3	1897.7
160°	1656.5	1671.4	1686.3	1690.0	1713.1	1744.0	1759.4	1784.9	1835.9	1874.2	1876.7
162.5°	1684.0	1695.2	1706.3	1709.1	1725.9	1748.2	1759.4	1780.9	1824.0	1856.2	1858.6
165°	1713.9	1724.0	1734.0	1736.6	1744.2	1754.3	1759.4	1774.8	1805.6	1828.7	1831.2
167.5°	1741.4	1746.2	1751.0	1752.1	1758.5	1767.1	1771.3	1781.4	1801.6	1816.7	1817.8
170°	1759.4	1764.1	1768.9	1770.1	1770.5	1771.0	1771.3	1781.4	1801.6	1816.7	1816.7
172.5°	1768.9	1770.0	1771.1	1771.3	1771.3	1771.3	1771.3	1779.3	1795.3	1807.2	1806.3
175°	1782.1	1782.1	1782.1	1782.1	1778.5	1773.7	1771.3	1776.4	1786.5	1794.0	1794.0
177.5°	1782.1	1782.1	1782.1	1782.1	1779.3	1775.5	1773.7	1777.7	1785.6	1791.6	1790.6
180°	1782.1	1782.1	1782.1	1782.1	1782.1	1782.1	1782.1	1782.1	1782.1	1782.1	1782.1



TEST NUMBER: P937921

CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (continued):

	80°	90°
0°	718.4	718.4
2.5°	766.9	762.3
5°	986.4	991.1
7.5°	1328.3	1326.0
10°	1651.7	1672.5
12.5°	1887.3	1892.0
15°	2030.6	2039.8
17.5°	2086.0	2088.3
20°	2088.3	2083.7
22.5°	2062.9	2058.3
25°	2032.9	2030.6
27.5°	2005.2	2007.5
30°	1993.6	2000.5
32.5°	1993.6	2005.2
35°	1998.2	2009.8
37.5°	1995.9	2009.8
40°	1986.7	2002.8
42.5°	1961.3	1972.8
45°	1922.0	1935.9
47.5°	1871.2	1880.4
50°	1806.5	1815.7
52.5°	1725.6	1728.0
55°	1628.6	1637.9
57.5°	1524.7	1527.0
60°	1409.2	1416.1
62.5°	1286.7	1286.7
65°	1157.4	1162.0
67.5°	1023.4	1035.0
70°	887.1	889.4
72.5°	753.1	753.1
75°	614.5	616.8
77.5°	482.8	482.8
80°	358.0	360.4
82.5°	247.2	251.8
85°	154.8	154.8
87.5°	71.6	64.7
90°	45.4	45.4
92.5°	182.0	145.9
95°	634.6	525.1
97.5°	1520.4	1312.0
100°	2190.6	1942.3
102.5°	2849.8	2637.2
105°	3690.4	3576.1
107.5°	4240.9	4268.6
110°	4450.9	4570.0



TEST NUMBER: P937921

CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (continued):

	80°	90°
112.5°	4469.6	4652.5
115°	4351.1	4604.7
117.5°	4099.8	4381.0
120°	3897.3	4170.5
122.5°	3700.1	3969.6
125°	3418.7	3667.0
127.5°	3165.7	3375.1
130°	3016.6	3210.1
132.5°	2881.3	3054.6
135°	2695.9	2845.3
137.5°	2547.2	2669.5
140°	2445.2	2559.5
142.5°	2360.7	2459.0
145°	2233.8	2308.3
147.5°	2136.6	2198.3
150°	2075.4	2125.4
152.5°	2023.0	2060.8
155°	1962.8	1987.8
157.5°	1915.2	1932.8
160°	1886.8	1896.9
162.5°	1868.2	1877.7
165°	1841.3	1851.5
167.5°	1822.1	1826.3
170°	1816.7	1816.7
172.5°	1802.5	1798.8
175°	1794.0	1794.0
177.5°	1786.3	1782.1
180°	1782.1	1782.1



TEST NUMBER: P937921
 CATALOG NUMBER: SQ4-FB-125U-075D-927-1D-UNV-STD-W-12

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	1.92	2.67	3.01	3.76	5.26	15.11	15.86	16.20	16.95	18.45
	3H	2.62	3.29	3.71	4.39	5.90	16.95	17.62	18.05	18.72	20.23
	4H	2.91	3.55	4.02	4.65	6.17	17.59	18.23	18.70	19.33	20.85
	6H	3.15	3.74	4.27	4.84	6.38	18.02	18.61	19.14	19.71	21.24
	8H	3.22	3.78	4.34	4.90	6.42	18.14	18.70	19.26	19.82	21.35
	12H	3.23	3.76	4.36	4.88	6.43	18.21	18.74	19.33	19.85	21.40
4H	2H	9.13	9.77	10.25	10.87	12.39	15.37	16.01	16.49	17.11	18.63
	3H	10.69	11.22	11.81	12.35	13.88	17.41	17.94	18.53	19.07	20.61
	4H	10.78	11.27	11.90	12.38	13.94	18.18	18.67	19.30	19.78	21.34
	6H	10.78	11.20	11.91	12.34	13.88	18.72	19.14	19.85	20.27	21.82
	8H	10.75	11.15	11.89	12.28	13.84	18.88	19.27	20.01	20.40	21.96
	12H	10.70	11.06	11.85	12.20	13.77	18.97	19.32	20.12	20.47	22.03
8H	4H	12.21	12.61	13.35	13.74	15.30	18.23	18.62	19.36	19.75	21.31
	6H	12.45	12.78	13.60	13.95	15.51	18.86	19.18	20.01	20.35	21.91
	8H	12.47	12.75	13.63	13.90	15.48	19.08	19.36	20.24	20.51	22.09
	12H	12.43	12.68	13.59	13.83	15.44	19.22	19.47	20.38	20.62	22.23
12H	4H	12.35	12.71	13.50	13.85	15.42	18.18	18.53	19.32	19.67	21.24
	6H	12.71	12.99	13.87	14.15	15.73	18.84	19.12	20.00	20.27	21.85
	8H	12.77	13.02	13.94	14.17	15.79	19.07	19.31	20.23	20.46	22.08