

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P936552

Luminaire Tested: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

Issue Date: 12/17/2024

Test Information

Test Method: LM-79-2019
Report Number: P936552
REPORT IS A COMBINATION OF REPORTS P933456 AND P933786
Test Lab: INNOVATION CENTER
Issue Date: 12/17/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8
Description: CORELITE SQ4 SUSPENDED INDIRECT LED LUMINAIRE WITH Batwing Frosted Continuous Roll L
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8093.5 lumens
Efficiency: N/A
Efficacy: 81.6 lumens/watt
Spacing Criteria (0/90/45): 0.71 / 2.69 / 2.33
Luminous Opening: Rectangular w/ Sides (W: 0.29' x L: 8' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 99.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P936552
CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

Luminous Intensity Polar Plot

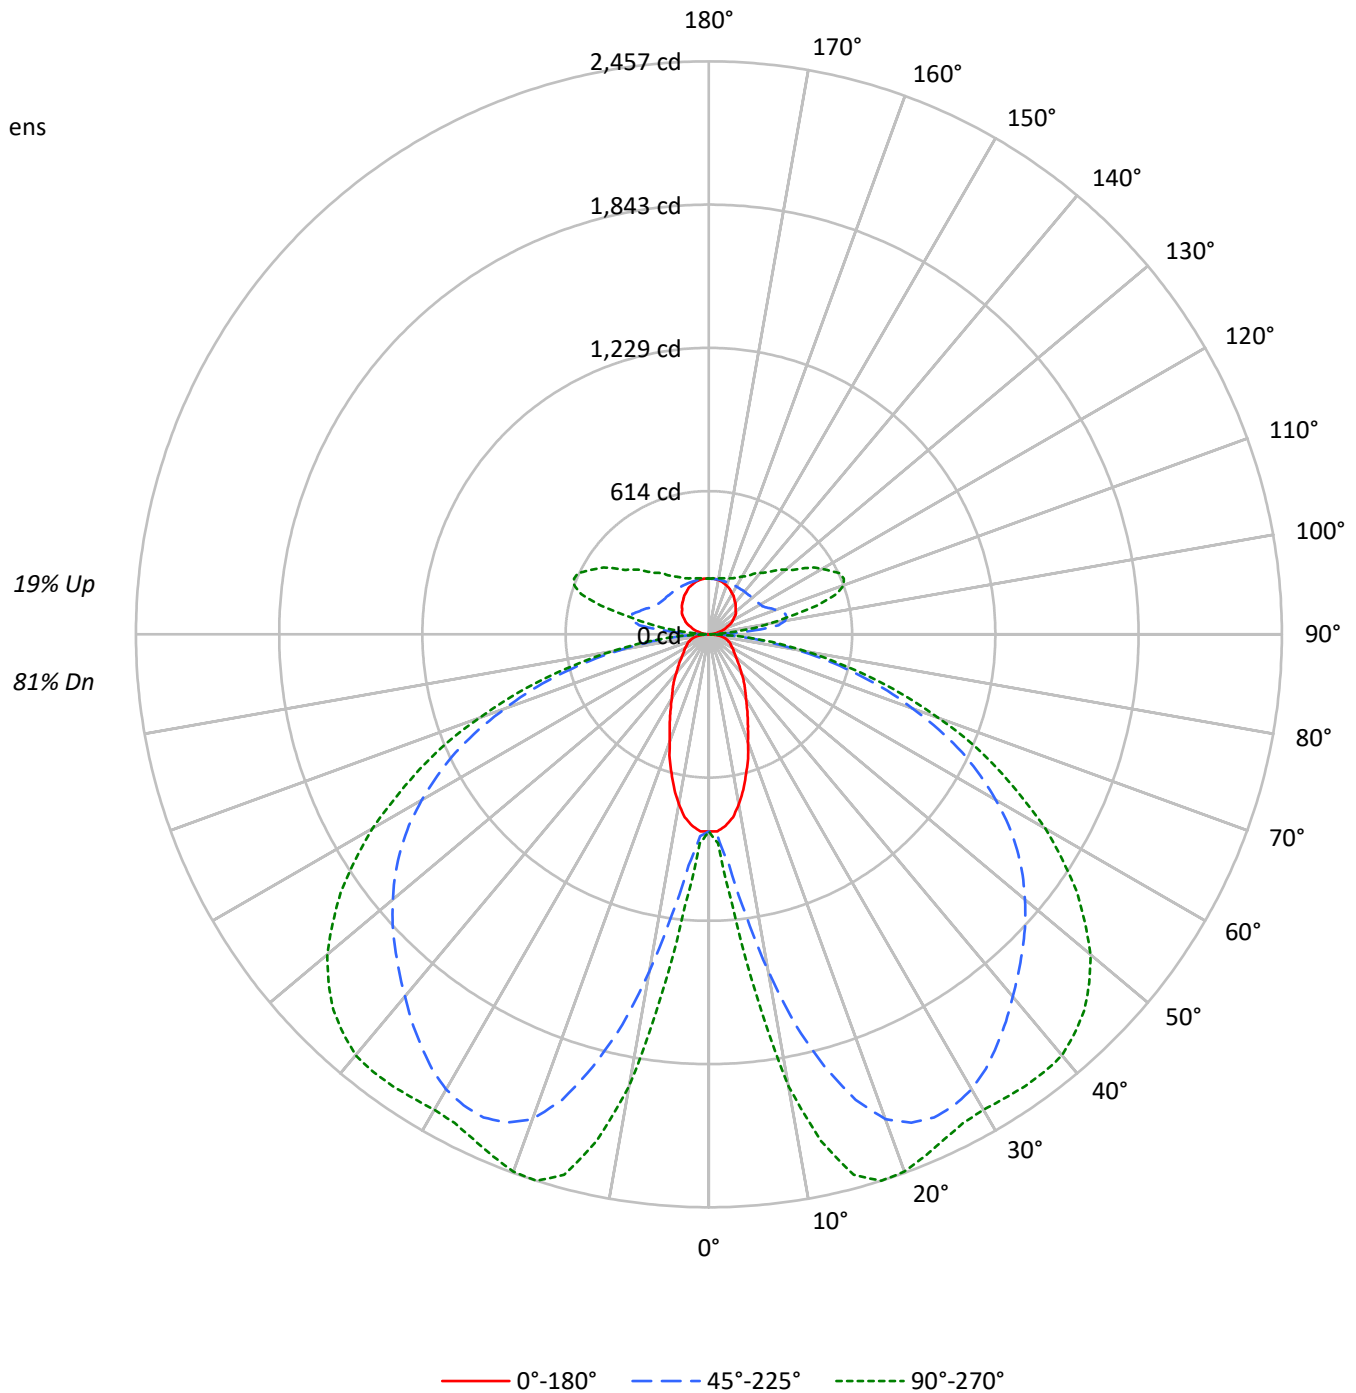



TEST NUMBER: P936552

CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	114	114	114	114	110	110	110	110	100	100	100	92	92	92	84	84	84	84	84	84	81
1	104	99	94	90	99	95	91	87	87	84	81	80	77	75	73	71	70	70	70	70	66
2	94	85	78	72	89	82	75	70	75	70	66	69	65	61	63	60	57	57	57	57	54
3	85	74	66	59	81	71	64	58	65	59	54	60	55	51	55	51	48	48	48	48	45
4	77	65	56	49	74	63	54	48	58	51	45	53	47	43	49	44	40	40	40	40	37
5	71	58	49	42	67	55	47	41	51	44	39	47	41	36	43	38	34	34	34	34	32
6	65	51	42	36	62	49	41	35	46	39	33	42	36	31	39	34	30	30	30	30	27
7	60	46	37	31	57	45	36	30	41	34	29	38	32	27	35	30	26	26	26	26	24
8	55	42	33	27	53	40	32	27	37	30	25	35	29	24	32	27	23	23	23	23	21
9	52	38	30	24	49	37	29	24	34	27	23	32	26	22	29	24	20	20	20	20	18
10	48	35	27	22	46	34	26	21	31	25	20	29	23	19	27	22	18	18	18	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3921	3921	3921
5°	3831	4533	5271
10°	3475	6607	8739
15°	2953	8632	10552
20°	2404	10003	10754
25°	2006	10468	10536
30°	1691	10534	10516
35°	1496	10359	10788
40°	1304	10132	11069
45°	1180	9965	11112
50°	1082	9815	10928
55°	1037	9596	10444
60°	1061	9174	9679
65°	1104	8534	8628
70°	1176	7442	7289
75°	1303	6068	5688
80°	1425	4208	3833
85°	1262	2233	1962

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 45°
 Luminance: 11112 cd/sqm



TEST NUMBER: P936552

CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	109.3	1.4
10°-20°	484.6	6.0
20°-30°	847.6	10.5
30°-40°	1091.1	13.5
40°-50°	1218.7	15.1
50°-60°	1167.3	14.4
60°-70°	925.1	11.4
70°-80°	544.0	6.7
80°-90°	152.0	1.9
90°-100°	116.8	1.4
100°-110°	307.2	3.8
110°-120°	318.5	3.9
120°-130°	255.5	3.2
130°-140°	200.4	2.5
140°-150°	153.9	1.9
150°-160°	110.8	1.4
160°-170°	67.8	0.8
170°-180°	22.9	0.3
0°-30°	1441.5	17.8
0°-40°	2532.6	31.3
0°-60°	4918.7	60.8
0°-90°	6539.7	80.8
90°-120°	742.5	9.2
90°-150°	1352.2	16.7
90°-180°	1554.0	19.2
0°-180°	8093.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	845	845	845	845	845	
5°	824	883	995	1125	1166	76
15°	617	1139	1919	2326	2400	172
25°	394	1291	2286	2386	2389	182
35°	266	1234	2152	2275	2364	166
45°	182	984	1902	2180	2278	141
55°	130	625	1614	1875	1927	119
65°	103	332	1199	1348	1367	102
75°	76	204	658	723	726	80
85°	27	62	163	179	182	29
90°	2	4	12	6	6	3
95°	15	60	201	104	71	17
105°	55	84	340	516	481	59
115°	98	119	272	543	619	97
125°	137	153	247	418	493	121
135°	163	179	240	338	383	126
145°	189	201	237	288	310	118
155°	214	220	237	260	267	98
165°	230	234	237	246	249	65
175°	240	240	238	241	241	23
180°	240	240	240	240	240	



TEST NUMBER: P936552

CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (FULL):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
0°	845.2	845.2	845.2	845.2	845.2	845.2	845.2	845.2	845.2	845.2	845.2
2.5°	845.2	845.2	850.7	853.4	858.8	861.5	867.0	872.5	888.8	891.5	896.9
5°	823.5	834.4	869.7	883.3	921.4	973.0	994.8	1030.1	1103.4	1125.2	1138.7
7.5°	790.9	815.4	902.3	924.1	1019.2	1155.1	1212.1	1288.3	1405.1	1462.2	1508.4
10°	739.2	790.9	945.8	997.4	1152.4	1358.9	1464.9	1570.9	1747.6	1826.4	1856.3
12.5°	682.1	766.5	992.0	1062.7	1285.5	1587.2	1715.0	1831.8	2033.0	2139.0	2155.3
15°	616.9	731.1	1035.5	1138.7	1426.9	1777.4	1918.8	2062.8	2250.4	2326.5	2345.5
17.5°	559.9	703.9	1076.3	1185.0	1535.6	1948.7	2092.7	2212.3	2364.5	2416.1	2429.7
20°	489.2	660.5	1103.4	1244.7	1649.8	2073.7	2212.3	2304.7	2408.0	2440.6	2446.0
22.5°	437.6	614.2	1119.8	1266.5	1725.8	2149.8	2266.7	2340.0	2410.7	2421.6	2424.3
25°	394.1	562.6	1117.1	1291.0	1791.1	2196.0	2285.7	2340.0	2380.8	2386.3	2386.3
27.5°	353.3	505.5	1106.1	1296.4	1840.0	2206.9	2277.5	2315.6	2334.6	2345.5	2345.5
30°	318.0	451.1	1079.0	1285.5	1861.8	2196.0	2253.1	2272.1	2291.1	2307.4	2315.6
32.5°	290.8	399.5	1038.2	1263.8	1864.4	2168.8	2209.6	2220.5	2247.7	2285.7	2299.3
35°	266.4	347.9	992.0	1233.9	1848.1	2125.4	2152.5	2163.4	2217.7	2274.8	2293.8
37.5°	241.9	309.8	932.2	1182.3	1823.7	2073.7	2092.7	2111.7	2196.0	2264.0	2285.7
40°	217.5	277.2	861.5	1125.2	1785.6	2011.2	2027.5	2057.4	2168.8	2247.7	2269.4
42.5°	198.4	250.1	785.5	1065.4	1736.7	1940.5	1965.0	2008.5	2136.2	2220.5	2244.9
45°	182.1	222.8	703.9	983.8	1674.2	1867.1	1902.5	1962.3	2098.2	2179.7	2201.4
47.5°	165.8	203.8	619.7	899.6	1606.2	1793.7	1840.0	1907.9	2046.5	2125.4	2144.4
50°	152.2	184.9	535.4	809.9	1532.8	1715.0	1769.3	1840.0	1981.3	2054.7	2079.1
52.5°	141.3	168.5	456.6	720.2	1448.6	1633.4	1695.9	1769.3	1902.5	1973.1	1989.4
55°	130.5	154.9	388.7	625.1	1361.6	1546.4	1614.4	1685.1	1815.5	1875.3	1886.2
57.5°	125.0	144.1	331.6	535.4	1269.2	1448.6	1524.7	1589.9	1712.2	1758.4	1769.3
60°	116.8	135.9	288.1	459.3	1168.7	1356.2	1421.4	1486.7	1589.9	1628.0	1636.1
62.5°	108.7	130.5	255.5	385.9	1065.4	1247.5	1312.7	1372.5	1459.5	1486.7	1497.5
65°	103.3	125.0	231.0	331.6	959.4	1133.4	1198.6	1250.2	1320.9	1348.1	1353.5
67.5°	97.8	119.6	212.0	285.4	853.4	1019.2	1068.1	1117.1	1171.4	1198.6	1201.3
70°	89.7	114.2	195.7	252.8	744.7	888.8	929.5	981.1	1024.6	1038.2	1046.4
72.5°	84.2	106.0	184.9	228.3	633.2	763.7	801.8	831.7	869.7	883.3	883.3
75°	76.1	95.2	173.9	203.8	519.1	625.1	657.7	687.6	717.5	722.9	714.8
77.5°	67.9	84.2	149.5	171.2	405.0	494.6	521.8	538.2	562.6	568.0	570.8
80°	57.1	73.4	116.8	133.1	293.5	364.2	383.2	396.8	418.5	418.5	424.0
82.5°	43.5	57.1	84.2	95.2	198.4	250.1	266.4	274.5	288.1	288.1	288.1
85°	27.1	35.3	54.4	62.5	119.6	152.2	163.1	165.8	176.7	179.4	179.4
87.5°	13.6	19.0	35.3	38.1	62.5	78.9	78.9	84.2	84.2	81.5	78.9
90°	1.6	2.9	4.2	4.5	7.1	10.5	12.2	10.8	8.1	6.1	6.1
92.5°	6.4	17.3	28.3	31.1	43.7	60.5	68.8	60.3	43.4	30.6	29.4
95°	15.4	35.4	55.5	60.5	107.4	169.9	201.2	179.6	136.3	103.7	100.1
97.5°	26.7	44.4	62.0	66.4	144.6	248.9	301.1	287.5	260.1	239.5	232.5
100°	35.4	51.4	67.4	71.4	158.2	273.9	331.8	332.8	334.9	336.4	328.0
102.5°	42.8	57.7	72.7	76.4	164.5	281.9	340.6	358.0	392.8	419.0	411.9
105°	55.3	68.0	80.7	83.8	169.1	282.7	339.6	378.7	456.9	515.5	511.7
107.5°	68.2	80.0	91.8	94.8	169.9	270.1	320.2	374.8	483.9	565.7	566.7
110°	76.9	87.5	98.2	100.9	168.6	259.0	304.2	365.1	487.1	578.6	582.6



TEST NUMBER: P936552

CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (continued):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
112.5°	85.4	95.6	105.7	108.2	168.7	249.3	289.6	352.0	476.7	570.4	576.6
115°	98.3	107.6	117.0	119.3	170.2	238.1	272.0	332.1	452.4	542.6	551.1
117.5°	111.0	119.5	128.0	130.2	173.4	231.1	259.9	314.2	422.7	504.1	513.6
120°	118.4	126.4	134.4	136.4	176.0	228.8	255.1	304.7	403.8	478.2	487.3
122.5°	125.6	133.7	141.8	143.8	179.7	227.5	251.4	296.1	385.4	452.3	461.4
125°	136.8	144.1	151.4	153.3	184.7	226.5	247.4	285.3	361.2	418.0	426.4
127.5°	145.7	153.1	160.6	162.4	189.7	225.9	244.0	276.6	341.8	390.6	397.6
130°	150.6	158.6	166.5	168.5	193.3	226.3	242.7	271.7	329.7	373.2	379.7
132.5°	155.5	163.6	171.5	173.5	196.3	226.5	241.6	267.6	319.4	358.4	364.2
135°	162.9	170.2	177.5	179.4	199.5	226.3	239.7	261.5	304.9	337.5	342.5
137.5°	170.5	177.7	184.9	186.8	204.3	227.7	239.4	257.8	294.5	322.0	326.1
140°	176.7	183.4	190.1	191.8	207.3	227.9	238.3	254.1	285.9	309.6	313.5
142.5°	181.6	187.7	193.9	195.5	209.7	228.8	238.3	252.2	280.1	301.0	304.3
145°	189.0	194.4	199.7	201.1	213.0	228.8	236.6	248.0	270.9	288.0	290.4
147.5°	196.4	201.6	206.9	208.1	217.6	230.3	236.6	245.6	263.5	277.0	279.0
150°	201.2	206.0	210.6	211.8	220.1	231.1	236.6	244.2	259.4	270.7	272.4
152.5°	206.2	209.7	213.4	214.2	221.7	231.7	236.6	243.1	256.0	265.7	267.0
155°	213.6	216.2	218.9	219.5	225.2	232.9	236.6	241.8	252.1	259.8	260.6
157.5°	219.1	221.6	224.2	224.8	228.8	234.0	236.6	240.7	248.6	254.6	255.2
160°	222.8	224.8	226.8	227.2	230.4	234.6	236.6	240.1	246.9	252.1	252.4
162.5°	226.4	228.0	229.4	229.8	232.1	235.1	236.6	239.5	245.3	249.7	250.0
165°	230.5	231.9	233.3	233.6	234.6	236.0	236.6	238.7	242.8	246.0	246.3
167.5°	234.2	234.9	235.5	235.7	236.6	237.7	238.3	239.6	242.3	244.4	244.5
170°	236.6	237.3	237.9	238.1	238.2	238.3	238.3	239.6	242.3	244.4	244.4
172.5°	237.9	238.1	238.3	238.3	238.3	238.3	238.3	239.3	241.5	243.1	242.9
175°	239.7	239.7	239.7	239.7	239.2	238.6	238.3	238.9	240.3	241.3	241.3
177.5°	239.7	239.7	239.7	239.7	239.3	238.8	238.6	239.1	240.2	241.0	240.8
180°	239.7	239.7	239.7	239.7	239.7	239.7	239.7	239.7	239.7	239.7	239.7



TEST NUMBER: P936552

CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (continued):

	80°	90°
0°	845.2	845.2
2.5°	902.3	896.9
5°	1160.5	1166.0
7.5°	1562.7	1560.1
10°	1943.3	1967.8
12.5°	2220.5	2225.9
15°	2389.0	2399.8
17.5°	2454.2	2456.9
20°	2456.9	2451.5
22.5°	2427.1	2421.6
25°	2391.7	2389.0
27.5°	2359.1	2361.8
30°	2345.5	2353.7
32.5°	2345.5	2359.1
35°	2350.9	2364.5
37.5°	2348.2	2364.5
40°	2337.4	2356.4
42.5°	2307.4	2321.1
45°	2261.2	2277.5
47.5°	2201.4	2212.3
50°	2125.4	2136.2
52.5°	2030.2	2033.0
55°	1916.0	1927.0
57.5°	1793.7	1796.5
60°	1657.9	1666.1
62.5°	1513.8	1513.8
65°	1361.6	1367.1
67.5°	1204.0	1217.6
70°	1043.7	1046.4
72.5°	886.0	886.0
75°	722.9	725.7
77.5°	568.0	568.0
80°	421.3	424.0
82.5°	290.8	296.2
85°	182.1	182.1
87.5°	84.2	76.1
90°	6.1	6.1
92.5°	24.5	19.6
95°	85.4	70.6
97.5°	204.4	176.4
100°	294.6	261.2
102.5°	383.3	354.7
105°	496.3	480.9
107.5°	570.4	574.1
110°	598.6	614.6



TEST NUMBER: P936552

CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (continued):

	80°	90°
112.5°	601.1	625.7
115°	585.2	619.3
117.5°	551.4	589.2
120°	524.1	560.9
122.5°	497.6	533.8
125°	459.8	493.2
127.5°	425.8	453.9
130°	405.7	431.7
132.5°	387.5	410.8
135°	362.6	382.6
137.5°	342.6	359.0
140°	328.8	344.2
142.5°	317.5	330.7
145°	300.5	310.4
147.5°	287.3	295.7
150°	279.1	285.9
152.5°	272.1	277.1
155°	263.9	267.3
157.5°	257.6	259.9
160°	253.7	255.1
162.5°	251.3	252.5
165°	247.6	249.0
167.5°	245.1	245.6
170°	244.4	244.4
172.5°	242.4	241.9
175°	241.3	241.3
177.5°	240.3	239.7
180°	239.7	239.7



TEST NUMBER: P936552
 CATALOG NUMBER: SQ4-FB-025U-125D-930-1D-UNV-STD-W-8

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.18	9.48	8.81	10.13	10.88	21.36	22.66	21.99	23.31	24.06
	3H	8.91	10.09	9.56	10.75	11.53	23.23	24.40	23.87	25.06	25.85
	4H	9.23	10.35	9.90	11.02	11.81	23.89	25.00	24.56	25.68	26.47
	6H	9.51	10.54	10.18	11.22	12.03	24.34	25.38	25.02	26.06	26.87
	8H	9.59	10.57	10.28	11.28	12.09	24.48	25.46	25.17	26.17	26.98
	12H	9.62	10.56	10.31	11.26	12.10	24.56	25.50	25.26	26.20	27.04
4H	2H	15.44	16.56	16.11	17.23	18.02	21.68	22.79	22.35	23.47	24.26
	3H	17.05	17.99	17.73	18.70	19.51	23.77	24.70	24.45	25.41	26.23
	4H	17.16	18.02	17.86	18.73	19.57	24.55	25.40	25.25	26.12	26.96
	6H	17.20	17.94	17.92	18.68	19.53	25.12	25.86	25.83	26.60	27.45
	8H	17.19	17.88	17.91	18.62	19.49	25.29	25.99	26.01	26.72	27.59
	12H	17.17	17.79	17.91	18.55	19.43	25.41	26.03	26.15	26.79	27.66
8H	4H	18.65	19.34	19.37	20.08	20.94	24.65	25.34	25.37	26.08	26.95
	6H	18.91	19.49	19.66	20.27	21.13	25.30	25.88	26.05	26.66	27.52
	8H	18.93	19.45	19.70	20.23	21.11	25.53	26.04	26.29	26.82	27.70
	12H	18.92	19.38	19.69	20.15	21.09	25.69	26.15	26.46	26.92	27.86
12H	4H	18.81	19.44	19.56	20.20	21.07	24.62	25.25	25.37	26.01	26.88
	6H	19.17	19.69	19.94	20.47	21.35	25.29	25.81	26.05	26.58	27.47
	8H	19.27	19.72	20.03	20.49	21.43	25.54	26.00	26.31	26.77	27.71