

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: CORELITE

Report Number: P562495

Luminaire Tested: **SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)**

Issue Date: 7/30/2021

Test Information

Test Method: LM-79-2019
Report Number: P562495
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2101-105-51, G2-2106-289-3)
Test Lab: INNOVATION CENTER
Issue Date: 7/30/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: CORELITE
Catalog Number: SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)
Description: CORELITE SQ4 SUSPENDED LED LUMINAIRE WITH PERCEIVE WAVES CONTINUOUS LENS
DOWNLIGHT 1250 LUMENS PER FOOT
UPLIGHT 1500 LUMENS PER FOOT
Light Source: 2700K/65000K CCT, 90 CRI LEDS, TUNED TO 4000K CCT
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11781.8 lumens
Efficiency: N/A
Efficacy: 110.1 lumens/watt
Spacing Criteria (0/90/45): 1.22 / 1.19 / 1.31
Luminous Opening: Rectangular (W 0.29' x L: 4' x H: 0')
CIE Type: General Diffuse

Input Watts (W): 107
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P562495
CATALOG NUMBER: SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)

Luminous Intensity Polar Plot

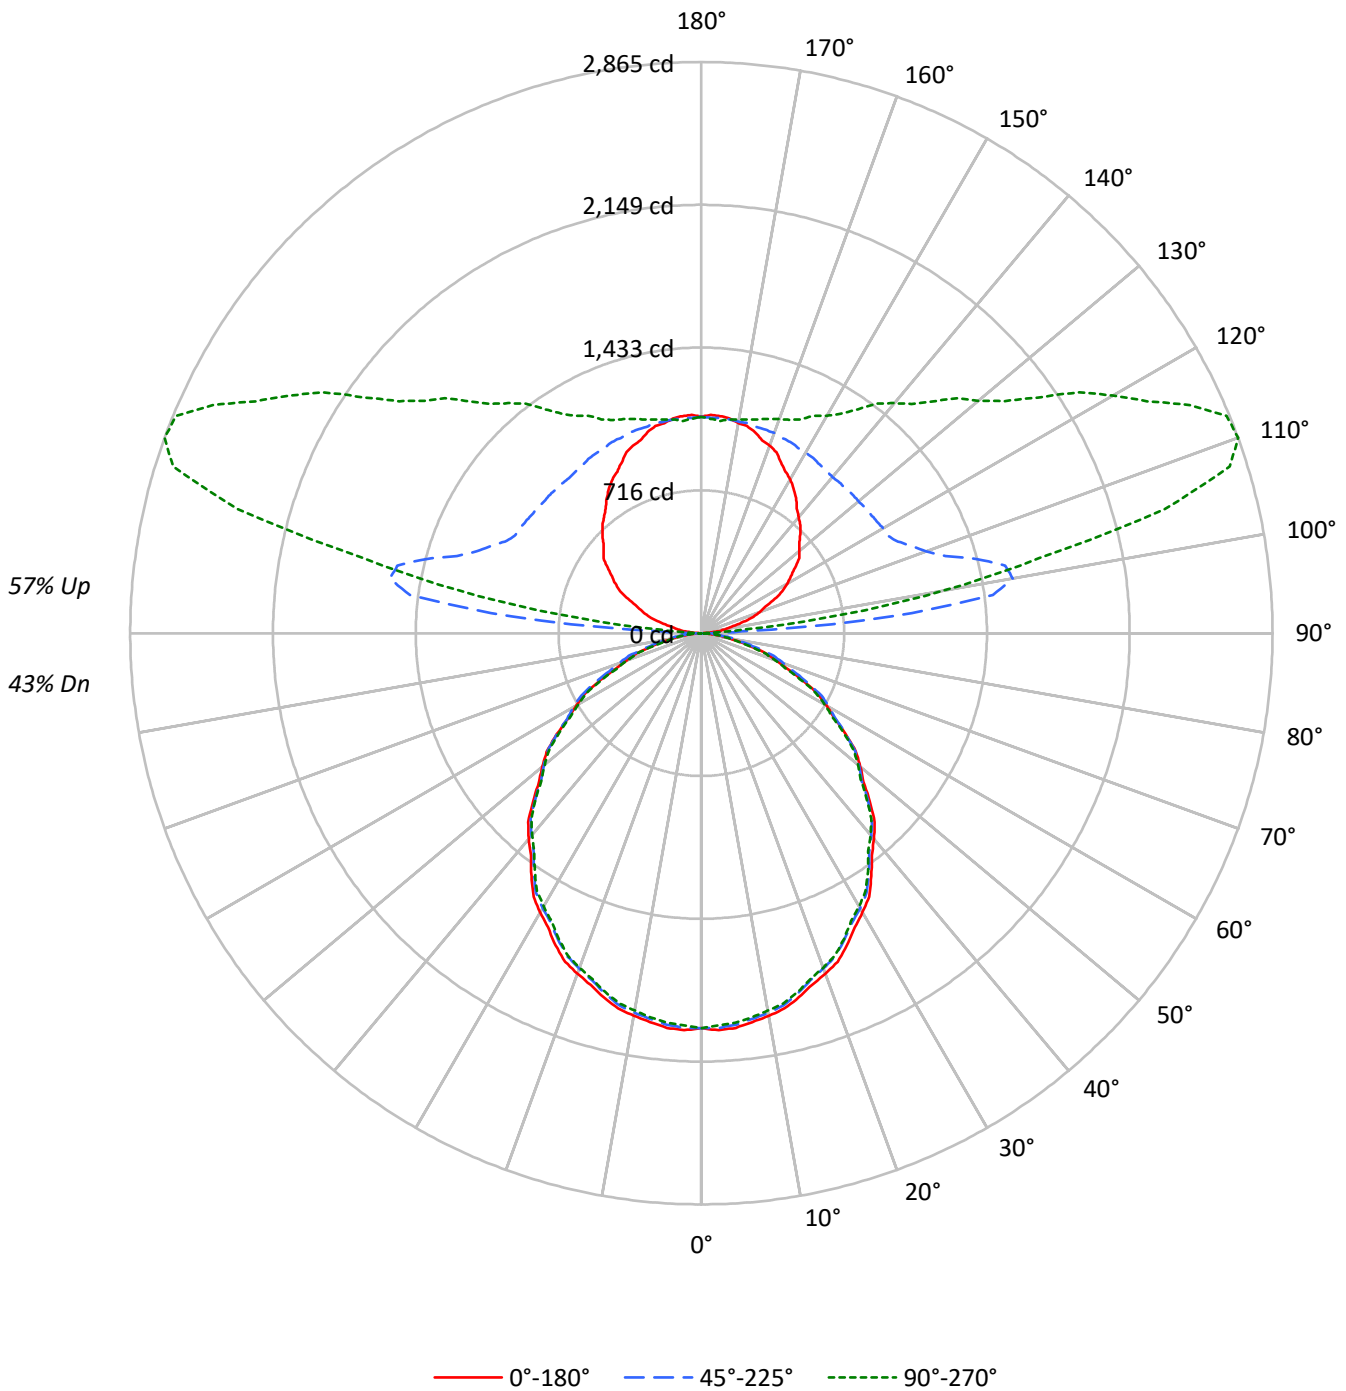



TEST NUMBER: P562495

CATALOG NUMBER: SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50	43
1	96	92	88	85	88	84	81	78	70	67	65	56	55	53	44	43	42	36
2	88	80	74	69	80	74	69	64	61	57	54	49	47	45	39	37	35	30
3	80	71	64	58	73	65	59	54	54	49	46	44	40	38	34	32	30	26
4	73	63	55	49	67	57	51	45	48	43	39	39	35	32	31	28	26	22
5	67	56	48	42	61	51	44	39	43	38	33	35	31	28	28	25	23	19
6	62	50	42	36	56	46	39	34	39	33	29	32	28	25	25	22	20	17
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18	15
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16	13
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14	12
10	46	34	27	22	42	32	25	21	27	22	18	22	18	16	18	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	18284	18284	18284
5°	18402	18257	18177
10°	18256	18108	18010
15°	18062	17863	17796
20°	17847	17572	17537
25°	17597	17277	17225
30°	17226	16965	16853
35°	16736	16500	16401
40°	16214	15962	15898
45°	15583	15378	15310
50°	14938	14811	14711
55°	14240	14240	14015
60°	13371	13629	13145
65°	12236	12845	11931
70°	10788	11823	10504
75°	9211	10580	8962
80°	7141	8905	7237
85°	4626	6838	6097



TEST NUMBER: P562495

CATALOG NUMBER: SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	186.6	1.6
10°-20°	526.9	4.5
20°-30°	781.5	6.6
30°-40°	914.5	7.8
40°-50°	910.4	7.7
50°-60°	786.2	6.7
60°-70°	565.9	4.8
70°-80°	296.7	2.5
80°-90°	73.6	0.6
90°-100°	494.4	4.2
100°-110°	1406.7	11.9
110°-120°	1347.8	11.4
120°-130°	1066.7	9.1
130°-140°	856.2	7.3
140°-150°	670.3	5.7
150°-160°	490.5	4.2
160°-170°	303.8	2.6
170°-180°	103.1	0.9
0°-30°	1495.0	12.7
0°-40°	2409.5	20.5
0°-60°	4106.0	34.9
0°-90°	5042.2	42.8
90°-120°	3249.0	27.6
90°-150°	5842.2	49.6
90°-180°	6740.0	57.2
0°-180°	11781.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1982	1982	1982	1982	1982	
5°	1987	1965	1971	1966	1963	188
15°	1891	1867	1870	1866	1863	533
25°	1729	1700	1697	1687	1692	795
35°	1486	1465	1465	1451	1456	929
45°	1194	1184	1179	1175	1173	921
55°	885	884	885	873	871	790
65°	560	578	588	565	546	555
75°	258	282	297	277	251	277
85°	44	57	65	61	58	58
90°	0	0	0	0	0	4
95°	54	213	957	331	204	61
105°	219	332	1434	2532	2407	231
115°	406	491	1087	2303	2704	400
125°	573	636	1038	1722	2059	513
135°	701	760	1025	1454	1644	541
145°	827	870	1033	1259	1372	517
155°	945	967	1058	1138	1184	437
165°	1044	1048	1070	1094	1110	294
175°	1093	1087	1083	1076	1068	104
180°	1085	1085	1085	1085	1085	

TEST NUMBER: P562495

CATALOG NUMBER: SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1981.8	1981.8	1981.8	1981.8	1981.8
2.5°	1993.0	1976.6	1981.8	1977.4	1967.8
5°	1987.0	1964.8	1971.3	1966.0	1962.6
7.5°	1966.8	1946.3	1951.1	1945.4	1943.4
10°	1948.6	1928.1	1932.9	1925.8	1922.4
12.5°	1927.7	1905.8	1910.6	1903.5	1901.5
15°	1891.0	1867.1	1870.1	1866.5	1863.1
17.5°	1848.4	1824.2	1824.7	1819.0	1818.4
20°	1817.7	1792.1	1789.7	1782.8	1786.2
22.5°	1784.1	1757.2	1754.8	1745.1	1749.9
25°	1728.6	1699.6	1697.2	1686.8	1692.0
27.5°	1664.4	1635.7	1635.7	1621.2	1626.6
30°	1616.9	1589.6	1592.4	1575.1	1581.9
32.5°	1566.6	1542.0	1543.5	1526.2	1533.1
35°	1485.9	1465.4	1465.0	1451.1	1456.2
37.5°	1403.5	1385.4	1382.5	1374.5	1375.9
40°	1346.2	1330.9	1325.3	1320.0	1320.0
42.5°	1286.2	1272.2	1266.6	1262.7	1261.4
45°	1194.3	1184.1	1178.6	1175.1	1173.4
47.5°	1103.5	1094.0	1089.2	1086.7	1085.0
50°	1040.7	1033.8	1031.9	1026.7	1024.9
52.5°	977.8	973.7	971.9	965.2	963.5
55°	885.3	883.6	885.3	873.0	871.3
57.5°	788.9	791.6	797.3	780.8	776.7
60°	724.6	731.5	738.6	719.2	712.4
62.5°	659.0	669.9	679.9	657.7	648.1
65°	560.5	577.6	588.4	565.3	546.5
67.5°	465.5	486.7	499.7	474.8	453.6
70°	399.9	423.8	438.3	413.3	389.4
72.5°	342.6	369.2	381.0	357.4	333.5
75°	258.4	282.3	296.8	277.0	251.4
77.5°	183.3	205.9	217.9	200.7	179.5
80°	134.4	158.3	167.6	153.3	136.2
82.5°	95.3	115.1	121.5	112.9	101.3
85°	43.7	57.3	64.6	61.0	57.6
87.5°	11.2	20.7	26.5	26.6	27.9
90°	0.0	0.0	0.0	0.0	0.0
92.5°	16.5	87.5	203.0	59.1	44.6
95°	53.6	213.0	957.1	331.3	204.2
97.5°	98.6	249.5	1474.0	1054.7	722.8
100°	129.9	271.1	1586.2	1606.7	1237.6
102.5°	164.6	294.5	1561.5	2056.6	1734.3
105°	218.6	331.6	1433.6	2532.2	2407.2
107.5°	273.5	374.8	1284.2	2666.3	2777.6
110°	311.5	406.3	1198.4	2615.0	2865.1



TEST NUMBER: P562495

CATALOG NUMBER: SQ4-PW1-150U-125D-92765-1D-UNV-STD-W-4 (4000K)

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	347.8	437.7	1140.7	2493.7	2850.2
115°	406.4	491.1	1087.0	2302.8	2704.2
117.5°	457.9	537.4	1055.3	2094.2	2519.4
120°	499.2	565.7	1052.0	1975.0	2382.4
122.5°	532.2	598.7	1043.7	1870.4	2248.8
125°	573.4	636.0	1037.5	1721.8	2058.6
127.5°	618.4	676.9	1034.2	1632.9	1910.5
130°	641.5	700.0	1029.3	1571.1	1813.1
132.5°	666.3	723.1	1029.3	1522.8	1745.5
135°	701.3	759.8	1025.2	1454.4	1644.0
137.5°	734.3	791.2	1024.7	1396.5	1560.2
140°	759.1	817.6	1023.1	1348.5	1505.8
142.5°	787.1	835.9	1028.0	1310.1	1451.3
145°	827.1	869.5	1033.4	1258.7	1371.7
147.5°	861.4	902.5	1042.5	1206.8	1304.4
150°	891.1	919.3	1045.8	1189.7	1258.2
152.5°	914.2	944.0	1049.1	1166.5	1230.2
155°	944.7	966.9	1058.2	1137.6	1184.0
157.5°	982.7	996.0	1060.2	1124.5	1157.6
160°	1002.5	1012.6	1068.5	1114.5	1142.7
162.5°	1014.0	1025.7	1070.1	1106.1	1127.9
165°	1043.7	1047.8	1070.5	1093.6	1109.7
167.5°	1063.9	1060.3	1080.0	1090.5	1096.9
170°	1070.5	1068.5	1076.7	1079.0	1087.0
172.5°	1085.4	1078.5	1081.7	1075.6	1082.1
175°	1093.2	1087.2	1082.9	1076.5	1068.5
177.5°	1096.5	1086.8	1081.7	1075.1	1076.7
180°	1085.0	1085.0	1085.0	1085.0	1085.0

(END OF REPORT)