

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P936755

Luminaire Tested: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

Issue Date: 12/17/2024

Test Information

Test Method: LM-79-2019
Report Number: P936755
REPORT IS A COMBINATION OF REPORTS P933462 AND P933786
Test Lab: INNOVATION CENTER
Issue Date: 12/17/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K
Description: CORELITE SQ4 SUSPENDED INDIRECT LED LUMINAIRE WITH Batwing Frosted Continuous Roll L
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 11942.7 lumens
Efficiency: N/A
Efficacy: 109.4 lumens/watt
Spacing Criteria (0/90/45): 0.71 / 2.69 / 2.33
Luminous Opening: Rectangular w/ Sides (W: 0.29' x L: 12' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 109.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P936755
CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

Luminous Intensity Polar Plot

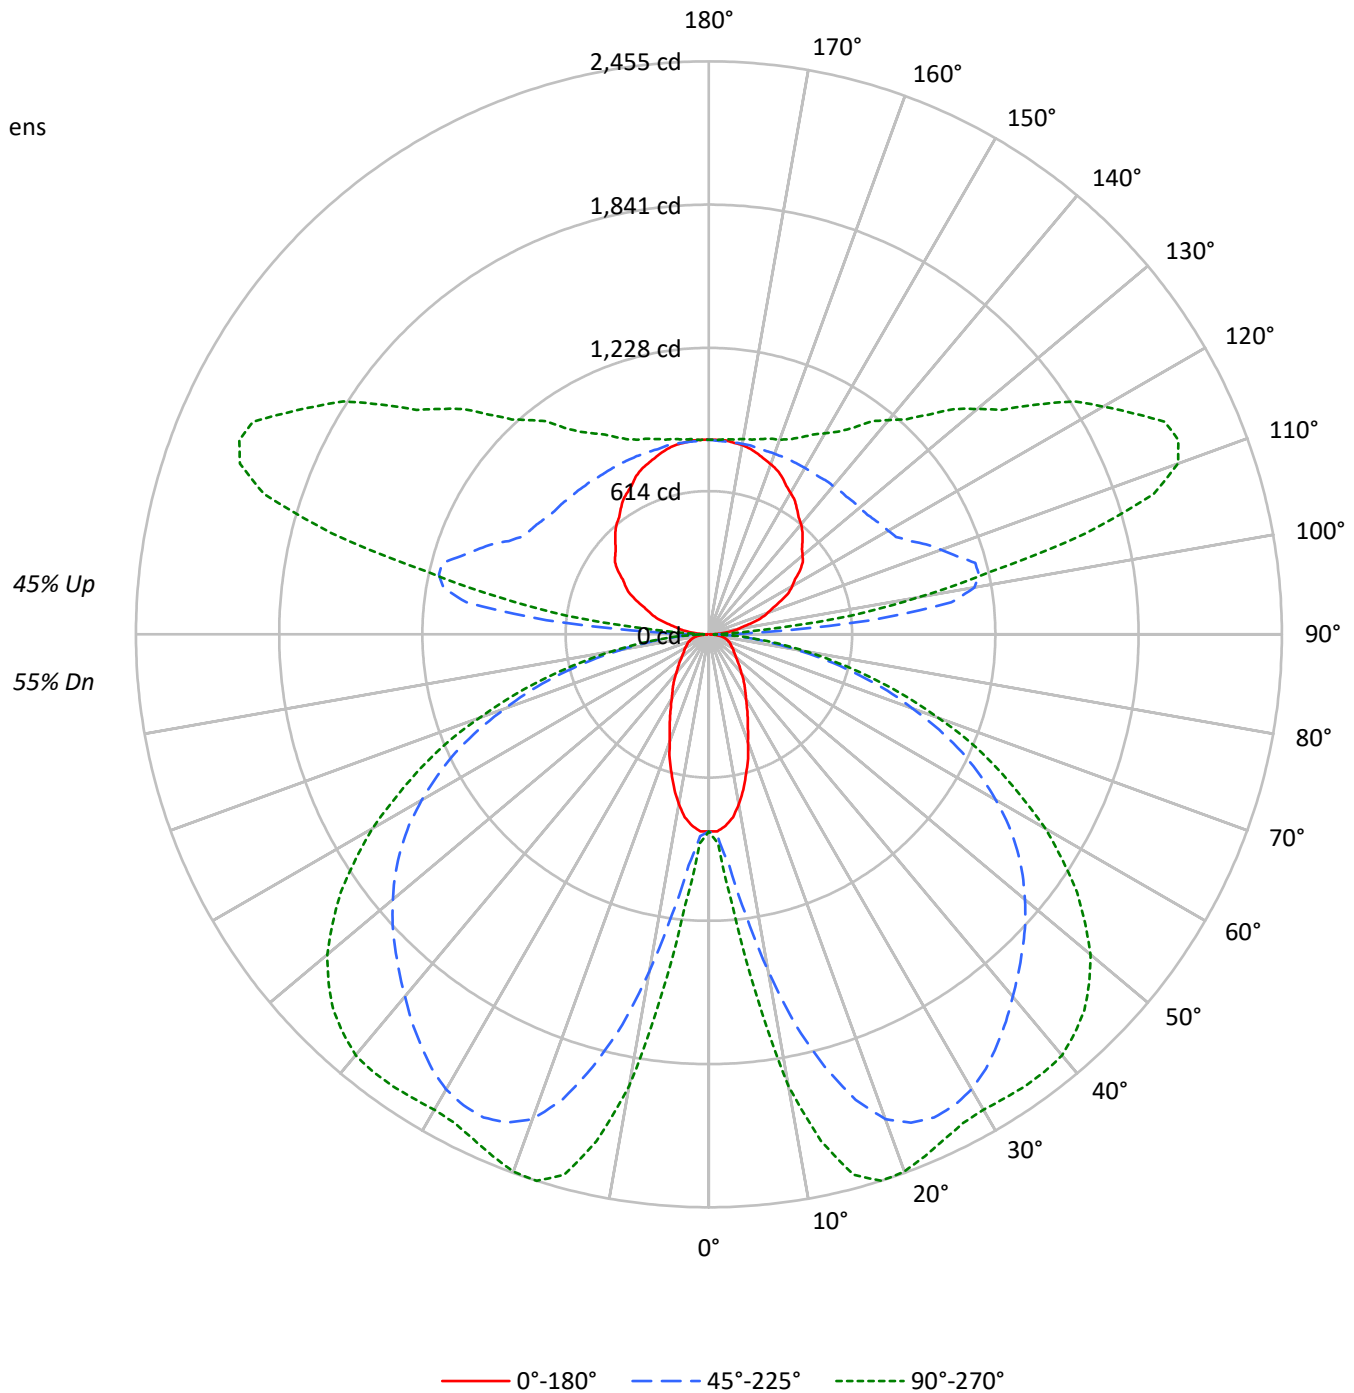



TEST NUMBER: P936755

CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60	55
1	98	94	89	86	91	87	83	80	75	72	69	63	61	59	53	51	50	45
2	89	81	74	69	82	75	70	65	65	60	56	55	51	49	45	43	41	37
3	81	71	63	57	74	66	59	53	56	51	47	48	44	40	40	37	34	30
4	73	62	54	47	68	58	50	45	50	44	39	42	38	34	35	32	29	25
5	67	55	46	40	62	51	44	38	44	38	33	37	33	29	31	28	25	21
6	62	49	40	34	57	46	38	32	39	33	29	33	29	25	28	24	21	18
7	57	44	36	30	52	41	34	28	35	29	25	30	25	22	25	22	19	16
8	53	40	32	26	49	37	30	25	32	26	22	27	23	19	23	19	16	14
9	49	36	28	23	45	34	27	22	29	23	19	25	20	17	21	17	15	12
10	46	33	25	20	42	31	24	19	27	21	17	23	18	15	19	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2612	2612	2612
5°	2553	3020	3511
10°	2316	4403	5821
15°	1969	5754	7029
20°	1604	6670	7164
25°	1338	6981	7018
30°	1129	7027	7005
35°	999	6913	7186
40°	871	6763	7373
45°	789	6654	7402
50°	725	6556	7280
55°	694	6412	6957
60°	712	6133	6447
65°	742	5708	5747
70°	792	4981	4856
75°	881	4065	3789
80°	969	2823	2553
85°	881	1500	1306

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 45°
 Luminance: 7402 cd/sqm



TEST NUMBER: P936755

CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	109.2	0.9
10°-20°	484.2	4.1
20°-30°	846.9	7.1
30°-40°	1090.2	9.1
40°-50°	1217.7	10.2
50°-60°	1166.3	9.8
60°-70°	924.3	7.7
70°-80°	543.5	4.6
80°-90°	154.2	1.3
90°-100°	406.5	3.4
100°-110°	1068.7	8.9
110°-120°	1108.1	9.3
120°-130°	888.9	7.4
130°-140°	697.4	5.8
140°-150°	535.3	4.5
150°-160°	385.5	3.2
160°-170°	235.9	2.0
170°-180°	79.7	0.7
0°-30°	1440.3	12.1
0°-40°	2530.6	21.2
0°-60°	4914.6	41.2
0°-90°	6536.6	54.7
90°-120°	2583.3	21.6
90°-150°	4704.9	39.4
90°-180°	5406.0	45.3
0°-180°	11942.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	844	844	844	844	844	
5°	823	882	994	1124	1165	76
15°	616	1138	1917	2324	2398	172
25°	394	1290	2284	2384	2387	181
35°	266	1233	2151	2273	2363	166
45°	182	983	1901	2178	2276	141
55°	130	625	1613	1874	1925	119
65°	103	331	1198	1347	1366	102
75°	76	204	657	722	725	80
85°	27	62	163	179	182	29
90°	6	16	42	21	21	6
95°	54	210	700	361	246	60
105°	192	292	1182	1794	1674	204
115°	342	415	946	1888	2155	338
125°	476	533	861	1455	1716	422
135°	567	624	834	1174	1332	439
145°	658	700	823	1002	1080	412
155°	743	764	823	904	930	342
165°	802	813	823	856	866	226
175°	834	834	829	840	840	79
180°	834	834	834	834	834	



TEST NUMBER: P936755

CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

CANDELA DISTRIBUTION (FULL):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
0°	844.5	844.5	844.5	844.5	844.5	844.5	844.5	844.5	844.5	844.5	844.5
2.5°	844.5	844.5	849.9	852.7	858.1	860.8	866.2	871.7	888.0	890.7	896.1
5°	822.8	833.7	869.0	882.5	920.5	972.1	993.9	1029.3	1102.6	1124.3	1137.9
7.5°	790.2	814.6	901.5	923.3	1018.3	1154.2	1211.2	1287.2	1404.0	1461.0	1507.2
10°	738.6	790.2	945.0	996.6	1151.5	1357.8	1463.7	1569.6	1746.1	1824.9	1854.8
12.5°	681.6	765.8	991.2	1061.8	1284.5	1585.9	1713.6	1830.3	2031.3	2137.2	2153.5
15°	616.4	730.5	1034.7	1137.9	1425.7	1776.0	1917.2	2061.1	2248.5	2324.5	2343.6
17.5°	559.4	703.3	1075.4	1184.0	1534.3	1947.1	2091.0	2210.5	2362.6	2414.2	2427.7
20°	488.8	659.9	1102.6	1243.8	1648.4	2072.0	2210.5	2302.8	2406.0	2438.6	2444.0
22.5°	437.2	613.7	1118.9	1265.5	1724.4	2148.0	2264.8	2338.1	2408.7	2419.6	2422.3
25°	393.7	562.1	1116.2	1289.9	1789.6	2194.2	2283.8	2338.1	2378.9	2384.3	2384.3
27.5°	353.0	505.1	1105.3	1295.4	1838.5	2205.1	2275.7	2313.7	2332.7	2343.6	2343.6
30°	317.7	450.8	1078.1	1284.5	1860.2	2194.2	2251.2	2270.2	2289.2	2305.5	2313.7
32.5°	290.6	399.2	1037.4	1262.8	1862.9	2167.0	2207.8	2218.6	2245.8	2283.8	2297.4
35°	266.1	347.6	991.2	1232.9	1846.6	2123.6	2150.8	2161.6	2215.9	2272.9	2292.0
37.5°	241.7	309.6	931.4	1181.3	1822.2	2072.0	2091.0	2110.0	2194.2	2262.1	2283.8
40°	217.2	277.0	860.8	1124.3	1784.2	2009.5	2025.8	2055.7	2167.0	2245.8	2267.5
42.5°	198.2	249.8	784.8	1064.6	1735.3	1938.9	1963.4	2006.8	2134.5	2218.6	2243.1
45°	181.9	222.7	703.3	983.0	1672.8	1865.6	1900.9	1960.7	2096.4	2177.9	2199.6
47.5°	165.6	203.7	619.1	898.8	1604.9	1792.3	1838.5	1906.4	2044.8	2123.6	2142.6
50°	152.1	184.7	535.0	809.2	1531.6	1713.6	1767.9	1838.5	1979.7	2053.0	2077.4
52.5°	141.2	168.4	456.2	719.6	1447.4	1632.1	1694.6	1767.9	1900.9	1971.5	1987.8
55°	130.3	154.8	388.3	624.6	1360.5	1545.2	1613.1	1683.7	1814.0	1873.8	1884.6
57.5°	124.9	143.9	331.3	535.0	1268.2	1447.4	1523.5	1588.6	1710.8	1757.0	1767.9
60°	116.8	135.8	287.8	458.9	1167.7	1355.1	1420.3	1485.5	1588.6	1626.7	1634.8
62.5°	108.6	130.3	255.3	385.6	1064.6	1246.5	1311.7	1371.4	1458.3	1485.5	1496.3
65°	103.2	124.9	230.8	331.3	958.6	1132.4	1197.6	1249.2	1319.8	1347.0	1352.4
67.5°	97.8	119.5	211.8	285.1	852.7	1018.3	1067.3	1116.2	1170.5	1197.6	1200.3
70°	89.6	114.1	195.5	252.5	744.0	888.0	928.7	980.3	1023.7	1037.4	1045.6
72.5°	84.2	105.9	184.7	228.1	632.7	763.1	801.1	830.9	869.0	882.5	882.5
75°	76.0	95.0	173.8	203.7	518.7	624.6	657.1	687.0	716.9	722.3	714.2
77.5°	67.9	84.2	149.4	171.1	404.6	494.2	521.4	537.7	562.1	567.5	570.3
80°	57.0	73.3	116.8	133.1	293.3	363.9	382.9	396.5	418.2	418.2	423.6
82.5°	43.4	57.0	84.2	95.0	198.2	249.8	266.1	274.3	287.8	287.8	287.8
85°	27.2	35.3	54.3	62.5	119.5	152.1	162.9	165.6	176.5	179.2	179.2
87.5°	13.6	19.0	35.3	38.0	62.5	78.7	78.7	84.2	84.2	81.5	78.7
90°	5.6	10.0	14.6	15.7	24.6	36.6	42.5	37.8	28.3	21.3	21.3
92.5°	22.4	60.4	98.5	108.0	151.8	210.3	239.5	209.9	150.7	106.4	102.1
95°	53.8	123.4	193.1	210.4	373.7	591.3	700.1	624.7	474.0	361.0	348.1
97.5°	92.9	154.3	215.8	231.2	503.4	866.2	1047.7	1000.1	904.8	833.4	809.0
100°	123.1	178.9	234.5	248.5	550.5	953.2	1154.6	1158.1	1165.0	1170.3	1141.2
102.5°	148.9	200.9	252.8	265.8	572.2	980.7	1184.9	1245.5	1366.9	1457.9	1433.1
105°	192.5	236.5	280.5	291.6	588.2	983.7	1181.5	1317.6	1589.6	1793.8	1780.4
107.5°	237.3	278.3	319.4	329.7	591.3	940.0	1114.3	1304.2	1683.8	1968.5	1971.7
110°	267.6	304.6	341.7	350.9	586.7	901.2	1058.4	1270.6	1694.9	2013.2	2027.1



TEST NUMBER: P936755

CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

CANDELA DISTRIBUTION (continued):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
112.5°	297.2	332.5	367.8	376.6	586.9	867.2	1007.4	1224.6	1658.9	1984.7	2006.0
115°	342.0	374.6	407.1	415.3	592.3	828.4	946.4	1155.6	1574.0	1887.8	1917.5
117.5°	386.1	415.7	445.3	452.8	603.3	804.1	904.4	1093.3	1470.8	1754.0	1786.9
120°	411.9	439.8	467.6	474.6	612.3	795.9	887.7	1060.2	1405.2	1664.0	1695.9
122.5°	437.1	465.3	493.3	500.4	625.2	791.6	874.7	1030.1	1340.8	1573.8	1605.3
125°	475.8	501.4	527.0	533.4	642.6	788.0	860.8	992.8	1256.6	1454.6	1483.6
127.5°	507.1	533.0	558.8	565.3	659.9	786.0	849.0	962.4	1188.9	1358.9	1383.4
130°	523.9	551.8	579.6	586.5	672.5	787.2	844.6	945.4	1147.2	1298.5	1321.1
132.5°	541.2	569.1	597.0	603.9	682.9	788.0	840.6	931.0	1111.5	1246.9	1267.2
135°	567.0	592.3	617.7	624.0	694.0	787.3	833.9	909.6	1060.8	1174.3	1191.7
137.5°	593.2	618.4	643.6	649.8	710.8	792.2	832.8	896.7	1024.6	1120.5	1134.8
140°	615.1	638.2	661.3	667.1	721.1	792.9	828.9	884.1	994.6	1077.4	1090.8
142.5°	631.9	653.3	674.7	680.0	729.7	795.8	828.9	877.4	974.4	1047.2	1058.7
145°	657.6	676.2	694.9	699.6	740.9	795.8	823.3	863.0	942.4	1001.8	1010.5
147.5°	683.4	701.5	719.7	724.2	757.3	801.3	823.3	854.6	917.0	963.8	971.1
150°	700.1	716.5	733.0	737.1	765.9	804.1	823.3	849.7	902.4	941.9	947.8
152.5°	717.5	729.9	742.4	745.5	771.5	806.0	823.3	845.9	890.9	924.6	929.1
155°	743.2	752.5	761.7	764.0	783.8	810.1	823.3	841.3	877.0	903.9	906.8
157.5°	762.3	771.3	780.2	782.4	796.1	814.3	823.3	837.3	865.1	886.0	888.1
160°	775.2	782.1	789.1	790.8	801.7	816.1	823.3	835.3	859.1	877.0	878.2
162.5°	788.0	793.3	798.5	799.8	807.7	818.1	823.3	833.4	853.5	868.6	869.7
165°	802.1	806.8	811.5	812.7	816.2	821.0	823.3	830.6	845.0	855.7	856.9
167.5°	814.9	817.1	819.4	819.9	822.9	826.9	828.9	833.6	843.1	850.1	850.7
170°	823.3	825.5	827.8	828.3	828.5	828.8	828.9	833.6	843.1	850.1	850.1
172.5°	827.8	828.2	828.8	828.9	828.9	828.9	828.9	832.6	840.1	845.7	845.2
175°	833.9	833.9	833.9	833.9	832.2	829.9	828.9	831.2	836.0	839.5	839.5
177.5°	833.9	833.9	833.9	833.9	832.7	830.9	830.0	831.9	835.6	838.5	837.9
180°	833.9	833.9	833.9	833.9	833.9	833.9	833.9	833.9	833.9	833.9	833.9



TEST NUMBER: P936755
CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

CANDELA DISTRIBUTION (continued):

	80°	90°
0°	844.5	844.5
2.5°	901.5	896.1
5°	1159.6	1165.0
7.5°	1561.5	1558.8
10°	1941.7	1966.1
12.5°	2218.6	2224.1
15°	2387.0	2397.9
17.5°	2452.2	2454.9
20°	2454.9	2449.5
22.5°	2425.0	2419.6
25°	2389.7	2387.0
27.5°	2357.1	2359.8
30°	2343.6	2351.7
32.5°	2343.6	2357.1
35°	2349.0	2362.6
37.5°	2346.3	2362.6
40°	2335.4	2354.4
42.5°	2305.5	2319.1
45°	2259.4	2275.7
47.5°	2199.6	2210.5
50°	2123.6	2134.5
52.5°	2028.6	2031.3
55°	1914.5	1925.4
57.5°	1792.3	1795.0
60°	1656.5	1664.7
62.5°	1512.6	1512.6
65°	1360.5	1366.0
67.5°	1203.0	1216.6
70°	1042.8	1045.6
72.5°	885.2	885.2
75°	722.3	725.0
77.5°	567.5	567.5
80°	420.9	423.6
82.5°	290.6	296.0
85°	181.9	181.9
87.5°	84.2	76.0
90°	21.3	21.3
92.5°	85.2	68.2
95°	296.9	245.7
97.5°	711.5	614.0
100°	1025.1	909.0
102.5°	1333.6	1234.1
105°	1727.0	1673.5
107.5°	1984.6	1997.5
110°	2082.8	2138.5



TEST NUMBER: P936755

CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

CANDELA DISTRIBUTION (continued):

	80°	90°
112.5°	2091.6	2177.2
115°	2036.2	2154.8
117.5°	1918.5	2050.1
120°	1823.8	1951.6
122.5°	1731.5	1857.6
125°	1599.8	1716.0
127.5°	1481.4	1579.4
130°	1411.7	1502.2
132.5°	1348.3	1429.4
135°	1261.6	1331.5
137.5°	1192.0	1249.2
140°	1144.2	1197.7
142.5°	1104.7	1150.7
145°	1045.4	1080.2
147.5°	999.8	1028.7
150°	971.1	994.6
152.5°	946.7	964.4
155°	918.6	930.2
157.5°	896.2	904.4
160°	883.0	887.7
162.5°	874.2	878.7
165°	861.7	866.4
167.5°	852.7	854.7
170°	850.1	850.1
172.5°	843.5	841.8
175°	839.5	839.5
177.5°	835.9	833.9
180°	833.9	833.9



TEST NUMBER: P936755
 CATALOG NUMBER: SQ4-FB-050U-075D-93050-1D-UNV-STD-W-12-4000K

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	4.77	5.72	5.67	6.65	7.85	17.96	18.91	18.87	19.84	21.04
	3H	5.48	6.33	6.40	7.27	8.50	19.81	20.66	20.73	21.61	22.83
	4H	5.78	6.59	6.71	7.54	8.77	20.46	21.27	21.40	22.22	23.45
	6H	6.04	6.78	6.98	7.73	8.98	20.90	21.65	21.85	22.60	23.85
	8H	6.11	6.82	7.06	7.79	9.03	21.03	21.74	21.98	22.71	23.95
	12H	6.13	6.80	7.09	7.77	9.04	21.10	21.78	22.06	22.74	24.01
4H	2H	12.00	12.81	12.94	13.76	14.99	18.24	19.05	19.18	20.00	21.23
	3H	13.58	14.25	14.53	15.23	16.48	20.30	20.98	21.25	21.96	23.20
	4H	13.67	14.29	14.63	15.26	16.53	21.08	21.70	22.04	22.67	23.94
	6H	13.69	14.23	14.66	15.22	16.49	21.63	22.16	22.60	23.16	24.42
	8H	13.67	14.17	14.64	15.16	16.44	21.79	22.29	22.77	23.28	24.57
	12H	13.63	14.08	14.62	15.09	16.38	21.89	22.35	22.89	23.35	24.64
8H	4H	15.13	15.63	16.11	16.62	17.90	21.14	21.64	22.12	22.63	23.92
	6H	15.38	15.79	16.38	16.82	18.10	21.78	22.20	22.78	23.23	24.51
	8H	15.40	15.76	16.40	16.78	18.08	22.01	22.37	23.02	23.39	24.69
	12H	15.37	15.69	16.38	16.70	18.05	22.16	22.48	23.17	23.49	24.84
12H	4H	15.28	15.73	16.27	16.74	18.03	21.10	21.55	22.10	22.56	23.85
	6H	15.64	16.01	16.65	17.02	18.32	21.77	22.13	22.78	23.15	24.45
	8H	15.71	16.03	16.73	17.05	18.39	22.00	22.33	23.02	23.34	24.68