

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P936397

Luminaire Tested: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

Issue Date: 12/17/2024

Test Information

Test Method: LM-79-2019
Report Number: P936397
REPORT IS A COMBINATION OF REPORTS P933430 AND P933786
Test Lab: INNOVATION CENTER
Issue Date: 12/17/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12
Description: CORELITE SQ4 SUSPENDED INDIRECT LED LUMINAIRE WITH Batwing Frosted Continuous Roll L
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9808.2 lumens
Efficiency: N/A
Efficacy: 109.0 lumens/watt
Spacing Criteria (0/90/45): 0.71 / 2.69 / 2.33
Luminous Opening: Rectangular w/ Sides (W: 0.29' x L: 12' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 90
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P936397
CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

Luminous Intensity Polar Plot

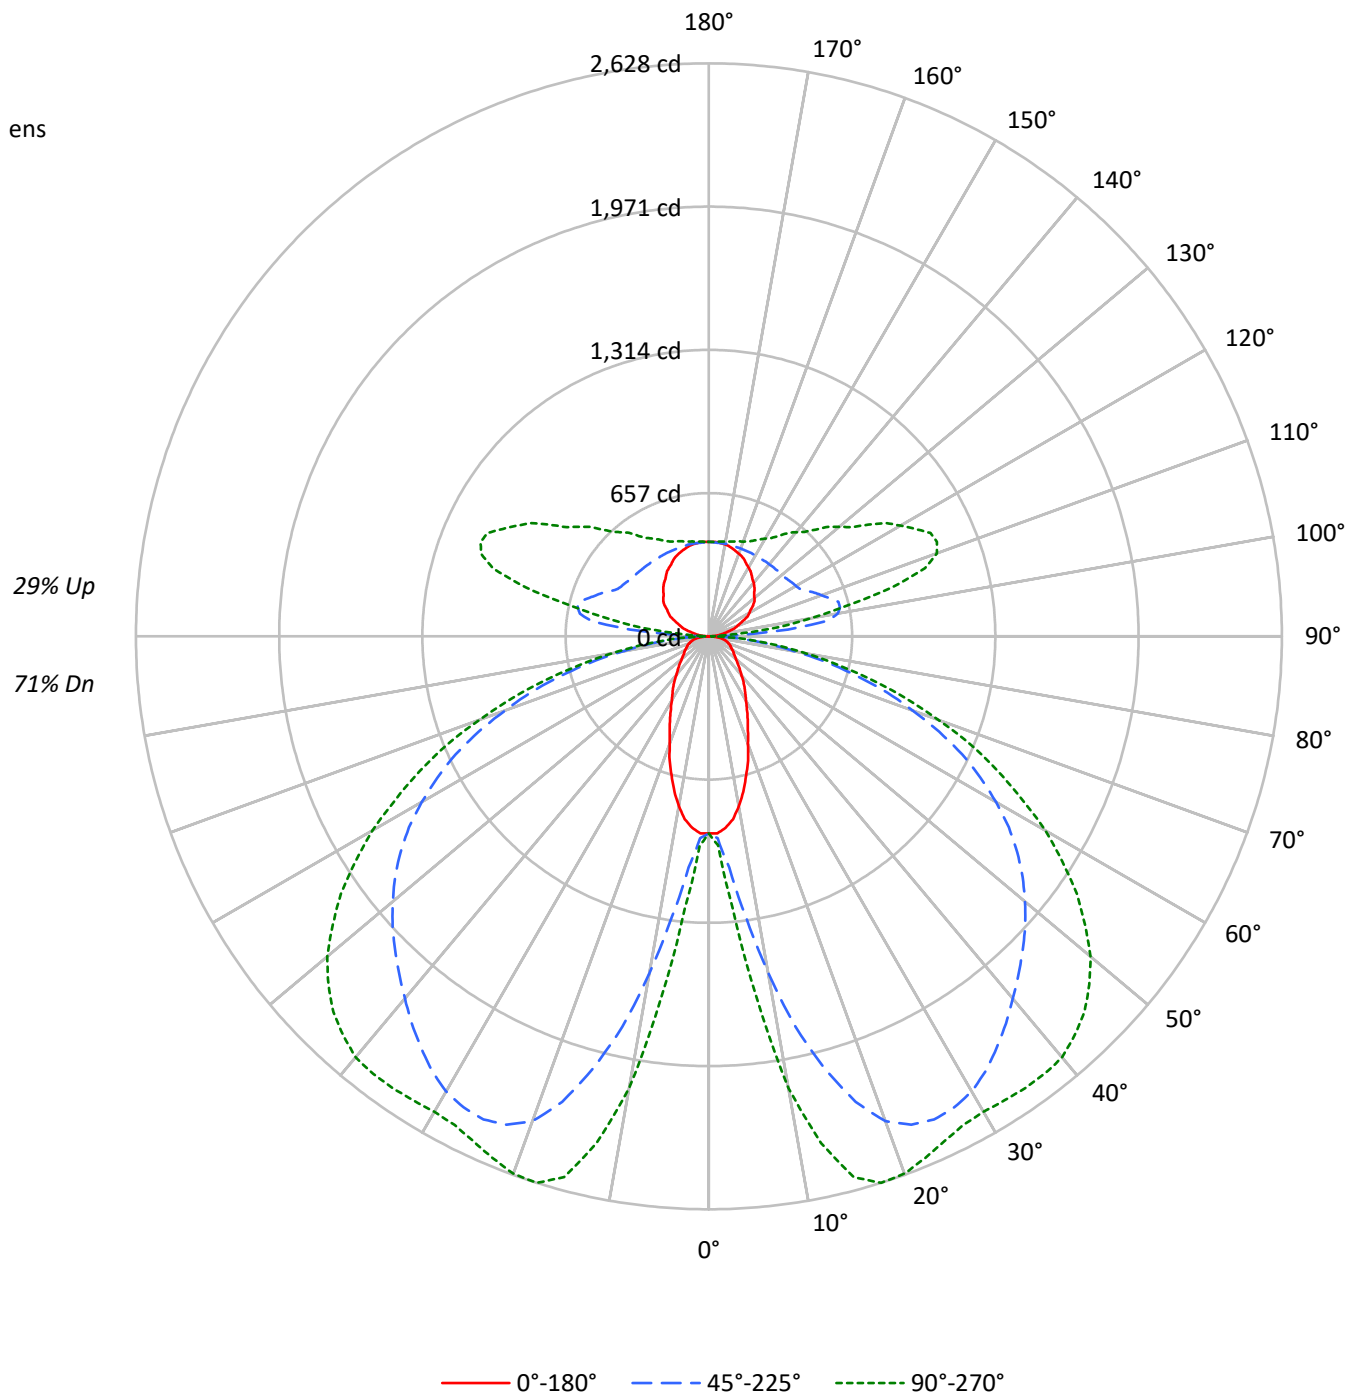



TEST NUMBER: P936397

CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	112	112	112	112	106	106	106	106	95	95	95	85	85	85	76	76	76	71
1	102	97	93	89	96	92	88	85	82	79	77	74	71	69	66	64	62	58
2	92	84	77	71	87	79	73	68	71	66	62	64	60	57	57	54	51	48
3	83	73	65	58	79	69	62	56	62	56	51	56	51	47	50	46	43	39
4	76	64	55	49	71	61	53	47	55	48	43	49	44	39	44	40	36	33
5	69	57	48	41	65	54	46	40	49	42	37	44	38	34	39	34	31	28
6	64	51	42	35	60	48	40	34	43	37	32	39	33	29	35	30	27	24
7	59	45	37	31	55	43	35	30	39	32	27	35	30	25	32	27	23	21
8	54	41	33	27	51	39	31	26	36	29	24	32	26	22	29	24	21	18
9	51	37	29	24	48	36	28	23	32	26	21	29	24	20	26	22	18	16
10	47	34	26	21	45	33	25	21	30	23	19	27	22	18	24	20	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2796	2796	2796
5°	2733	3233	3759
10°	2480	4714	6232
15°	2108	6160	7525
20°	1717	7140	7669
25°	1433	7474	7513
30°	1209	7523	7499
35°	1070	7400	7693
40°	933	7240	7893
45°	845	7123	7924
50°	776	7018	7793
55°	743	6864	7448
60°	762	6566	6902
65°	795	6111	6153
70°	848	5332	5198
75°	943	4352	4056
80°	1038	3022	2733
85°	943	1606	1399

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 45°
 Luminance: 7924 cd/sqm



TEST NUMBER: P936397

CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	117.0	1.2
10°-20°	518.3	5.3
20°-30°	906.6	9.2
30°-40°	1167.1	11.9
40°-50°	1303.6	13.3
50°-60°	1248.6	12.7
60°-70°	989.5	10.1
70°-80°	581.8	5.9
80°-90°	163.3	1.7
90°-100°	211.5	2.2
100°-110°	556.0	5.7
110°-120°	576.5	5.9
120°-130°	462.4	4.7
130°-140°	362.8	3.7
140°-150°	278.5	2.8
150°-160°	200.6	2.0
160°-170°	122.7	1.3
170°-180°	41.5	0.4
0°-30°	1541.9	15.7
0°-40°	2709.0	27.6
0°-60°	5261.2	53.6
0°-90°	6995.9	71.3
90°-120°	1343.9	13.7
90°-150°	2447.6	25.0
90°-180°	2812.0	28.7
0°-180°	9808.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	904	904	904	904	904	
5°	881	945	1064	1204	1247	81
15°	660	1218	2052	2488	2567	184
25°	422	1381	2445	2552	2555	194
35°	285	1320	2302	2433	2529	178
45°	195	1052	2035	2332	2436	151
55°	140	669	1727	2006	2061	127
65°	110	355	1282	1442	1462	110
75°	81	218	704	773	776	85
85°	29	67	174	192	195	31
90°	3	8	22	11	11	4
95°	28	110	364	188	128	31
105°	100	152	615	933	870	106
115°	178	216	492	982	1121	176
125°	248	278	448	757	893	220
135°	295	325	434	611	693	228
145°	342	364	428	521	562	214
155°	387	397	428	470	484	178
165°	417	423	428	445	451	118
175°	434	434	431	437	437	41
180°	434	434	434	434	434	



TEST NUMBER: P936397

CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (FULL):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
0°	904.1	904.1	904.1	904.1	904.1	904.1	904.1	904.1	904.1	904.1	904.1
2.5°	904.1	904.1	909.9	912.8	918.6	921.5	927.3	933.1	950.6	953.5	959.3
5°	880.8	892.4	930.2	944.8	985.5	1040.7	1064.0	1101.8	1180.3	1203.6	1218.1
7.5°	845.9	872.1	965.1	988.4	1090.1	1235.6	1296.6	1378.0	1503.0	1564.1	1613.5
10°	790.7	845.9	1011.6	1066.9	1232.7	1453.6	1567.0	1680.3	1869.3	1953.6	1985.6
12.5°	729.7	819.8	1061.1	1136.7	1375.1	1697.8	1834.4	1959.4	2174.5	2287.9	2305.3
15°	659.9	782.0	1107.7	1218.1	1526.3	1901.3	2052.4	2206.5	2407.1	2488.5	2508.8
17.5°	598.8	752.9	1151.3	1267.5	1642.6	2084.4	2238.5	2366.4	2529.2	2584.4	2599.0
20°	523.3	706.4	1180.3	1331.5	1764.6	2218.1	2366.4	2465.2	2575.7	2610.6	2616.4
22.5°	468.0	657.0	1197.8	1354.8	1846.0	2299.5	2424.5	2503.0	2578.6	2590.2	2593.1
25°	421.5	601.7	1194.9	1380.9	1915.8	2349.0	2444.9	2503.0	2546.6	2552.4	2552.4
27.5°	377.9	540.7	1183.2	1386.7	1968.1	2360.6	2436.2	2476.9	2497.2	2508.8	2508.8
30°	340.1	482.6	1154.2	1375.1	1991.4	2349.0	2410.0	2430.3	2450.7	2468.1	2476.9
32.5°	311.0	427.3	1110.6	1351.9	1994.3	2319.9	2363.5	2375.1	2404.2	2444.9	2459.4
35°	284.9	372.1	1061.1	1319.9	1976.9	2273.4	2302.4	2314.1	2372.2	2433.3	2453.6
37.5°	258.7	331.4	997.1	1264.6	1950.7	2218.1	2238.5	2258.8	2349.0	2421.6	2444.9
40°	232.6	296.5	921.5	1203.6	1910.0	2151.3	2168.7	2200.7	2319.9	2404.2	2427.4
42.5°	212.2	267.4	840.1	1139.6	1857.7	2075.7	2101.9	2148.4	2285.0	2375.1	2401.3
45°	194.8	238.4	752.9	1052.3	1790.8	1997.2	2035.0	2099.0	2244.3	2331.5	2354.8
47.5°	177.3	218.0	662.8	962.2	1718.1	1918.7	1968.1	2040.8	2189.1	2273.4	2293.7
50°	162.8	197.7	572.7	866.3	1639.6	1834.4	1892.6	1968.1	2119.3	2197.8	2224.0
52.5°	151.2	180.2	488.4	770.4	1549.5	1747.2	1814.1	1892.6	2035.0	2110.6	2128.0
55°	139.5	165.7	415.7	668.6	1456.5	1654.2	1726.9	1802.4	1942.0	2005.9	2017.6
57.5°	133.7	154.1	354.7	572.7	1357.7	1549.5	1630.9	1700.7	1831.5	1880.9	1892.6
60°	125.0	145.4	308.1	491.3	1250.1	1450.7	1520.5	1590.2	1700.7	1741.4	1750.1
62.5°	116.3	139.5	273.3	412.8	1139.6	1334.4	1404.2	1468.1	1561.2	1590.2	1601.9
65°	110.5	133.7	247.1	354.7	1026.2	1212.3	1282.1	1337.3	1412.9	1442.0	1447.8
67.5°	104.7	127.9	226.7	305.2	912.8	1090.1	1142.5	1194.9	1253.0	1282.1	1285.0
70°	95.9	122.1	209.3	270.4	796.5	950.6	994.2	1049.4	1095.9	1110.6	1119.3
72.5°	90.1	113.4	197.7	244.2	677.3	816.9	857.6	889.5	930.2	944.8	944.8
75°	81.4	101.7	186.0	218.0	555.2	668.6	703.5	735.5	767.4	773.3	764.5
77.5°	72.7	90.1	159.9	183.1	433.1	529.1	558.1	575.6	601.7	607.6	610.5
80°	61.0	78.5	125.0	142.4	314.0	389.5	409.9	424.4	447.7	447.7	453.5
82.5°	46.5	61.0	90.1	101.7	212.2	267.4	284.9	293.6	308.1	308.1	308.1
85°	29.1	37.8	58.1	66.9	127.9	162.8	174.4	177.3	189.0	191.9	191.9
87.5°	14.5	20.3	37.8	40.7	66.9	84.3	84.3	90.1	90.1	87.2	84.3
90°	2.9	5.2	7.6	8.1	12.8	19.0	22.1	19.7	14.7	11.0	11.0
92.5°	11.6	31.4	51.3	56.2	79.0	109.4	124.6	109.2	78.4	55.3	53.1
95°	27.9	64.1	100.4	109.5	194.4	307.7	364.2	325.0	246.6	187.8	181.1
97.5°	48.4	80.3	112.3	120.3	261.8	450.7	545.1	520.3	470.7	433.5	420.8
100°	64.1	93.0	122.0	129.3	286.4	495.9	600.7	602.5	606.1	608.8	593.7
102.5°	77.4	104.5	131.5	138.3	297.7	510.2	616.4	648.0	711.1	758.4	745.5
105°	100.2	123.1	145.9	151.6	306.0	511.7	614.6	685.4	826.9	933.1	926.2
107.5°	123.5	144.8	166.2	171.5	307.6	489.0	579.7	678.4	875.9	1024.0	1025.7
110°	139.1	158.4	177.7	182.6	305.2	468.8	550.6	661.0	881.7	1047.3	1054.6



TEST NUMBER: P936397

CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (continued):

	0°	10°	20°	22.5°	30°	40°	45°	50°	60°	67.5°	70°
112.5°	154.7	173.0	191.4	195.9	305.3	451.2	524.1	637.1	863.0	1032.5	1043.6
115°	177.9	194.9	211.8	216.1	308.1	430.9	492.3	601.2	818.8	982.1	997.5
117.5°	200.9	216.3	231.7	235.6	313.9	418.3	470.5	568.8	765.2	912.5	929.7
120°	214.2	228.8	243.3	246.9	318.5	414.0	461.7	551.5	731.0	865.6	882.3
122.5°	227.4	242.1	256.6	260.3	325.2	411.7	455.0	535.9	697.5	818.7	835.1
125°	247.5	260.9	274.2	277.5	334.3	410.0	447.8	516.4	653.7	756.7	771.8
127.5°	263.8	277.2	290.7	294.1	343.3	408.9	441.7	500.6	618.5	706.9	719.7
130°	272.5	287.0	301.6	305.1	349.9	409.5	439.3	491.9	596.8	675.5	687.3
132.5°	281.6	296.0	310.6	314.1	355.2	410.0	437.3	484.3	578.3	648.7	659.3
135°	295.0	308.1	321.3	324.6	361.0	409.6	433.8	473.2	551.8	610.9	620.0
137.5°	308.6	321.7	334.7	338.0	369.8	412.1	433.2	466.5	532.9	582.9	590.3
140°	320.0	332.0	344.1	347.1	375.1	412.5	431.2	459.9	517.3	560.5	567.4
142.5°	328.7	339.8	351.0	353.8	379.6	414.0	431.2	456.4	506.9	544.8	550.8
145°	342.2	351.8	361.5	364.0	385.4	414.0	428.3	448.9	490.2	521.1	525.7
147.5°	355.5	364.9	374.4	376.7	393.9	416.9	428.3	444.6	477.0	501.4	505.1
150°	364.2	372.8	381.3	383.4	398.4	418.3	428.3	442.1	469.5	490.0	493.0
152.5°	373.3	379.8	386.1	387.8	401.3	419.3	428.3	440.0	463.5	481.0	483.3
155°	386.6	391.4	396.2	397.4	407.7	421.4	428.3	437.6	456.3	470.3	471.8
157.5°	396.5	401.2	405.9	407.1	414.2	423.5	428.3	435.6	450.0	460.9	461.9
160°	403.3	406.9	410.6	411.4	417.1	424.5	428.3	434.5	446.9	456.2	456.8
162.5°	410.0	412.7	415.4	416.1	420.2	425.6	428.3	433.5	444.0	451.8	452.4
165°	417.3	419.7	422.2	422.8	424.6	427.0	428.3	432.1	439.5	445.2	445.7
167.5°	423.9	425.1	426.3	426.6	428.1	430.1	431.2	433.6	438.6	442.3	442.5
170°	428.3	429.5	430.6	430.9	431.0	431.1	431.2	433.6	438.6	442.3	442.3
172.5°	430.6	430.9	431.1	431.2	431.2	431.2	431.2	433.1	437.0	439.9	439.7
175°	433.8	433.8	433.8	433.8	432.9	431.8	431.2	432.5	434.9	436.7	436.7
177.5°	433.8	433.8	433.8	433.8	433.1	432.3	431.8	432.8	434.7	436.1	435.9
180°	433.8	433.8	433.8	433.8	433.8	433.8	433.8	433.8	433.8	433.8	433.8



TEST NUMBER: P936397

CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (continued):

	80°	90°
0°	904.1	904.1
2.5°	965.1	959.3
5°	1241.4	1247.2
7.5°	1671.6	1668.7
10°	2078.6	2104.8
12.5°	2375.1	2380.9
15°	2555.3	2567.0
17.5°	2625.1	2628.0
20°	2628.0	2622.2
22.5°	2596.0	2590.2
25°	2558.3	2555.3
27.5°	2523.4	2526.3
30°	2508.8	2517.6
32.5°	2508.8	2523.4
35°	2514.7	2529.2
37.5°	2511.7	2529.2
40°	2500.1	2520.5
42.5°	2468.1	2482.7
45°	2418.7	2436.2
47.5°	2354.8	2366.4
50°	2273.4	2285.0
52.5°	2171.6	2174.5
55°	2049.5	2061.2
57.5°	1918.7	1921.6
60°	1773.4	1782.1
62.5°	1619.3	1619.3
65°	1456.5	1462.3
67.5°	1287.9	1302.4
70°	1116.4	1119.3
72.5°	947.7	947.7
75°	773.3	776.2
77.5°	607.6	607.6
80°	450.6	453.5
82.5°	311.0	316.9
85°	194.8	194.8
87.5°	90.1	81.4
90°	11.0	11.0
92.5°	44.4	35.6
95°	154.5	127.8
97.5°	370.2	319.4
100°	533.3	472.9
102.5°	693.7	642.0
105°	898.4	870.5
107.5°	1032.5	1039.2
110°	1083.5	1112.5



TEST NUMBER: P936397

CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

CANDELA DISTRIBUTION (continued):

	80°	90°
112.5°	1088.1	1132.6
115°	1059.2	1120.9
117.5°	998.1	1066.5
120°	948.7	1015.2
122.5°	900.8	966.4
125°	832.2	892.6
127.5°	770.6	821.6
130°	734.4	781.5
132.5°	701.5	743.6
135°	656.3	692.6
137.5°	620.1	649.9
140°	595.3	623.1
142.5°	574.7	598.6
145°	543.8	561.9
147.5°	520.2	535.2
150°	505.2	517.3
152.5°	492.4	501.7
155°	477.8	483.9
157.5°	466.3	470.5
160°	459.3	461.7
162.5°	454.8	457.1
165°	448.3	450.7
167.5°	443.5	444.6
170°	442.3	442.3
172.5°	438.8	437.9
175°	436.7	436.7
177.5°	434.9	433.8
180°	433.8	433.8



TEST NUMBER: P936397
 CATALOG NUMBER: SQ4-FB-025U-075D-B35-1D-UNV-STD-W-12

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.32	7.48	7.06	8.25	9.17	19.52	20.67	20.26	21.44	22.37
	3H	7.05	8.09	7.80	8.87	9.83	21.38	22.42	22.14	23.20	24.16
	4H	7.36	8.35	8.13	9.13	10.10	22.04	23.03	22.82	23.82	24.78
	6H	7.63	8.54	8.41	9.33	10.32	22.49	23.40	23.28	24.20	25.18
	8H	7.70	8.57	8.50	9.39	10.37	22.63	23.49	23.42	24.31	25.30
	12H	7.73	8.56	8.53	9.37	10.38	22.71	23.54	23.51	24.35	25.36
4H	2H	13.58	14.57	14.36	15.35	16.32	19.82	20.81	20.60	21.60	22.56
	3H	15.17	16.00	15.96	16.82	17.81	21.90	22.73	22.69	23.55	24.54
	4H	15.28	16.04	16.09	16.86	17.87	22.68	23.44	23.49	24.26	25.27
	6H	15.31	15.96	16.13	16.81	17.83	23.25	23.90	24.07	24.75	25.76
	8H	15.29	15.91	16.12	16.75	17.78	23.42	24.03	24.24	24.87	25.90
	12H	15.27	15.82	16.11	16.68	17.72	23.53	24.08	24.37	24.94	25.98
8H	4H	16.76	17.37	17.58	18.21	19.24	22.77	23.38	23.59	24.22	25.26
	6H	17.01	17.52	17.86	18.40	19.44	23.42	23.93	24.27	24.81	25.84
	8H	17.03	17.49	17.90	18.37	19.41	23.64	24.10	24.51	24.98	26.02
	12H	17.02	17.42	17.88	18.29	19.39	23.81	24.21	24.67	25.08	26.18
12H	4H	16.91	17.47	17.76	18.33	19.37	22.74	23.29	23.58	24.15	25.19
	6H	17.27	17.73	18.14	18.61	19.66	23.40	23.86	24.27	24.74	25.79
	8H	17.36	17.76	18.23	18.63	19.73	23.65	24.05	24.52	24.92	26.02