

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P621421

Luminaire Tested: VLT-F-025U-100D-830-UNV-STD-W-4

Issue Date: 9/2/2020

Test Information

Test Method: LM-79-2019
Report Number: P621421
REPORT IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2203-563-26, G2-2203-563-1)
Test Lab: INNOVATION CENTER
Issue Date: 9/2/2020
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: VLT-F-025U-100D-830-UNV-STD-W-4
Description: CORELITE VAULT SUSPENDED LED LUMINAIRE
FROSTED LENS
DOWNLIGHT 1000 LUMENS PER FOOT
UPLIGHT 250 LUMENS PER FOOT
Light Source: 3000K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5022.0 lumens
Efficiency: N/A
Efficacy: 133.9 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.12 / 1.23
Luminous Opening: Rectangular (W 0.38' x L: 4' x H: 0')
CIE Type: Semi-Direct

Input Watts (W): 37.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P621421
CATALOG NUMBER: VLT-F-025U-100D-830-UNV-STD-W-4

Luminous Intensity Polar Plot

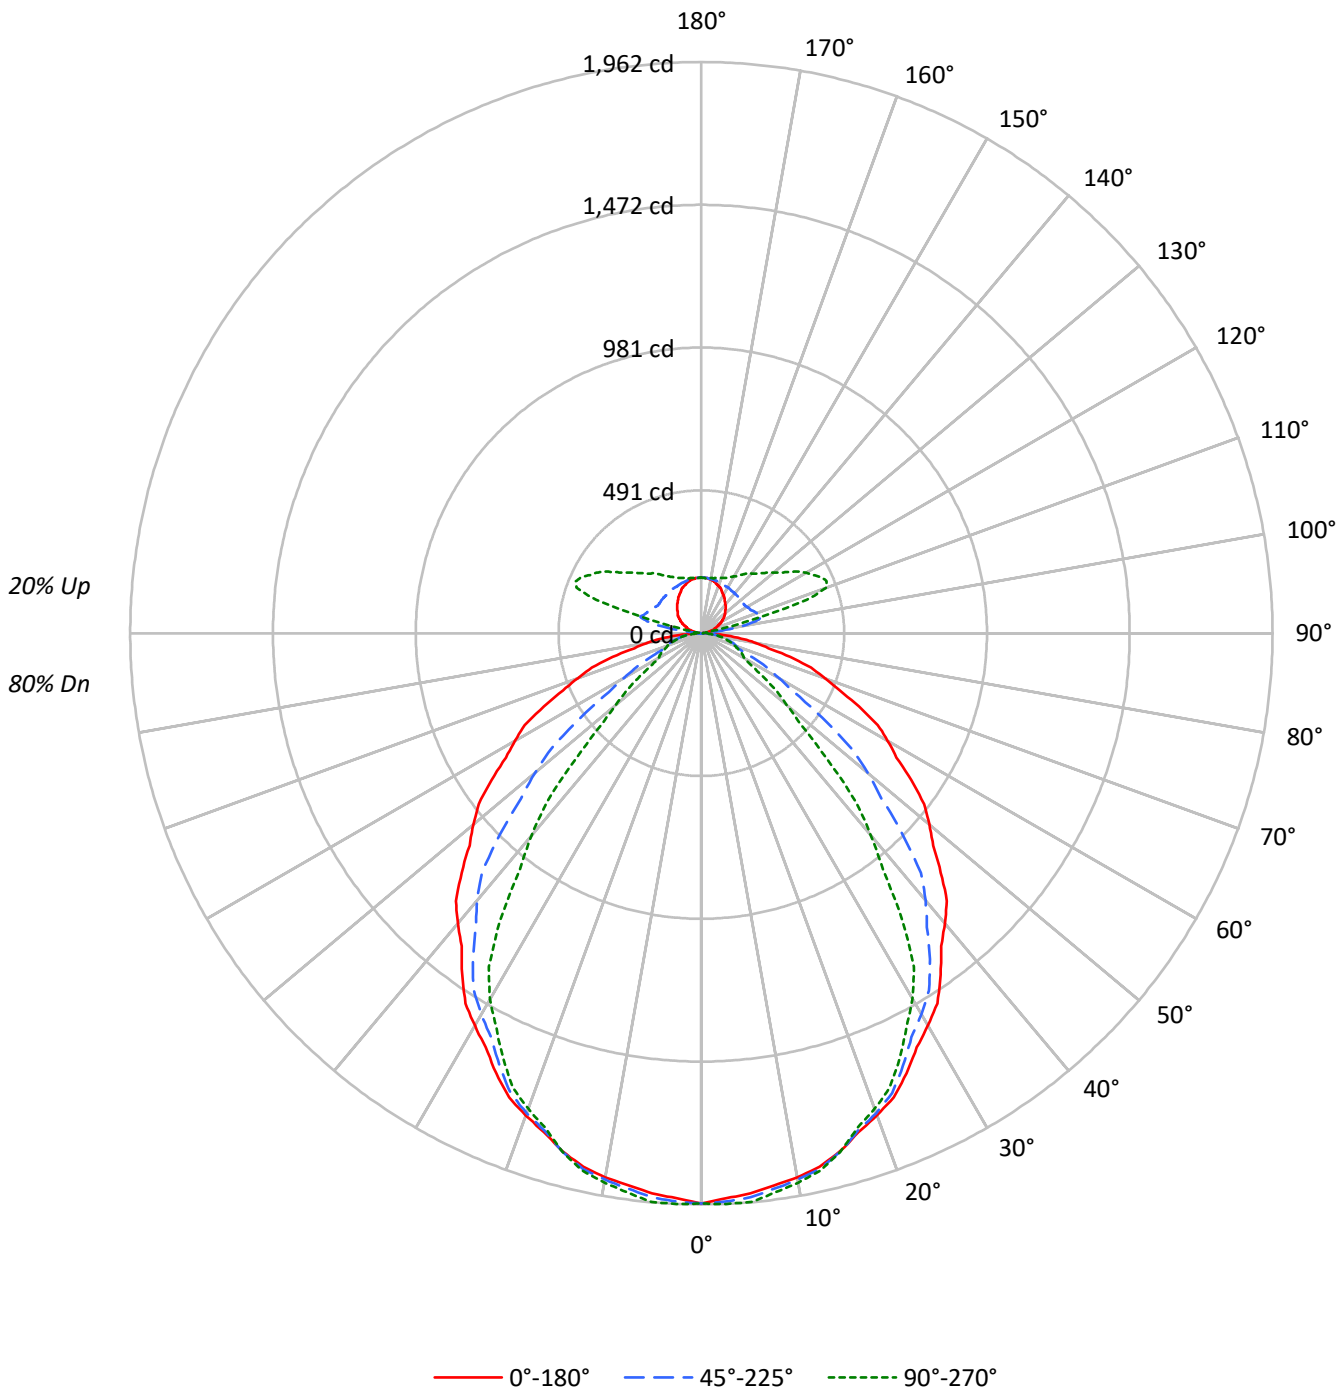



TEST NUMBER: P621421

CATALOG NUMBER: VLT-F-025U-100D-830-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	114	114	114	114	109	109	109	109	100	100	100	91	91	91	83	83	83	80				
1	106	101	98	94	101	97	94	91	89	87	84	82	80	78	75	74	73	69				
2	97	90	84	79	93	86	81	77	80	76	72	73	70	67	68	65	63	60				
3	89	80	73	67	85	77	71	66	71	66	62	66	62	58	61	58	55	52				
4	82	72	64	58	79	69	62	57	64	58	54	60	55	51	55	52	48	46				
5	76	65	57	51	73	63	55	50	58	52	47	54	49	45	50	46	43	40				
6	71	59	51	45	68	57	49	44	53	47	42	49	44	40	46	42	38	36				
7	66	54	46	40	63	52	44	39	49	42	38	45	40	36	43	38	34	32				
8	61	49	41	36	59	48	40	35	45	38	34	42	37	33	39	35	31	29				
9	57	45	38	33	55	44	37	32	41	35	31	39	33	30	36	32	28	27				
10	54	42	35	30	52	41	34	29	38	32	28	36	31	27	34	29	26	24				

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	14058	14058	14058
5°	13908	14010	14126
10°	13833	13892	13966
15°	13682	13697	13697
20°	13462	13400	13276
25°	13204	12980	12756
30°	12896	12527	12024
35°	12553	11985	10549
40°	12190	11223	8494
45°	11810	9940	6162
50°	11409	8315	4270
55°	11015	6331	3190
60°	10602	4386	2411
65°	10137	3128	2474
70°	9469	2633	2547
75°	8753	2692	2581
80°	7612	2843	2678
85°	6167	3170	2668

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11810 cd/sqm



TEST NUMBER: P621421

CATALOG NUMBER: VLT-F-025U-100D-830-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.6	3.7
10°-20°	519.1	10.3
20°-30°	755.1	15.0
30°-40°	835.4	16.6
40°-50°	717.2	14.3
50°-60°	496.6	9.9
60°-70°	295.9	5.9
70°-80°	145.8	2.9
80°-90°	45.5	0.9
90°-100°	23.5	0.5
100°-110°	167.4	3.3
110°-120°	227.3	4.5
120°-130°	185.0	3.7
130°-140°	148.8	3.0
140°-150°	117.3	2.3
150°-160°	85.8	1.7
160°-170°	53.3	1.1
170°-180°	18.2	0.4
0°-30°	1458.9	29.0
0°-40°	2294.3	45.7
0°-60°	3508.1	69.9
0°-90°	3995.3	79.6
90°-120°	418.3	8.3
90°-150°	869.5	17.3
90°-180°	1027.0	20.5
0°-180°	5022.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1959	1959	1959	1959	1959	
5°	1931	1960	1945	1943	1961	183
15°	1842	1866	1844	1834	1844	519
25°	1668	1680	1639	1611	1611	767
35°	1433	1429	1368	1258	1204	895
45°	1164	1144	980	708	607	898
55°	880	843	506	291	255	787
65°	597	480	184	148	146	591
75°	316	138	97	95	93	333
85°	75	37	38	34	32	87
90°	0	1	2	4	4	4
95°	10	18	10	11	13	11
105°	37	57	218	278	184	39
115°	66	80	188	390	456	66
125°	95	108	177	309	365	84
135°	118	131	178	254	292	91
145°	139	151	179	222	245	88
155°	164	169	183	201	210	75
165°	182	184	188	192	196	51
175°	191	192	191	190	189	18
180°	191	191	191	191	191	

TEST NUMBER: P621421

CATALOG NUMBER: VLT-F-025U-100D-830-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1959.1	1959.1	1959.1	1959.1	1959.1
2.5°	1942.9	1965.1	1954.2	1954.4	1962.3
5°	1930.8	1960.4	1944.9	1943.3	1961.1
7.5°	1913.0	1940.3	1924.3	1922.2	1937.6
10°	1898.4	1924.1	1906.5	1902.7	1916.6
12.5°	1877.3	1903.1	1883.8	1876.8	1890.7
15°	1841.7	1865.5	1843.7	1833.8	1843.7
17.5°	1796.8	1816.6	1791.9	1776.3	1782.2
20°	1762.8	1782.6	1754.7	1732.6	1738.5
22.5°	1725.5	1742.2	1711.0	1685.6	1689.9
25°	1667.7	1679.5	1639.3	1611.0	1611.0
27.5°	1603.3	1610.4	1563.6	1533.9	1525.6
30°	1556.3	1560.3	1511.8	1476.8	1451.1
32.5°	1507.8	1510.1	1455.2	1398.8	1358.8
35°	1432.9	1428.9	1368.1	1257.6	1204.2
37.5°	1353.2	1344.4	1272.6	1104.4	1024.9
40°	1301.3	1289.5	1198.1	995.7	906.7
42.5°	1247.9	1231.3	1115.6	883.8	785.3
45°	1163.7	1143.9	979.5	708.1	607.2
47.5°	1080.3	1054.2	840.3	548.5	461.8
50°	1022.0	994.3	744.8	451.8	382.5
52.5°	963.8	936.1	647.6	379.2	324.2
55°	880.4	842.8	506.0	290.6	255.0
57.5°	795.4	741.6	376.8	226.4	198.7
60°	738.7	667.5	305.6	187.8	168.0
62.5°	683.7	593.4	250.6	163.8	159.9
65°	597.0	480.3	184.2	147.7	145.7
67.5°	514.5	366.4	136.8	133.1	131.1
70°	451.3	289.1	125.5	123.4	121.4
72.5°	394.7	221.3	114.1	112.1	110.1
75°	315.7	137.6	97.1	95.1	93.1
77.5°	236.0	86.8	80.1	78.1	76.1
80°	184.2	71.4	68.8	66.7	64.8
82.5°	138.8	57.7	55.9	53.8	51.8
85°	74.9	37.3	38.5	34.4	32.4
87.5°	25.9	18.2	18.3	15.3	13.7
90°	0.0	1.2	2.4	3.6	3.6
92.5°	2.9	4.1	5.3	7.5	8.4
95°	9.6	17.8	9.6	10.9	13.2
97.5°	17.1	34.2	70.7	20.9	18.0
100°	22.8	42.8	141.8	41.8	27.6
102.5°	28.6	49.5	191.9	110.2	60.3
105°	37.3	57.2	217.6	277.9	183.9
107.5°	45.9	61.0	207.7	404.5	378.9
110°	51.7	65.8	201.9	425.1	456.8



TEST NUMBER: P621421

CATALOG NUMBER: VLT-F-025U-100D-830-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	57.5	71.6	196.2	413.0	466.4
115°	66.1	80.2	187.5	389.8	455.6
117.5°	75.0	88.9	185.4	364.6	432.3
120°	81.7	94.7	181.5	345.4	415.9
122.5°	86.5	100.4	176.7	328.9	393.8
125°	95.0	107.9	176.7	309.0	365.4
127.5°	101.9	115.1	176.9	285.9	341.6
130°	105.8	119.9	177.9	270.5	323.4
132.5°	110.6	124.7	177.9	263.5	307.0
135°	117.8	130.7	177.9	254.5	292.1
137.5°	123.8	137.7	177.9	244.5	276.7
140°	128.6	141.6	177.9	238.7	268.1
142.5°	133.4	145.4	178.9	231.9	259.4
145°	139.4	151.2	179.1	221.7	245.2
147.5°	146.7	157.0	180.6	214.4	232.5
150°	151.5	160.9	181.5	209.5	224.8
152.5°	156.3	164.7	181.5	205.6	218.1
155°	163.5	169.4	182.7	201.0	210.4
157.5°	169.3	174.9	184.2	198.0	204.8
160°	173.1	177.8	185.1	196.1	201.9
162.5°	176.0	180.7	186.1	195.1	199.1
165°	181.5	183.9	187.5	192.4	195.9
167.5°	184.6	186.8	188.7	191.2	193.3
170°	187.5	188.7	188.7	191.2	192.3
172.5°	188.5	190.6	189.7	190.2	191.4
175°	191.1	192.3	191.1	189.9	188.7
177.5°	191.1	192.1	191.1	191.1	190.2
180°	191.1	191.1	191.1	191.1	191.1



TEST NUMBER: P621421

CATALOG NUMBER: VLT-F-025U-100D-830-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.24	20.36	19.91	21.03	21.81	11.48	12.59	12.14	13.26	14.04
	3H	20.76	21.75	21.44	22.43	23.25	12.85	13.84	13.53	14.53	15.34
	4H	21.28	22.22	21.98	22.91	23.74	13.52	14.45	14.21	15.14	15.97
	6H	21.69	22.55	22.40	23.26	24.10	14.12	14.98	14.83	15.68	16.52
	8H	21.83	22.65	22.55	23.37	24.22	14.35	15.17	15.07	15.89	16.74
	12H	21.92	22.70	22.64	23.41	24.29	14.52	15.30	15.25	16.02	16.89
4H	2H	19.10	20.04	19.80	20.73	21.56	12.13	13.06	12.83	13.75	14.58
	3H	20.76	21.54	21.48	22.27	23.11	13.70	14.47	14.41	15.20	16.05
	4H	21.36	22.06	22.09	22.80	23.67	14.50	15.20	15.23	15.94	16.81
	6H	21.87	22.47	22.62	23.23	24.12	15.26	15.86	16.00	16.62	17.50
	8H	22.06	22.62	22.81	23.38	24.27	15.55	16.12	16.30	16.87	17.77
	12H	22.20	22.70	22.97	23.48	24.39	15.78	16.29	16.55	17.07	17.97
8H	4H	21.30	21.86	22.05	22.62	23.51	14.97	15.54	15.73	16.29	17.19
	6H	21.84	22.30	22.62	23.10	24.00	15.86	16.33	16.65	17.13	18.03
	8H	22.07	22.49	22.87	23.29	24.20	16.26	16.67	17.05	17.47	18.39
	12H	22.27	22.64	23.07	23.43	24.40	16.59	16.96	17.38	17.74	18.72
12H	4H	21.26	21.76	22.03	22.54	23.44	15.03	15.54	15.81	16.32	17.22
	6H	21.81	22.23	22.61	23.03	23.94	15.98	16.39	16.77	17.19	18.11
	8H	22.06	22.43	22.86	23.22	24.19	16.43	16.80	17.23	17.59	18.56