

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P546838

Luminaire Tested: **FMR-24-4-LD4-2LO-40-UNV-93-97-EDD**

Issue Date: 6/15/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P546838
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2102-135-5)
Test Lab: INNOVATION CENTER
Issue Date: 6/15/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FMR-24-4-LD4-2LO-40-UNV-93-97-EDD
Description: 2X4 FMR TROFFER WITH .156 CLEAR TEMPERED GLASS FIXTURE SIDE AND .375 CLEAR TEMPERED GLASS ENVIRONMENTAL SIDE LENSES WITH, 90 CRI AND 4000K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4829.0 lumens
Efficiency: N/A
Efficacy: 103.2 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1 / 1.15
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 46.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P546838

CATALOG NUMBER: FMR-24-4-LD4-2LO-40-UNV-93-97-EDD

Luminous Intensity Polar Plot

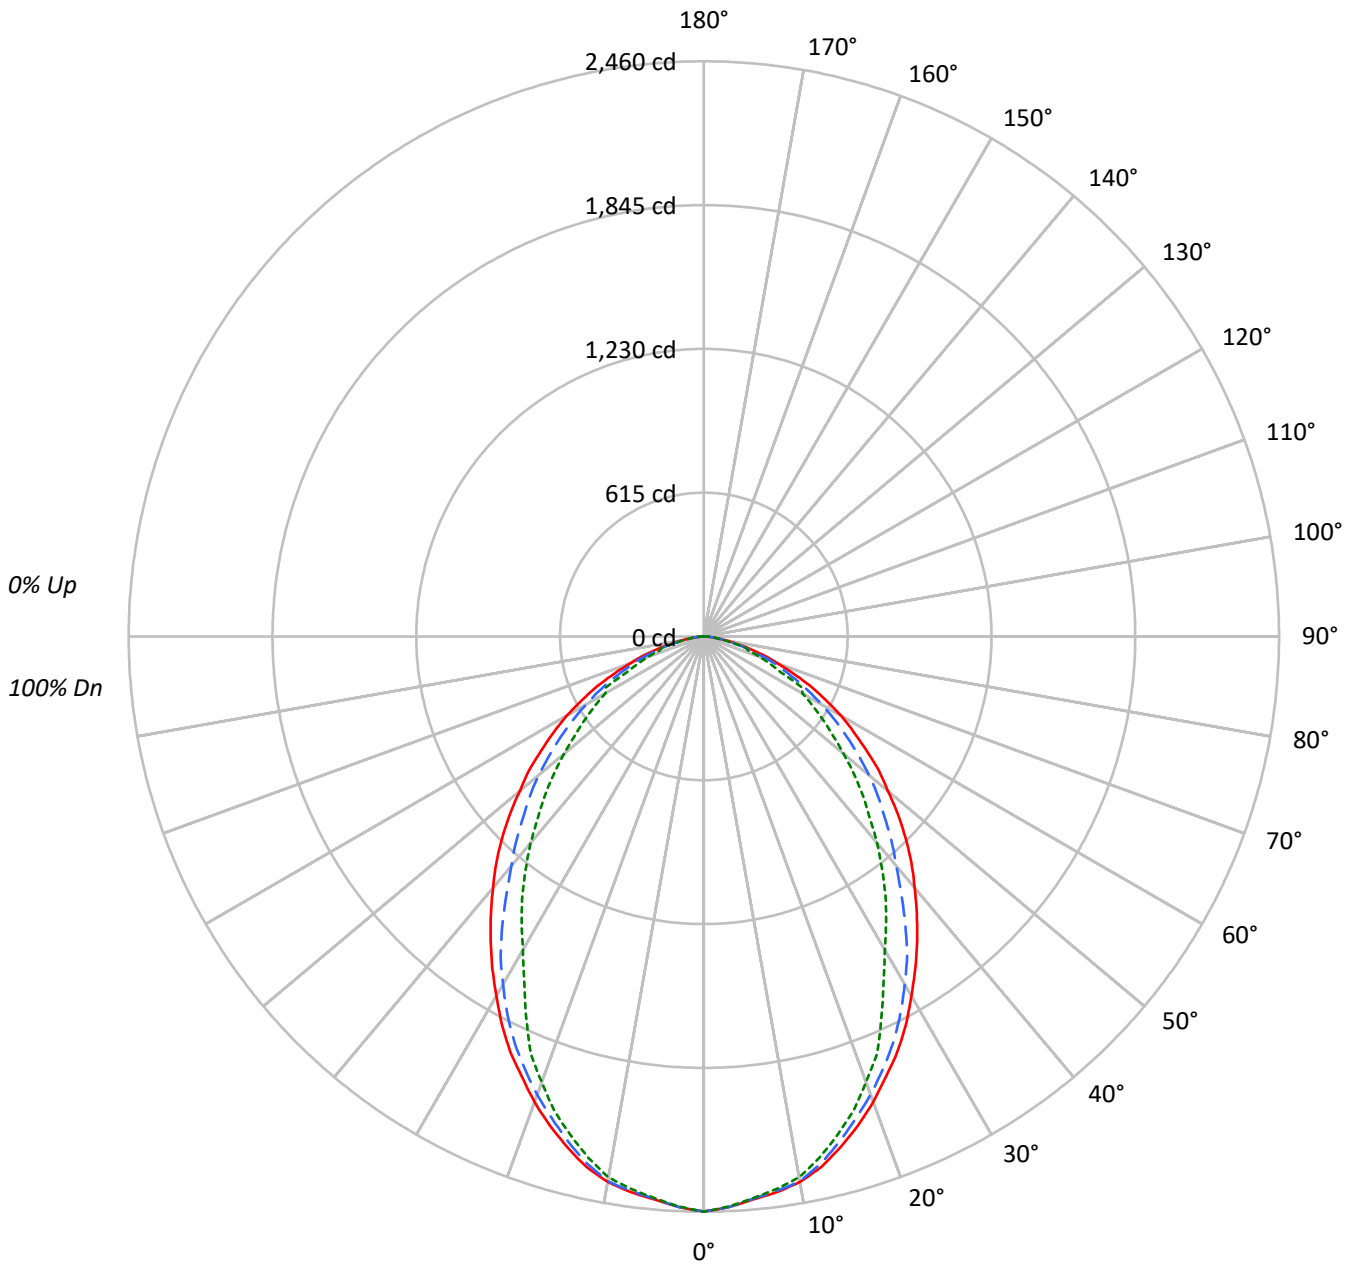



TEST NUMBER: P546838

CATALOG NUMBER: FMR-24-4-LD4-2LO-40-UNV-93-97-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	110	106	102	99	108	104	100	97	100	97	94	96	94	91	92	90	89	87																			
2	101	94	88	83	99	92	87	82	89	84	80	86	82	78	83	79	77	75																			
3	93	84	77	71	91	82	76	70	79	74	69	77	72	68	74	70	67	65																			
4	86	75	67	61	84	74	66	61	72	65	60	69	64	59	67	62	58	56																			
5	80	68	60	54	78	67	59	53	65	58	53	63	57	52	61	56	52	50																			
6	74	62	53	48	72	61	53	47	59	52	47	57	51	47	56	50	46	44																			
7	69	56	48	43	67	56	48	42	54	47	42	53	46	42	51	46	42	40																			
8	65	52	44	38	63	51	44	38	50	43	38	49	42	38	48	42	38	36																			
9	61	48	40	35	59	47	40	35	46	39	35	45	39	34	44	38	34	33																			
10	57	44	37	32	56	44	37	32	43	36	32	42	36	32	41	36	32	30																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3310	3310	3310
5°	3265	3261	3257
10°	3236	3233	3209
15°	3149	3117	3074
20°	3033	2985	2903
25°	2909	2846	2668
30°	2757	2669	2403
35°	2611	2466	2223
40°	2462	2248	2023
45°	2321	2078	1829
50°	2149	1929	1631
55°	1988	1748	1461
60°	1821	1561	1309
65°	1602	1367	1159
70°	1320	1197	984
75°	1050	917	961
80°	705	661	617
85°	438	526	614



TEST NUMBER: P546838

CATALOG NUMBER: FMR-24-4-LD4-2LO-40-UNV-93-97-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	229.0	4.7
10°-20°	628.4	13.0
20°-30°	870.0	18.0
30°-40°	927.7	19.2
40°-50°	846.3	17.5
50°-60°	663.0	13.7
60°-70°	432.1	8.9
70°-80°	191.4	4.0
80°-90°	41.1	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1727.4	35.8
0°-40°	2655.0	55.0
0°-60°	4164.3	86.2
0°-90°	4829.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4829.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2460	2460	2460	2460	2460	
5°	2417	2414	2414	2412	2412	229
15°	2261	2261	2238	2215	2207	636
25°	1959	1948	1917	1848	1797	900
35°	1590	1578	1502	1388	1354	994
45°	1220	1194	1092	1001	961	940
55°	847	822	745	657	623	760
65°	503	475	429	438	364	496
75°	202	188	176	168	185	216
85°	28	31	34	37	40	39
90°	0	0	0	0	0	



TEST NUMBER: P546838

CATALOG NUMBER: FMR-24-4-LD4-2LO-40-UNV-93-97-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2459.8	2459.8	2459.8	2459.8	2459.8
2.5°	2442.8	2442.8	2442.8	2439.9	2439.9
5°	2417.2	2414.3	2414.3	2411.5	2411.5
7.5°	2397.3	2394.4	2391.6	2388.7	2383.0
10°	2368.8	2368.8	2366.0	2351.8	2348.9
12.5°	2323.3	2320.5	2309.1	2289.2	2283.5
15°	2260.8	2260.8	2238.0	2215.3	2206.7
17.5°	2192.5	2189.7	2161.2	2138.5	2127.1
20°	2118.6	2112.9	2084.5	2047.5	2027.6
22.5°	2036.1	2036.1	2002.0	1953.6	1933.7
25°	1959.3	1948.0	1916.7	1848.4	1797.2
27.5°	1871.2	1854.1	1820.0	1723.3	1663.6
30°	1774.5	1766.0	1717.6	1592.5	1547.0
32.5°	1683.5	1669.3	1618.1	1487.3	1450.3
35°	1589.6	1578.3	1501.5	1387.7	1353.6
37.5°	1495.8	1481.6	1384.9	1293.9	1251.2
40°	1402.0	1384.9	1279.7	1197.2	1151.7
42.5°	1313.8	1291.1	1188.7	1100.5	1049.3
45°	1220.0	1194.4	1092.0	1001.0	961.2
47.5°	1126.1	1103.4	1009.5	915.7	870.2
50°	1026.6	1006.7	921.4	827.5	779.2
52.5°	944.1	912.8	830.4	736.5	696.7
55°	847.4	821.8	745.1	656.9	622.8
57.5°	759.3	733.7	662.6	580.1	551.7
60°	676.8	639.8	580.1	509.0	486.3
62.5°	585.8	557.4	506.2	446.5	474.9
65°	503.3	474.9	429.4	437.9	364.0
67.5°	412.3	398.1	358.3	318.5	307.1
70°	335.6	318.5	304.3	261.6	250.2
72.5°	267.3	250.2	230.3	207.6	199.1
75°	201.9	187.7	176.3	167.8	184.8
77.5°	139.3	133.7	125.1	116.6	113.7
80°	91.0	88.2	85.3	82.5	79.6
82.5°	54.0	54.0	54.0	54.0	54.0
85°	28.4	31.3	34.1	37.0	39.8
87.5°	17.1	17.1	19.9	22.7	25.6
90°	0.0	0.0	0.0	0.0	0.0



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180° - - 45°-225° - - - - 90°-270°







(END OF REPORT)