

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P547085

Luminaire Tested: **FMR-24-4-LD4-3LO-35-UNV-82-96-EDD**

Issue Date: 6/15/2021

This test was performed under the Supervised Manufacturer's Testing Program. The results of this test have not been influenced by sources from within Cooper Lighting Solutions or from external interests.



Test Information

Test Method: LM-79-08
Report Number: P547085
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2102-135-5)
Test Lab: INNOVATION CENTER
Issue Date: 6/15/2021
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FMR-24-4-LD4-3LO-35-UNV-82-96-EDD
Description: 2X4 FMR TROFFER WITH .187 CLEAR PC FIXTURE SIDE AND .250 CLEAR
TEMPERED GLASS ENVIRONMENTAL SIDE LENSES WITH, 90 CRI AND 3500K CCT LEDS
Light Source: -
Ballast/Driver: -

Luminaire Equipment: Sample No. Condition Description

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6875.0 lumens
Efficiency: N/A
Efficacy: 97.9 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1 / 1.15
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 70.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P547085

CATALOG NUMBER: FMR-24-4-LD4-3LO-35-UNV-82-96-EDD

Luminous Intensity Polar Plot

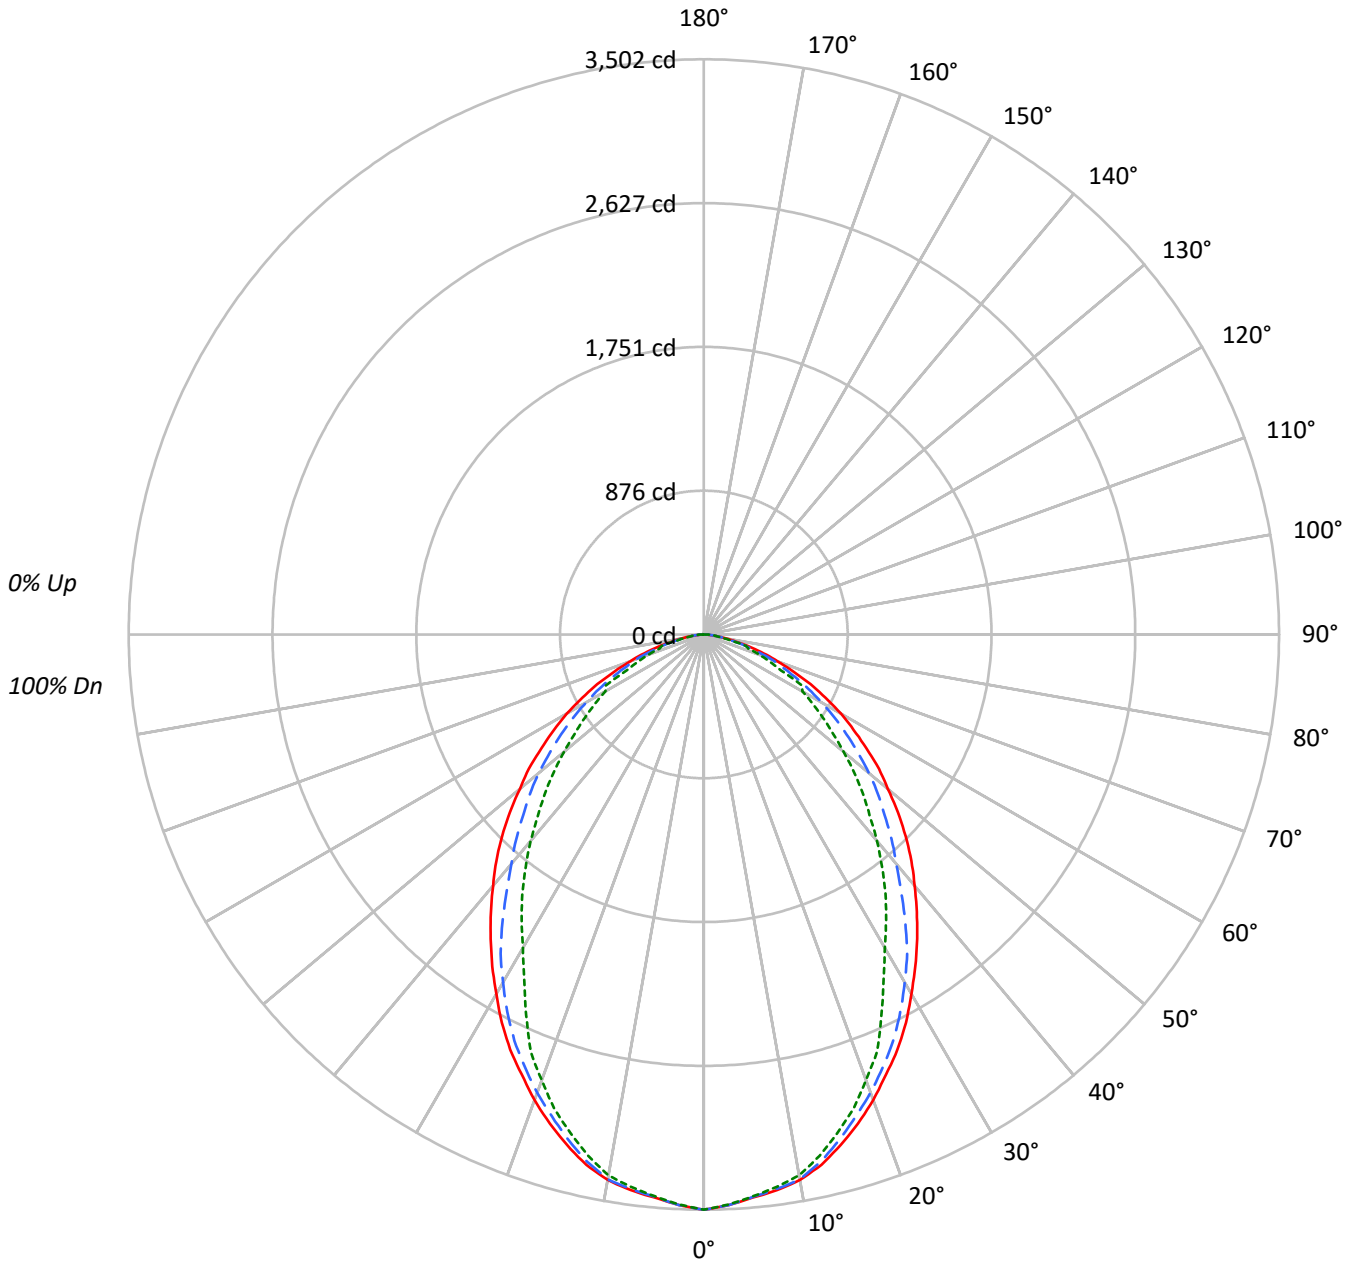



TEST NUMBER: P547085

CATALOG NUMBER: FMR-24-4-LD4-3LO-35-UNV-82-96-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | | | | | | | | | | | | | | | | |
| 1 | 110 | 106 | 102 | 99 | 108 | 104 | 100 | 97 | 100 | 97 | 94 | 96 | 94 | 91 | 92 | 90 | 89 | 87 | | | | | | | | | | | | | | | | | | | |
| 2 | 101 | 94 | 88 | 83 | 99 | 92 | 87 | 82 | 89 | 84 | 80 | 86 | 82 | 78 | 83 | 79 | 77 | 75 | | | | | | | | | | | | | | | | | | | |
| 3 | 93 | 84 | 77 | 71 | 91 | 82 | 76 | 70 | 79 | 74 | 69 | 77 | 72 | 68 | 74 | 70 | 67 | 65 | | | | | | | | | | | | | | | | | | | |
| 4 | 86 | 75 | 67 | 61 | 84 | 74 | 66 | 61 | 72 | 65 | 60 | 69 | 64 | 59 | 67 | 62 | 58 | 56 | | | | | | | | | | | | | | | | | | | |
| 5 | 80 | 68 | 60 | 54 | 78 | 67 | 59 | 53 | 65 | 58 | 53 | 63 | 57 | 52 | 61 | 56 | 52 | 50 | | | | | | | | | | | | | | | | | | | |
| 6 | 74 | 62 | 53 | 48 | 72 | 61 | 53 | 47 | 59 | 52 | 47 | 57 | 51 | 47 | 56 | 50 | 46 | 44 | | | | | | | | | | | | | | | | | | | |
| 7 | 69 | 56 | 48 | 43 | 67 | 56 | 48 | 42 | 54 | 47 | 42 | 53 | 46 | 42 | 51 | 46 | 42 | 40 | | | | | | | | | | | | | | | | | | | |
| 8 | 65 | 52 | 44 | 38 | 63 | 51 | 44 | 38 | 50 | 43 | 38 | 49 | 42 | 38 | 48 | 42 | 38 | 36 | | | | | | | | | | | | | | | | | | | |
| 9 | 61 | 48 | 40 | 35 | 59 | 47 | 40 | 35 | 46 | 39 | 35 | 45 | 39 | 34 | 44 | 38 | 34 | 33 | | | | | | | | | | | | | | | | | | | |
| 10 | 57 | 44 | 37 | 32 | 56 | 44 | 37 | 32 | 43 | 36 | 32 | 42 | 36 | 32 | 41 | 36 | 32 | 30 | | | | | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° | 45° | 90° |
|-----|------|------|------|
| 0° | 4712 | 4712 | 4712 |
| 5° | 4648 | 4643 | 4637 |
| 10° | 4608 | 4602 | 4569 |
| 15° | 4483 | 4438 | 4376 |
| 20° | 4319 | 4249 | 4133 |
| 25° | 4141 | 4051 | 3799 |
| 30° | 3925 | 3799 | 3422 |
| 35° | 3717 | 3511 | 3165 |
| 40° | 3506 | 3200 | 2880 |
| 45° | 3305 | 2958 | 2604 |
| 50° | 3059 | 2746 | 2322 |
| 55° | 2830 | 2488 | 2080 |
| 60° | 2593 | 2222 | 1863 |
| 65° | 2281 | 1946 | 1650 |
| 70° | 1879 | 1704 | 1402 |
| 75° | 1495 | 1305 | 1368 |
| 80° | 1004 | 941 | 879 |
| 85° | 625 | 750 | 875 |



TEST NUMBER: P547085

CATALOG NUMBER: FMR-24-4-LD4-3LO-35-UNV-82-96-EDD

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 326.0 | 4.7 |
| 10°-20° | 894.7 | 13.0 |
| 20°-30° | 1238.6 | 18.0 |
| 30°-40° | 1320.7 | 19.2 |
| 40°-50° | 1204.9 | 17.5 |
| 50°-60° | 943.9 | 13.7 |
| 60°-70° | 615.2 | 8.9 |
| 70°-80° | 272.6 | 4.0 |
| 80°-90° | 58.5 | 0.9 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 2459.2 | 35.8 |
| 0°-40° | 3779.9 | 55.0 |
| 0°-60° | 5928.7 | 86.2 |
| 0°-90° | 6875.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 6875.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | 22.5° | 45° | 67.5° | 90° | Flux |
|-----|------|-------|------|-------|------|------|
| 0° | 3502 | 3502 | 3502 | 3502 | 3502 | |
| 5° | 3441 | 3437 | 3437 | 3433 | 3433 | 327 |
| 15° | 3219 | 3219 | 3186 | 3154 | 3142 | 905 |
| 25° | 2790 | 2773 | 2729 | 2632 | 2559 | 1281 |
| 35° | 2263 | 2247 | 2138 | 1976 | 1927 | 1415 |
| 45° | 1737 | 1700 | 1555 | 1425 | 1368 | 1338 |
| 55° | 1206 | 1170 | 1061 | 935 | 887 | 1082 |
| 65° | 717 | 676 | 611 | 624 | 518 | 706 |
| 75° | 288 | 267 | 251 | 239 | 263 | 308 |
| 85° | 40 | 44 | 49 | 53 | 57 | 56 |
| 90° | 0 | 0 | 0 | 0 | 0 | |



TEST NUMBER: P547085

CATALOG NUMBER: FMR-24-4-LD4-3LO-35-UNV-82-96-EDD

CANDELA DISTRIBUTION (FULL):

| | 0° | 22.5° | 45° | 67.5° | 90° |
|-------|--------|--------|--------|--------|--------|
| 0° | 3502.0 | 3502.0 | 3502.0 | 3502.0 | 3502.0 |
| 2.5° | 3477.7 | 3477.7 | 3477.7 | 3473.7 | 3473.7 |
| 5° | 3441.3 | 3437.3 | 3437.3 | 3433.2 | 3433.2 |
| 7.5° | 3413.0 | 3408.9 | 3404.9 | 3400.8 | 3392.7 |
| 10° | 3372.5 | 3372.5 | 3368.4 | 3348.2 | 3344.1 |
| 12.5° | 3307.7 | 3303.7 | 3287.5 | 3259.1 | 3251.0 |
| 15° | 3218.6 | 3218.6 | 3186.2 | 3153.9 | 3141.7 |
| 17.5° | 3121.5 | 3117.4 | 3076.9 | 3044.5 | 3028.3 |
| 20° | 3016.2 | 3008.1 | 2967.6 | 2915.0 | 2886.6 |
| 22.5° | 2898.8 | 2898.8 | 2850.2 | 2781.4 | 2753.0 |
| 25° | 2789.5 | 2773.3 | 2728.8 | 2631.6 | 2558.7 |
| 27.5° | 2664.0 | 2639.7 | 2591.1 | 2453.4 | 2368.4 |
| 30° | 2526.3 | 2514.2 | 2445.4 | 2267.2 | 2202.4 |
| 32.5° | 2396.8 | 2376.5 | 2303.6 | 2117.4 | 2064.8 |
| 35° | 2263.2 | 2247.0 | 2137.7 | 1975.7 | 1927.1 |
| 37.5° | 2129.6 | 2109.3 | 1971.7 | 1842.1 | 1781.4 |
| 40° | 1996.0 | 1971.7 | 1821.9 | 1704.5 | 1639.7 |
| 42.5° | 1870.5 | 1838.1 | 1692.3 | 1566.8 | 1493.9 |
| 45° | 1736.8 | 1700.4 | 1554.7 | 1425.1 | 1368.4 |
| 47.5° | 1603.2 | 1570.9 | 1437.3 | 1303.6 | 1238.9 |
| 50° | 1461.5 | 1433.2 | 1311.7 | 1178.1 | 1109.3 |
| 52.5° | 1344.1 | 1299.6 | 1182.2 | 1048.6 | 991.9 |
| 55° | 1206.5 | 1170.0 | 1060.7 | 935.2 | 886.6 |
| 57.5° | 1081.0 | 1044.5 | 943.3 | 825.9 | 785.4 |
| 60° | 963.6 | 910.9 | 825.9 | 724.7 | 692.3 |
| 62.5° | 834.0 | 793.5 | 720.6 | 635.6 | 676.1 |
| 65° | 716.6 | 676.1 | 611.3 | 623.5 | 518.2 |
| 67.5° | 587.0 | 566.8 | 510.1 | 453.4 | 437.2 |
| 70° | 477.7 | 453.4 | 433.2 | 372.5 | 356.3 |
| 72.5° | 380.6 | 356.3 | 327.9 | 295.5 | 283.4 |
| 75° | 287.5 | 267.2 | 251.0 | 238.9 | 263.2 |
| 77.5° | 198.4 | 190.3 | 178.1 | 166.0 | 161.9 |
| 80° | 129.6 | 125.5 | 121.5 | 117.4 | 113.4 |
| 82.5° | 76.9 | 76.9 | 76.9 | 76.9 | 76.9 |
| 85° | 40.5 | 44.5 | 48.6 | 52.6 | 56.7 |
| 87.5° | 24.3 | 24.3 | 28.3 | 32.4 | 36.4 |
| 90° | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180° - - 45°-225° - - - - 90°-270°







(END OF REPORT)