

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P560302

Luminaire Tested: FSR-12-2-LD4-2HI-40-UNV-93-97-EDD-90

Issue Date: 7/20/2021

Test Information

Test Method: LM-79-2019
Report Number: P560302
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2102-135-5)
Test Lab: INNOVATION CENTER
Issue Date: 7/20/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: FSR-12-2-LD4-2HI-40-UNV-93-97-EDD-90
Description: 1X2 FSR TROFFER WITH .156 CLEAR TEMPERED GLASS FIXTURE SIDE AND .375 CLEAR TEMPER GLASS ENVIRONMENTAL SIDE LENSES WITH, 90 CRI AND 4000K CCT LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3041.0 lumens
Efficiency: N/A
Efficacy: 70.4 lumens/watt
Spacing Criteria (0/90/45): 1.1 / 1 / 1.15
Luminous Opening: Rectangular (W 1' x L: 2' x H: 0')
CIE Type: Direct


Input Watts (W): 43.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P560302

CATALOG NUMBER: FSR-12-2-LD4-2HI-40-UNV-93-97-EDD-90

Luminous Intensity Polar Plot

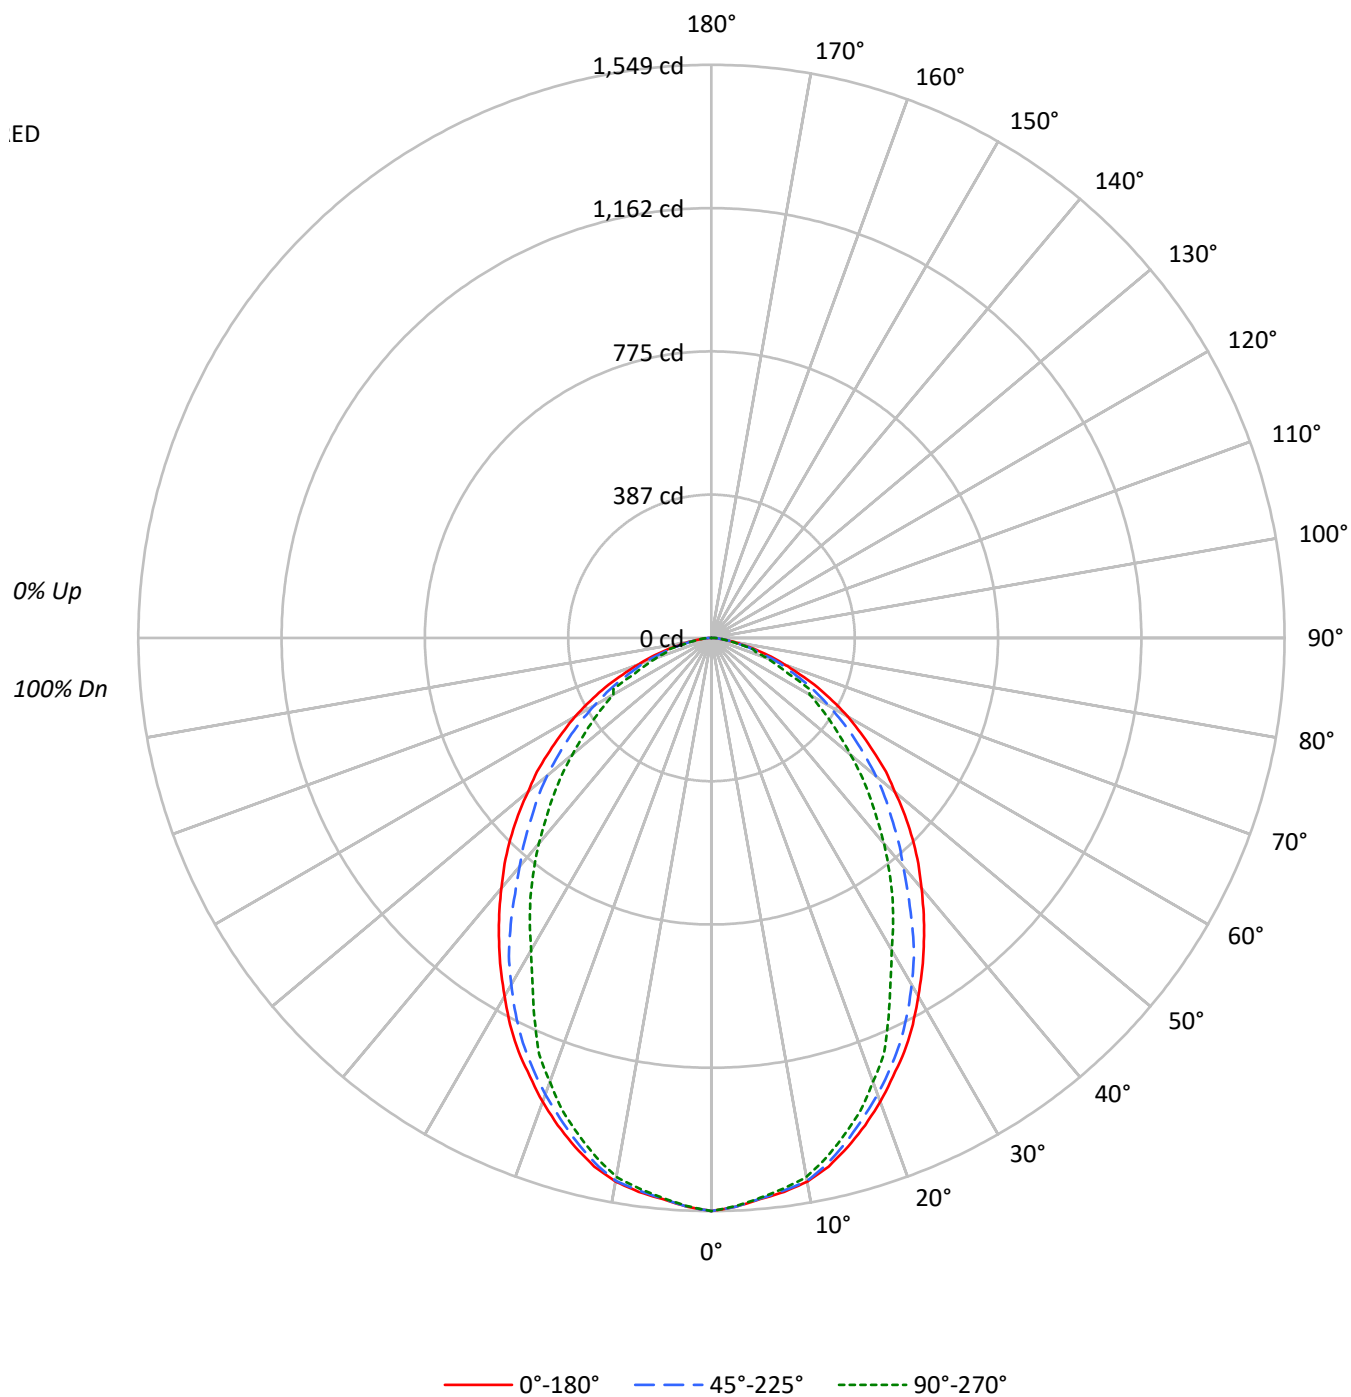



TEST NUMBER: P560302

CATALOG NUMBER: FSR-12-2-LD4-2HI-40-UNV-93-97-EDD-90

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20				
RC	80					70					50					30					10				
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10		
RCR																									
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100							
1	110	106	102	99	108	104	100	97	100	97	94	96	94	91	92	90	89	87							
2	101	94	88	83	99	92	87	82	89	84	80	86	82	78	83	79	77	75							
3	93	84	77	71	91	82	76	70	79	74	69	77	72	68	74	70	67	65							
4	86	75	67	61	84	74	66	61	72	65	60	69	64	59	67	62	58	56							
5	80	68	60	54	78	67	59	53	65	58	53	63	57	52	61	56	52	50							
6	74	62	53	48	72	61	53	47	59	52	47	57	51	47	56	50	46	44							
7	69	56	48	43	67	56	48	42	54	47	42	53	46	42	51	46	42	40							
8	65	52	44	38	63	51	44	38	50	43	38	49	42	38	48	42	38	36							
9	61	48	40	35	59	47	40	35	46	39	35	45	39	34	44	38	34	33							
10	57	44	37	32	56	44	37	32	43	36	32	42	36	32	41	36	32	30							

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	8337	8337	8337
5°	8224	8214	8204
10°	8152	8142	8084
15°	7933	7853	7743
20°	7641	7518	7313
25°	7327	7168	6721
30°	6945	6722	6054
35°	6577	6212	5600
40°	6203	5662	5096
45°	5848	5234	4607
50°	5413	4858	4109
55°	5008	4403	3680
60°	4588	3932	3296
65°	4037	3443	2919
70°	3325	3015	2480
75°	2643	2308	2420
80°	1776	1664	1553
85°	1105	1328	1550

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5848 cd/sqm

TEST NUMBER: P560302

CATALOG NUMBER: FSR-12-2-LD4-2HI-40-UNV-93-97-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	144.2	4.7
10°-20°	395.7	13.0
20°-30°	547.9	18.0
30°-40°	584.2	19.2
40°-50°	532.9	17.5
50°-60°	417.5	13.7
60°-70°	272.1	8.9
70°-80°	120.6	4.0
80°-90°	25.9	0.9
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1087.8	35.8
0°-40°	1672.0	55.0
0°-60°	2622.4	86.2
0°-90°	3041.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3041.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1549	1549	1549	1549	1549	
5°	1522	1520	1520	1519	1519	144
15°	1424	1424	1409	1395	1390	400
25°	1234	1227	1207	1164	1132	566
35°	1001	994	946	874	852	626
45°	768	752	688	630	605	592
55°	534	518	469	414	392	479
65°	317	299	270	276	229	312
75°	127	118	111	106	116	136
85°	18	20	22	23	25	25
90°	0	0	0	0	0	

TEST NUMBER: P560302

CATALOG NUMBER: FSR-12-2-LD4-2HI-40-UNV-93-97-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1549.0	1549.0	1549.0	1549.0	1549.0
2.5°	1538.3	1538.3	1538.3	1536.5	1536.5
5°	1522.2	1520.4	1520.4	1518.6	1518.6
7.5°	1509.6	1507.9	1506.1	1504.3	1500.7
10°	1491.7	1491.7	1489.9	1481.0	1479.2
12.5°	1463.1	1461.3	1454.1	1441.6	1438.0
15°	1423.7	1423.7	1409.4	1395.0	1389.7
17.5°	1380.7	1378.9	1361.0	1346.7	1339.5
20°	1334.1	1330.6	1312.7	1289.4	1276.8
22.5°	1282.2	1282.2	1260.7	1230.3	1217.7
25°	1233.9	1226.7	1207.0	1164.0	1131.8
27.5°	1178.3	1167.6	1146.1	1085.2	1047.6
30°	1117.5	1112.1	1081.6	1002.8	974.2
32.5°	1060.2	1051.2	1019.0	936.6	913.3
35°	1001.1	993.9	945.5	873.9	852.4
37.5°	942.0	933.0	872.1	814.8	788.0
40°	882.9	872.1	805.9	753.9	725.3
42.5°	827.4	813.0	748.6	693.0	660.8
45°	768.3	752.1	687.7	630.4	605.3
47.5°	709.2	694.8	635.7	576.6	548.0
50°	646.5	633.9	580.2	521.1	490.7
52.5°	594.5	574.8	522.9	463.8	438.7
55°	533.7	517.5	469.2	413.7	392.2
57.5°	478.1	462.0	417.3	365.3	347.4
60°	426.2	402.9	365.3	320.6	306.2
62.5°	368.9	351.0	318.8	281.2	299.1
65°	317.0	299.1	270.4	275.8	229.2
67.5°	259.7	250.7	225.6	200.6	193.4
70°	211.3	200.6	191.6	164.8	157.6
72.5°	168.3	157.6	145.1	130.7	125.4
75°	127.1	118.2	111.0	105.7	116.4
77.5°	87.7	84.2	78.8	73.4	71.6
80°	57.3	55.5	53.7	51.9	50.1
82.5°	34.0	34.0	34.0	34.0	34.0
85°	17.9	19.7	21.5	23.3	25.1
87.5°	10.7	10.7	12.5	14.3	16.1
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)