

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P573642

Luminaire Tested: **FLD4C-50-D010 FEU4C-X-90-27 F4X-N-X-LI**

Issue Date: 3/1/2023



Test Information

Test Method: LM-79-08
Report Number: P573642
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/1/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD4C-50-D010 FEU4C-X-90-27 F4X-N-X-LI
Description: 4 INCH FAIL-SAFE LED DOWNLIGHT WITH 2700K, 90 CRI LEDS, 4LBNLI TRIM

Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3737.0 lumens
Efficiency: N/A
Efficacy: 64.0 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 58.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P573642

CATALOG NUMBER: FLD4C-50-D010 FEU4C-X-90-27 F4X-N-X-LI

Luminous Intensity Polar Plot

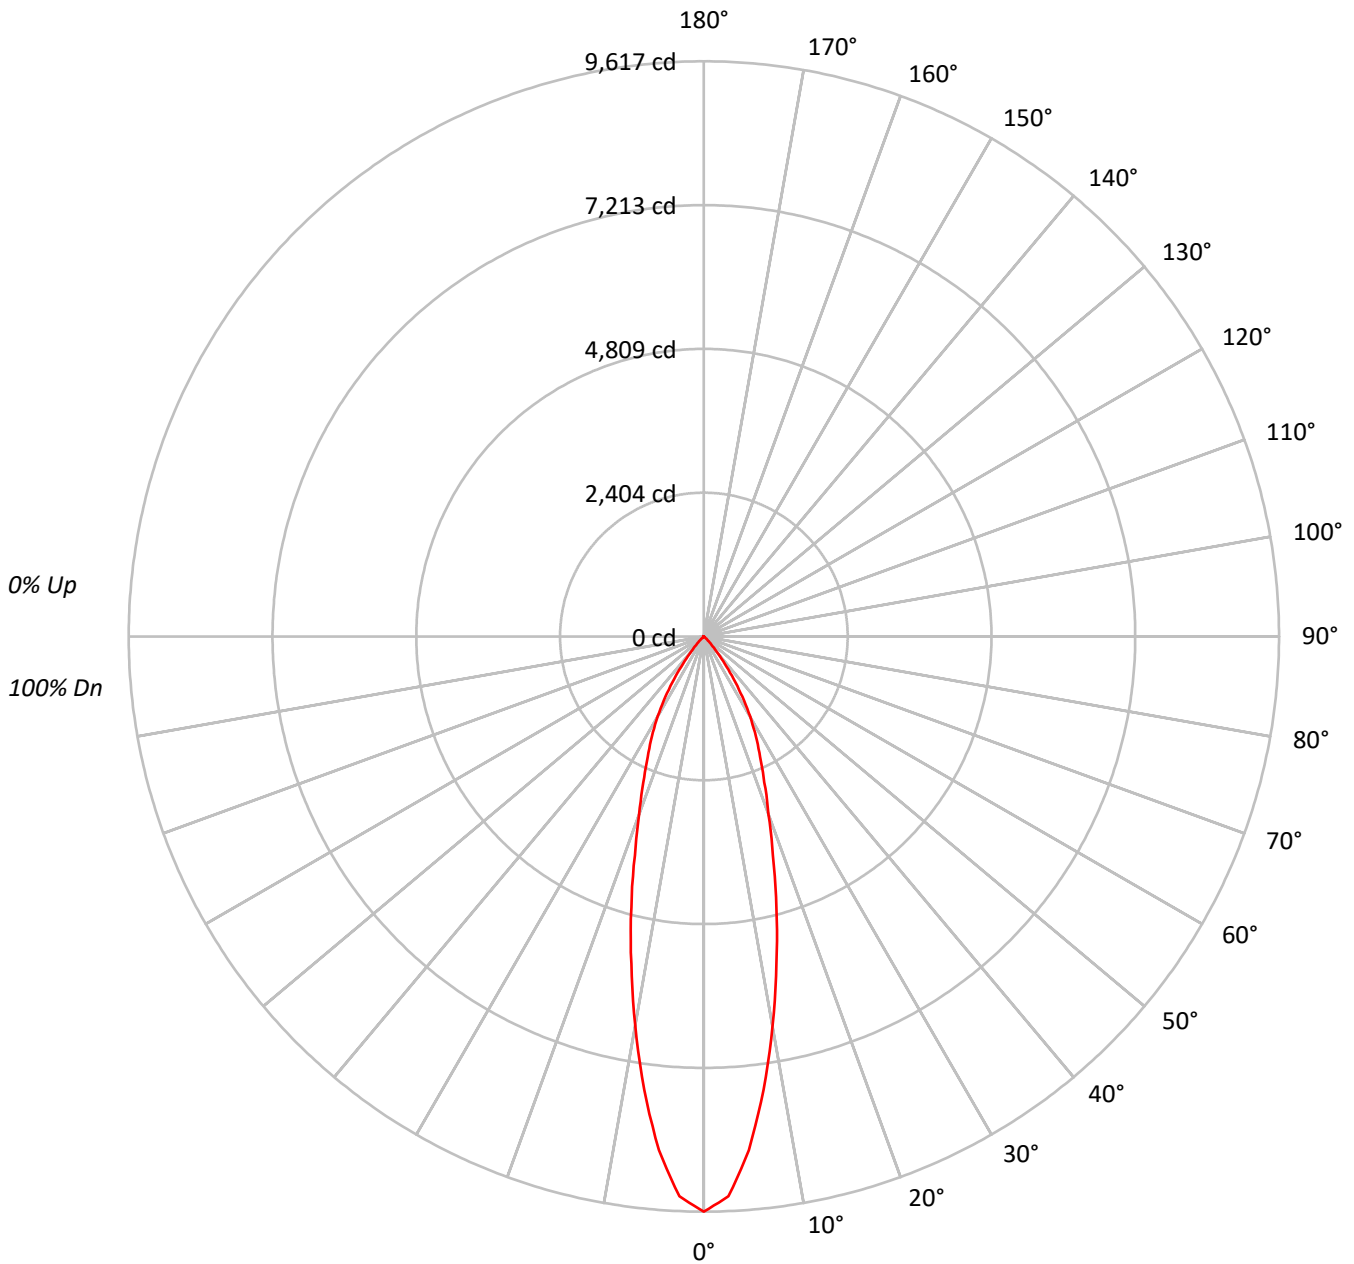



TEST NUMBER: P573642

CATALOG NUMBER: FLD4C-50-D010 FEU4C-X-90-27 F4X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95																			
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90																			
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85																			
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81																			
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77																			
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73																			
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69																			
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66																			
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63																			
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1181470
5°	1063202
10°	824215
15°	596559
20°	413067
25°	301133
30°	218803
35°	129475
40°	54463
45°	16975
50°	2198
55°	1242
60°	1425
65°	1686
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P573642

CATALOG NUMBER: FLD4C-50-D010 FEU4C-X-90-27 F4X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	757.9	20.3
10°-20°	1297.5	34.7
20°-30°	1031.2	27.6
30°-40°	545.9	14.6
40°-50°	94.0	2.5
50°-60°	7.1	0.2
60°-70°	3.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3086.5	82.6
0°-40°	3632.4	97.2
0°-60°	3733.5	99.9
0°-90°	3737.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3737.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9617	
5°	8621	758
15°	4690	1297
25°	2222	1031
35°	863	546
45°	98	94
55°	6	7
65°	6	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P573642

CATALOG NUMBER: FLD4C-50-D010 FEU4C-X-90-27 F4X-N-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	9616.9
2.5°	9369.3
5°	8621.3
7.5°	7642.9
10°	6607.0
12.5°	5605.6
15°	4690.4
17.5°	3838.6
20°	3159.5
22.5°	2641.5
25°	2221.5
27.5°	1882.0
30°	1542.4
32.5°	1197.1
35°	863.3
37.5°	569.9
40°	339.6
42.5°	195.7
45°	97.7
47.5°	34.6
50°	11.5
52.5°	11.5
55°	5.8
57.5°	5.8
60°	5.8
62.5°	5.8
65°	5.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)