

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P365967

Luminaire Tested: **FLD6BX10D010-FEU6B12-8050-F6LBXVM1-WMH-BTR94**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P365967
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1910-544-33)
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6BX10D010-FEU6B12-8050-F6LBXVM1-WMH-BTR94
Description: VANDAL RESISTANT ENCLOSED BOTTOM TRIM RING, WARM HAZE REFLECTOR,
BOTTOM TRIM GLASS, TEMPERED CLEAR 0.187", 1000LM
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 859.0 lumens
Efficiency: N/A
Efficacy: 85.9 lumens/watt
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.8
Luminous Opening: Circular (Dia: 0.44' x H: 0')
CIE Type: Direct


Input Watts (W): 10
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P365967

CATALOG NUMBER: FLD6BX10D010-FEU6B12-8050-F6LBXVM1-WMH-BTR94

Luminous Intensity Polar Plot

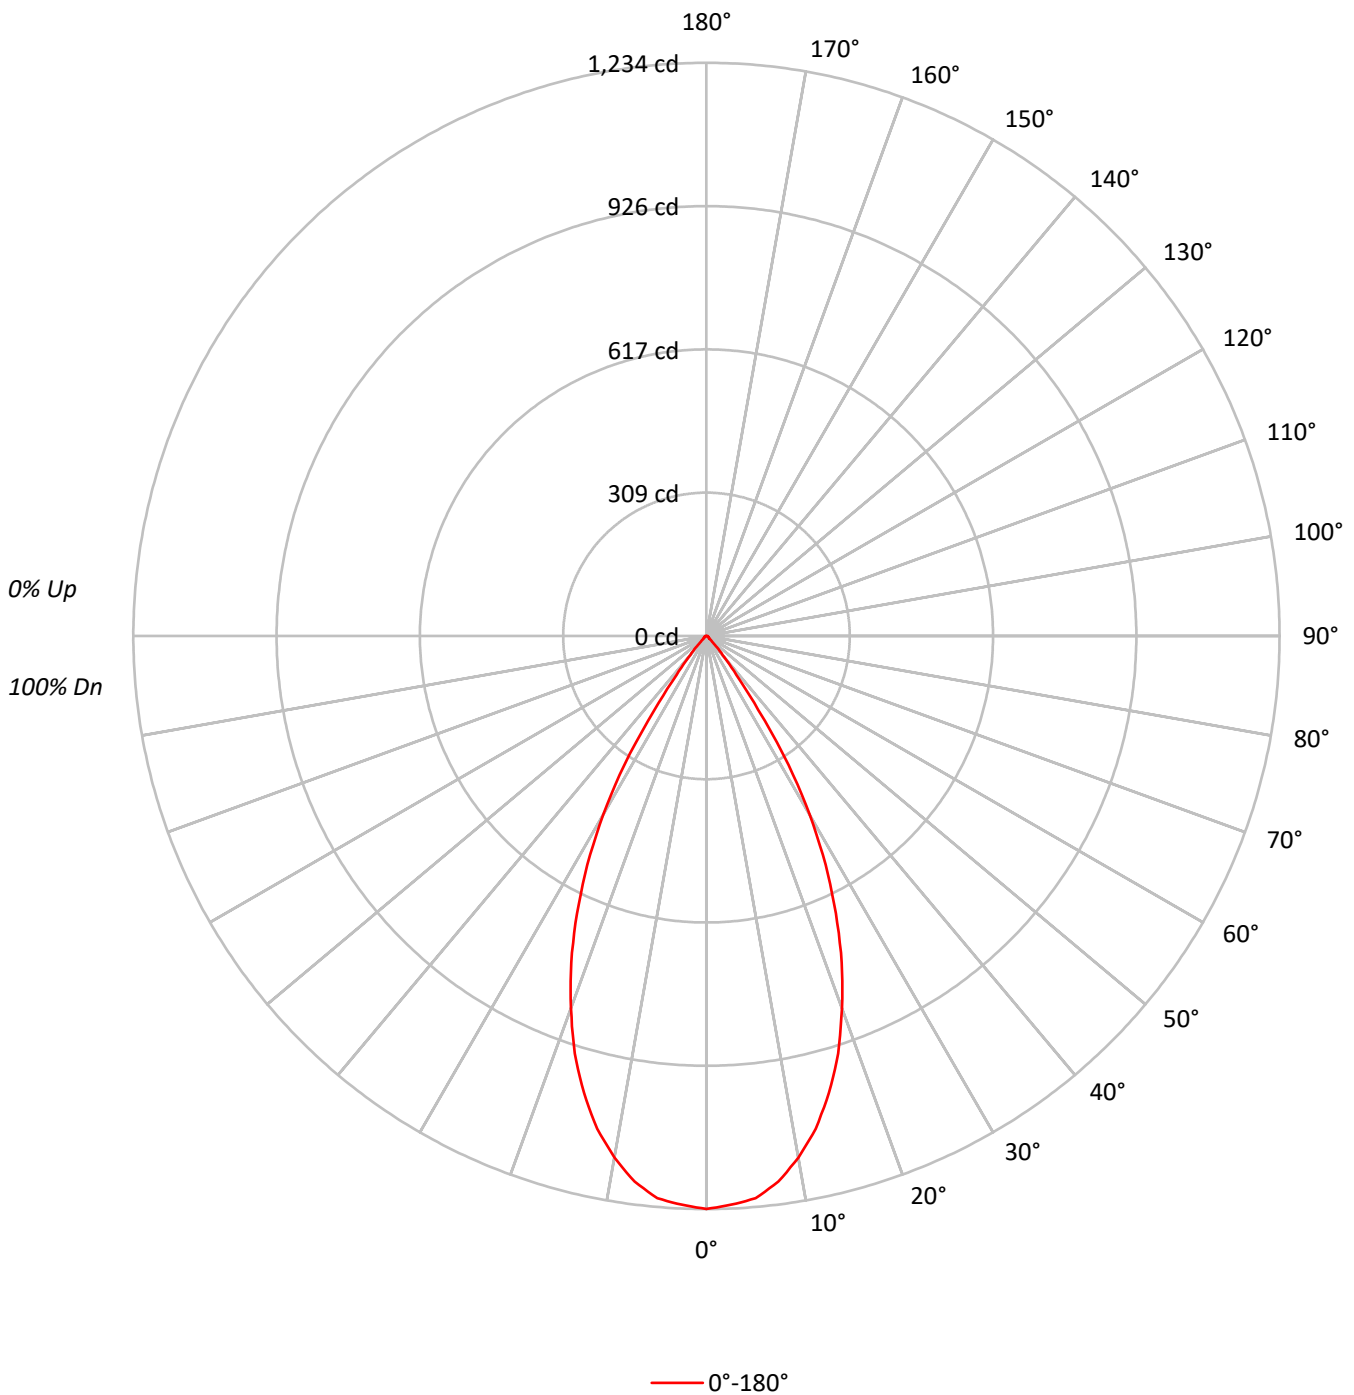



TEST NUMBER: P365967

CATALOG NUMBER: FLD6BX10D010-FEU6B12-8050-F6LBXVM1-WMH-BTR94

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | | 50 | 30 | 10 | | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | | 106 | 106 | 106 | | 102 | 102 | 102 | 100 |
| 1 | 114 | 111 | 109 | 107 | 111 | 109 | 107 | 105 | 105 | 103 | 102 | | 101 | 100 | 99 | | 98 | 97 | 96 | 94 |
| 2 | 109 | 104 | 100 | 97 | 106 | 102 | 99 | 96 | 99 | 96 | 94 | | 96 | 94 | 92 | | 93 | 92 | 90 | 88 |
| 3 | 104 | 98 | 93 | 89 | 102 | 96 | 92 | 88 | 94 | 90 | 87 | | 91 | 88 | 86 | | 89 | 87 | 84 | 83 |
| 4 | 99 | 92 | 87 | 83 | 97 | 91 | 86 | 82 | 89 | 85 | 81 | | 87 | 83 | 80 | | 85 | 82 | 79 | 78 |
| 5 | 94 | 87 | 81 | 77 | 93 | 86 | 81 | 77 | 84 | 80 | 76 | | 82 | 78 | 75 | | 81 | 77 | 75 | 73 |
| 6 | 90 | 82 | 76 | 72 | 89 | 81 | 76 | 72 | 80 | 75 | 72 | | 78 | 74 | 71 | | 77 | 73 | 71 | 69 |
| 7 | 86 | 78 | 72 | 68 | 85 | 77 | 72 | 68 | 76 | 71 | 67 | | 74 | 70 | 67 | | 73 | 70 | 67 | 65 |
| 8 | 82 | 74 | 68 | 64 | 81 | 73 | 68 | 64 | 72 | 67 | 64 | | 71 | 67 | 63 | | 70 | 66 | 63 | 62 |
| 9 | 79 | 70 | 64 | 61 | 78 | 69 | 64 | 61 | 68 | 64 | 60 | | 68 | 63 | 60 | | 67 | 63 | 60 | 59 |
| 10 | 76 | 66 | 61 | 57 | 75 | 66 | 61 | 57 | 65 | 61 | 57 | | 65 | 60 | 57 | | 64 | 60 | 57 | 56 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 88335 |
| 5° | 87343 |
| 10° | 82914 |
| 15° | 75506 |
| 20° | 64981 |
| 25° | 52064 |
| 30° | 36734 |
| 35° | 17010 |
| 40° | 5533 |
| 45° | 1772 |
| 50° | 847 |
| 55° | 761 |
| 60° | 702 |
| 65° | 644 |
| 70° | 628 |
| 75° | 830 |
| 80° | 948 |
| 85° | 1561 |



TEST NUMBER: P365967

CATALOG NUMBER: FLD6BX10D010-FEUG6B12-8050-F6LBXVM1-WMH-BTR94

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 113.5 | 13.2 |
| 10°-20° | 282.5 | 32.9 |
| 20°-30° | 298.1 | 34.7 |
| 30°-40° | 133.4 | 15.5 |
| 40°-50° | 17.5 | 2.0 |
| 50°-60° | 5.4 | 0.6 |
| 60°-70° | 3.8 | 0.4 |
| 70°-80° | 3.0 | 0.3 |
| 80°-90° | 1.8 | 0.2 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 694.2 | 80.8 |
| 0°-40° | 827.6 | 96.3 |
| 0°-60° | 850.4 | 99.0 |
| 0°-90° | 859.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 859.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1234 | |
| 5° | 1215 | 114 |
| 15° | 1019 | 282 |
| 25° | 659 | 298 |
| 35° | 195 | 133 |
| 45° | 18 | 17 |
| 55° | 6 | 5 |
| 65° | 4 | 4 |
| 75° | 3 | 3 |
| 85° | 2 | 2 |
| 90° | 0 | |



TEST NUMBER: P365967

CATALOG NUMBER: FLD6BX10D010-FEU6B12-8050-F6LBXVM1-WMH-BTR94

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1233.7 |
| 2.5° | 1225.8 |
| 5° | 1215.2 |
| 7.5° | 1185.2 |
| 10° | 1140.4 |
| 12.5° | 1086.9 |
| 15° | 1018.6 |
| 17.5° | 942.8 |
| 20° | 852.8 |
| 22.5° | 761.4 |
| 25° | 659.0 |
| 27.5° | 555.4 |
| 30° | 444.3 |
| 32.5° | 329.3 |
| 35° | 194.6 |
| 37.5° | 105.8 |
| 40° | 59.2 |
| 42.5° | 33.0 |
| 45° | 17.5 |
| 47.5° | 9.1 |
| 50° | 7.6 |
| 52.5° | 6.4 |
| 55° | 6.1 |
| 57.5° | 5.3 |
| 60° | 4.9 |
| 62.5° | 4.2 |
| 65° | 3.8 |
| 67.5° | 3.4 |
| 70° | 3.0 |
| 72.5° | 3.0 |
| 75° | 3.0 |
| 77.5° | 2.7 |
| 80° | 2.3 |
| 82.5° | 2.3 |
| 85° | 1.9 |
| 87.5° | 1.1 |
| 90° | 0.0 |

(END OF REPORT)