

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P365453

Luminaire Tested: **FLD6BX30D010-FEU6B35-8030-F6LBXVM1-MW-BL89BW**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P365453
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1910-544-35)
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6BX30D010-FEU6B35-8030-F6LBXVM1-MW-BL89BW
Description: VANDAL RESISTANT ENCLOSED BOTTOM LENS, MATTE WHITE REFLECTOR, BOTTOM LENS ACRYLIC OPAL SMOOTH, CLEAR 0.125", 3000LM
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1767.0 lumens
Efficiency: N/A
Efficacy: 65.4 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.36
Luminous Opening: Circular (Dia: 0.71' x H: 0')
CIE Type: Direct


Input Watts (W): 27
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P365453

CATALOG NUMBER: FLD6BX30D010-FEU6B35-8030-F6LBXVM1-MW-BL89BW

Luminous Intensity Polar Plot

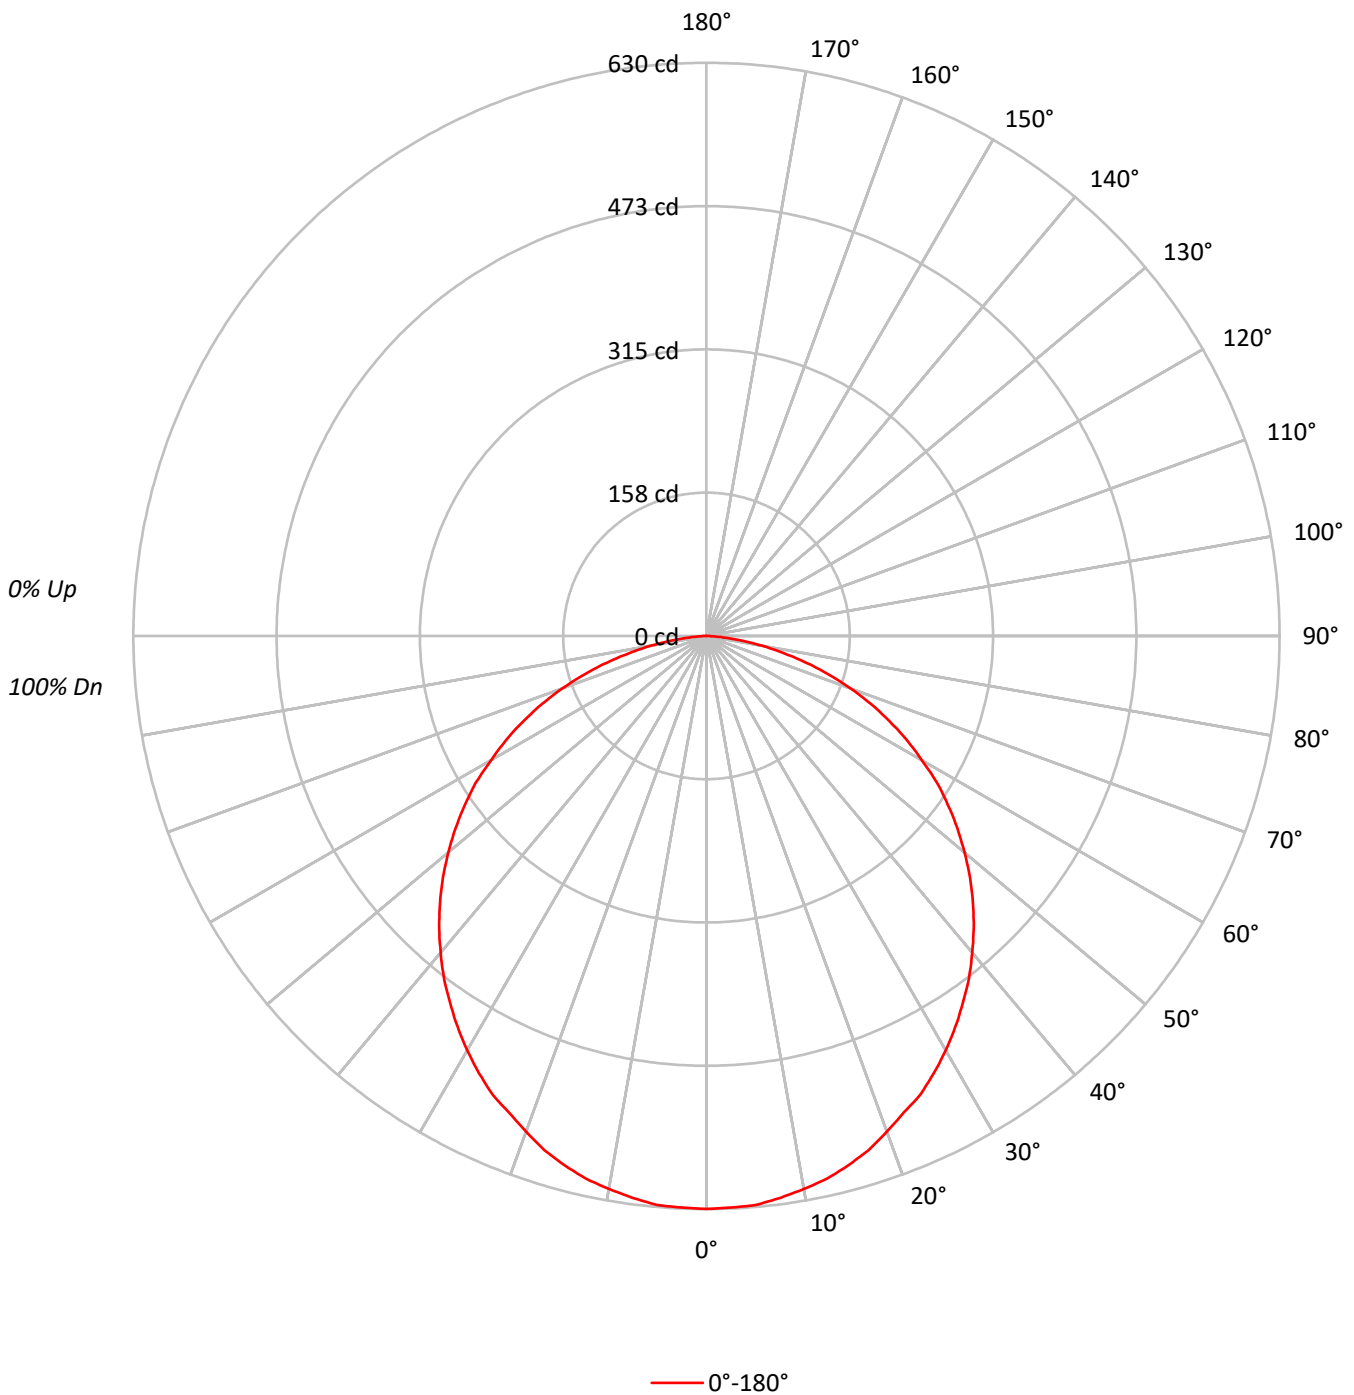



TEST NUMBER: P365453

CATALOG NUMBER: FLD6BX30D010-FEU6B35-8030-F6LBXVM1-MW-BL89BW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | | 50 | 30 | 10 | | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | | 106 | 106 | 106 | | 102 | 102 | 102 | 100 |
| 1 | 109 | 104 | 100 | 96 | 106 | 102 | 98 | 95 | 98 | 94 | 92 | | 94 | 91 | 89 | | 90 | 88 | 86 | 84 |
| 2 | 99 | 91 | 84 | 78 | 96 | 89 | 83 | 77 | 85 | 80 | 75 | | 82 | 78 | 74 | | 79 | 75 | 72 | 70 |
| 3 | 90 | 80 | 71 | 65 | 88 | 78 | 70 | 64 | 75 | 69 | 63 | | 72 | 67 | 62 | | 70 | 65 | 61 | 59 |
| 4 | 83 | 71 | 62 | 55 | 80 | 69 | 61 | 55 | 67 | 60 | 54 | | 64 | 58 | 53 | | 62 | 57 | 52 | 50 |
| 5 | 76 | 63 | 54 | 47 | 74 | 62 | 53 | 47 | 60 | 52 | 47 | | 58 | 51 | 46 | | 56 | 50 | 45 | 43 |
| 6 | 70 | 57 | 48 | 41 | 68 | 56 | 47 | 41 | 54 | 46 | 41 | | 52 | 45 | 40 | | 51 | 45 | 40 | 38 |
| 7 | 65 | 51 | 43 | 36 | 63 | 51 | 42 | 36 | 49 | 41 | 36 | | 48 | 41 | 36 | | 46 | 40 | 35 | 33 |
| 8 | 60 | 47 | 38 | 32 | 59 | 46 | 38 | 32 | 45 | 37 | 32 | | 44 | 37 | 32 | | 42 | 36 | 32 | 30 |
| 9 | 56 | 43 | 35 | 29 | 55 | 42 | 35 | 29 | 41 | 34 | 29 | | 40 | 34 | 29 | | 39 | 33 | 29 | 27 |
| 10 | 53 | 40 | 32 | 26 | 52 | 39 | 32 | 26 | 38 | 31 | 26 | | 37 | 31 | 26 | | 36 | 30 | 26 | 24 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 17203 |
| 5° | 17214 |
| 10° | 17116 |
| 15° | 17035 |
| 20° | 16854 |
| 25° | 16766 |
| 30° | 16591 |
| 35° | 16396 |
| 40° | 16206 |
| 45° | 16004 |
| 50° | 15732 |
| 55° | 15439 |
| 60° | 14931 |
| 65° | 14368 |
| 70° | 13457 |
| 75° | 11989 |
| 80° | 9706 |
| 85° | 5829 |



TEST NUMBER: P365453

CATALOG NUMBER: FLD6BX30D010-FEU6B35-8030-F6LBXVM1-MW-BL89BW

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 59.5 | 3.4 |
| 10°-20° | 169.9 | 9.6 |
| 20°-30° | 255.9 | 14.5 |
| 30°-40° | 307.8 | 17.4 |
| 40°-50° | 319.4 | 18.1 |
| 50°-60° | 289.5 | 16.4 |
| 60°-70° | 219.7 | 12.4 |
| 70°-80° | 120.2 | 6.8 |
| 80°-90° | 25.2 | 1.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 485.4 | 27.5 |
| 0°-40° | 793.1 | 44.9 |
| 0°-60° | 1402.0 | 79.3 |
| 0°-90° | 1767.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1767.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-----|------|
| 0° | 630 | |
| 5° | 628 | 60 |
| 15° | 602 | 170 |
| 25° | 556 | 256 |
| 35° | 492 | 308 |
| 45° | 414 | 319 |
| 55° | 324 | 289 |
| 65° | 222 | 220 |
| 75° | 114 | 120 |
| 85° | 19 | 25 |
| 90° | 0 | |



TEST NUMBER: P365453

CATALOG NUMBER: FLD6BX30D010-FEU6B35-8030-F6LBXVM1-MW-BL89BW

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|-------|
| 0° | 629.8 |
| 2.5° | 628.8 |
| 5° | 627.8 |
| 7.5° | 622.9 |
| 10° | 617.1 |
| 12.5° | 611.2 |
| 15° | 602.4 |
| 17.5° | 592.6 |
| 20° | 579.8 |
| 22.5° | 567.1 |
| 25° | 556.3 |
| 27.5° | 541.6 |
| 30° | 526.0 |
| 32.5° | 509.3 |
| 35° | 491.7 |
| 37.5° | 474.1 |
| 40° | 454.5 |
| 42.5° | 434.9 |
| 45° | 414.3 |
| 47.5° | 392.8 |
| 50° | 370.2 |
| 52.5° | 347.7 |
| 55° | 324.2 |
| 57.5° | 300.7 |
| 60° | 273.3 |
| 62.5° | 248.8 |
| 65° | 222.3 |
| 67.5° | 195.9 |
| 70° | 168.5 |
| 72.5° | 141.0 |
| 75° | 113.6 |
| 77.5° | 86.2 |
| 80° | 61.7 |
| 82.5° | 38.2 |
| 85° | 18.6 |
| 87.5° | 4.9 |
| 90° | 0.0 |

(END OF REPORT)