

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P365534

Luminaire Tested: **FLD6BX40D010-FEU6B35-8027-F6LBXVM1-MW-BTR89BV**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P365534
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1910-544-12)
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6BX40D010-FEU6B35-8027-F6LBXVM1-MW-BTR89BV
Description: VANDAL RESISTANT ENCLOSED BOTTOM TRIM RING, MATTE WHITE REFLECTOR,
BOTTOM TRIM ACRYLIC, CLEAR 0.125", 4000LM
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2468.0 lumens
Efficiency: N/A
Efficacy: 60.8 lumens/watt
Spacing Criteria (0/90/45): 0.87 / 0.87 / 0.84
Luminous Opening: Circular (Dia: 0.44' x H: 0')
CIE Type: Direct


Input Watts (W): 40.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P365534

CATALOG NUMBER: FLD6BX40D010-FEU6B35-8027-F6LBXVM1-MW-BTR89BV

Luminous Intensity Polar Plot

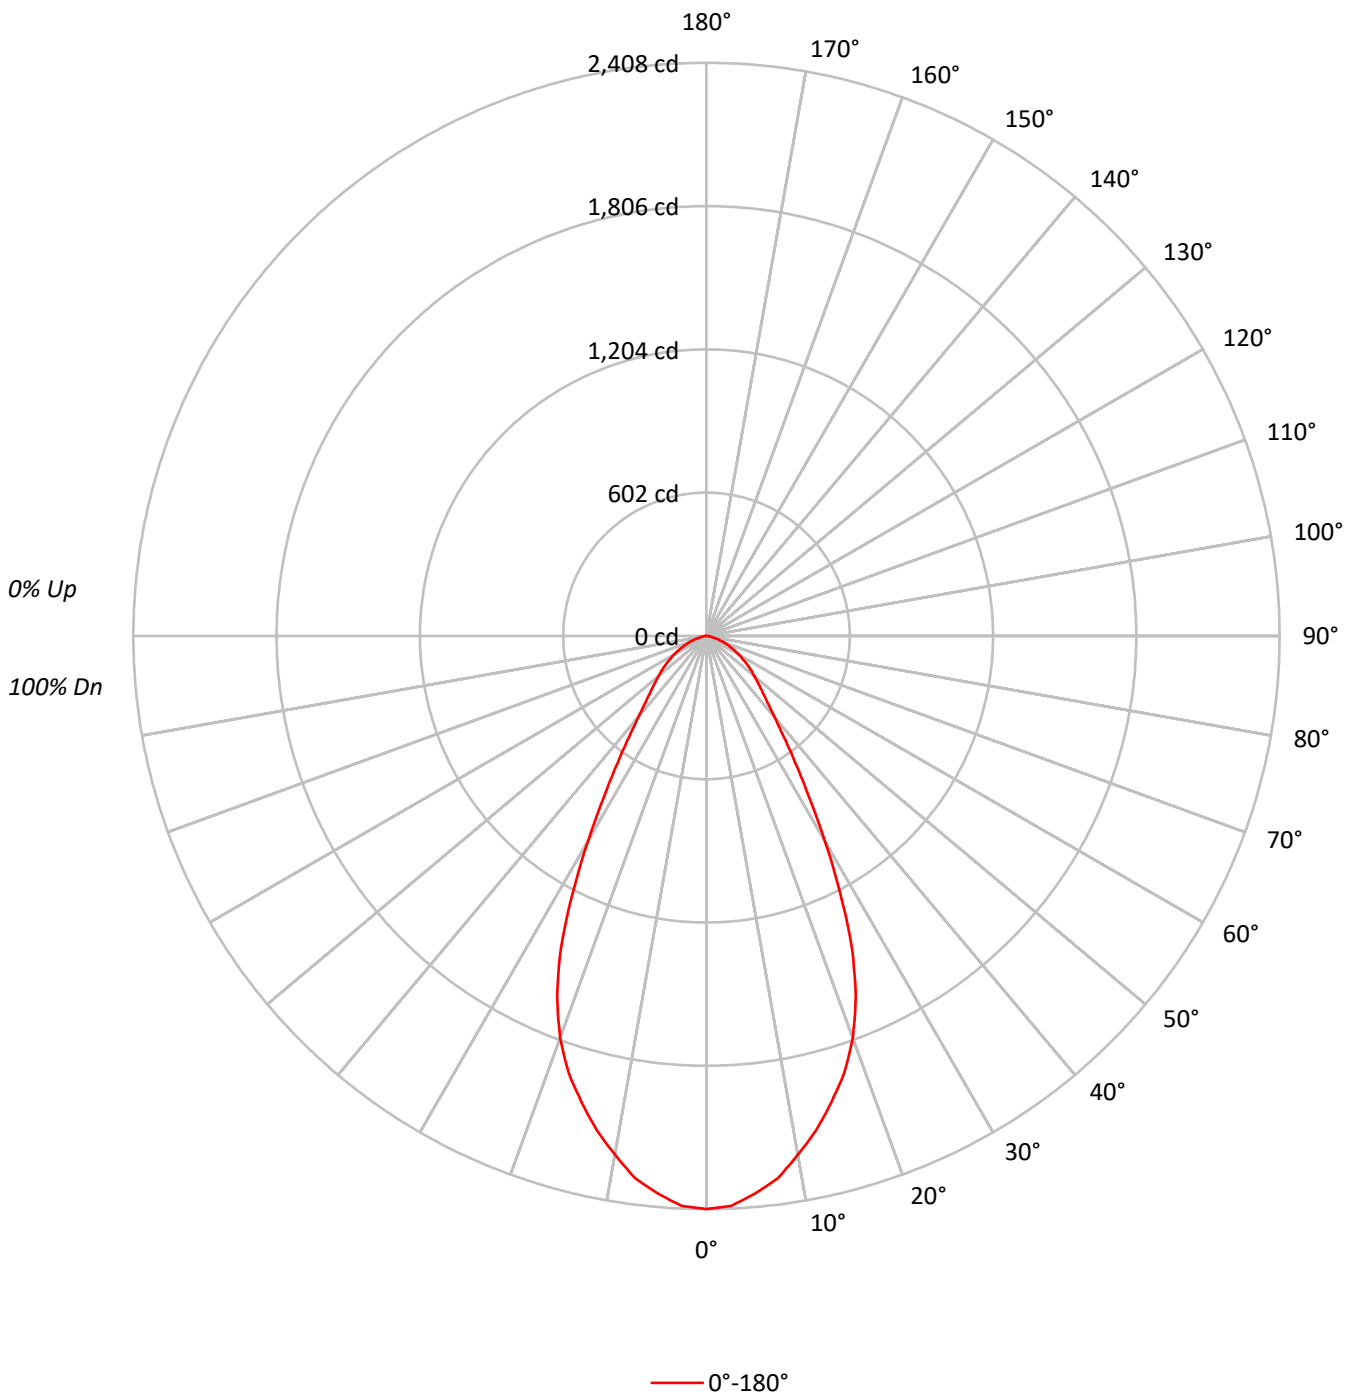



TEST NUMBER: P365534

CATALOG NUMBER: FLD6BX40D010-FEU6B35-8027-F6LBXVM1-MW-BTR89BV

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | | 50 | 30 | 10 | | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | | 106 | 106 | 106 | | 102 | 102 | 102 | 100 |
| 1 | 112 | 109 | 106 | 103 | 110 | 107 | 104 | 101 | 102 | 100 | 98 | | 99 | 97 | 95 | | 95 | 94 | 92 | 91 |
| 2 | 105 | 99 | 94 | 90 | 103 | 97 | 93 | 89 | 94 | 90 | 87 | | 91 | 88 | 85 | | 88 | 86 | 83 | 82 |
| 3 | 99 | 91 | 85 | 80 | 96 | 89 | 84 | 79 | 87 | 82 | 78 | | 84 | 80 | 77 | | 82 | 78 | 76 | 74 |
| 4 | 93 | 84 | 77 | 72 | 91 | 82 | 76 | 72 | 80 | 75 | 71 | | 78 | 74 | 70 | | 76 | 72 | 69 | 67 |
| 5 | 87 | 77 | 70 | 65 | 85 | 76 | 70 | 65 | 74 | 69 | 64 | | 73 | 68 | 64 | | 71 | 67 | 63 | 62 |
| 6 | 82 | 72 | 65 | 60 | 81 | 71 | 64 | 60 | 69 | 64 | 59 | | 68 | 63 | 59 | | 66 | 62 | 58 | 57 |
| 7 | 78 | 67 | 60 | 55 | 76 | 66 | 60 | 55 | 65 | 59 | 55 | | 64 | 58 | 54 | | 62 | 58 | 54 | 53 |
| 8 | 73 | 63 | 56 | 51 | 72 | 62 | 56 | 51 | 61 | 55 | 51 | | 60 | 54 | 51 | | 59 | 54 | 50 | 49 |
| 9 | 70 | 59 | 52 | 48 | 68 | 58 | 52 | 48 | 57 | 51 | 47 | | 56 | 51 | 47 | | 55 | 51 | 47 | 46 |
| 10 | 66 | 55 | 49 | 45 | 65 | 55 | 49 | 45 | 54 | 48 | 44 | | 53 | 48 | 44 | | 52 | 48 | 44 | 43 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 172424 |
| 5° | 169015 |
| 10° | 160914 |
| 15° | 150301 |
| 20° | 136941 |
| 25° | 114319 |
| 30° | 82183 |
| 35° | 56738 |
| 40° | 41472 |
| 45° | 33598 |
| 50° | 29330 |
| 55° | 25965 |
| 60° | 22626 |
| 65° | 19179 |
| 70° | 15429 |
| 75° | 10928 |
| 80° | 7587 |
| 85° | 8626 |



TEST NUMBER: P365534

CATALOG NUMBER: FLD6BX40D010-FEU6B35-8027-F6LBXVM1-MW-BTR89BV

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 220.4 | 8.9 |
| 10°-20° | 567.0 | 23.0 |
| 20°-30° | 648.1 | 26.3 |
| 30°-40° | 417.0 | 16.9 |
| 40°-50° | 261.3 | 10.6 |
| 50°-60° | 186.6 | 7.6 |
| 60°-70° | 113.2 | 4.6 |
| 70°-80° | 44.3 | 1.8 |
| 80°-90° | 10.0 | 0.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| <hr/> | | |
| 0°-30° | 1435.5 | 58.2 |
| 0°-40° | 1852.5 | 75.1 |
| 0°-60° | 2300.5 | 93.2 |
| 0°-90° | 2468.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 2468.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2408 | |
| 5° | 2352 | 220 |
| 15° | 2028 | 567 |
| 25° | 1447 | 648 |
| 35° | 649 | 417 |
| 45° | 332 | 261 |
| 55° | 208 | 187 |
| 65° | 113 | 113 |
| 75° | 40 | 44 |
| 85° | 10 | 10 |
| 90° | 0 | |



TEST NUMBER: P365534

CATALOG NUMBER: FLD6BX40D010-FEU6B35-8027-F6LBXVM1-MW-BTR89BV

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 2408.1 |
| 2.5° | 2396.2 |
| 5° | 2351.5 |
| 7.5° | 2297.5 |
| 10° | 2213.2 |
| 12.5° | 2127.6 |
| 15° | 2027.6 |
| 17.5° | 1924.9 |
| 20° | 1797.2 |
| 22.5° | 1639.2 |
| 25° | 1447.0 |
| 27.5° | 1215.2 |
| 30° | 994.0 |
| 32.5° | 799.2 |
| 35° | 649.1 |
| 37.5° | 530.6 |
| 40° | 443.7 |
| 42.5° | 379.2 |
| 45° | 331.8 |
| 47.5° | 294.9 |
| 50° | 263.3 |
| 52.5° | 235.7 |
| 55° | 208.0 |
| 57.5° | 181.7 |
| 60° | 158.0 |
| 62.5° | 135.6 |
| 65° | 113.2 |
| 67.5° | 93.5 |
| 70° | 73.7 |
| 72.5° | 55.3 |
| 75° | 39.5 |
| 77.5° | 27.6 |
| 80° | 18.4 |
| 82.5° | 11.8 |
| 85° | 10.5 |
| 87.5° | 5.3 |
| 90° | 0.0 |

(END OF REPORT)