

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P364995

Luminaire Tested: **FLD6BX60D010TE-FEU6B67-8027-F6LBXVM1-LI-BTR94**

Issue Date: 3/3/2020

Test Information

Test Method: LM-79-08
Report Number: P364995
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-1910-544-27)
Test Lab: INNOVATION CENTER
Issue Date: 3/3/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6BX60D010TE-FEU6B67-8027-F6LBXVM1-LI-BTR94
Description: VANDAL RESISTANT ENCLOSED BOTTOM TRIM RING, SPECULAR CLEAR REFLECTOR, BOTTOM TRIM GLASS, TEMPERED CLEAR 0.187", 6000LM
Light Source: -
Ballast/Driver: ELECTRONIC DRIVER

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4416.0 lumens
Efficiency: N/A
Efficacy: 76.0 lumens/watt
Spacing Criteria (0/90/45): 0.76 / 0.76 / 0.77
Luminous Opening: Circular (Dia: 0.44' x H: 0')
CIE Type: Direct


Input Watts (W): 58.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P364995

CATALOG NUMBER: FLD6BX60D010TE-FEU6B67-8027-F6LBXVM1-LI-BTR94

Luminous Intensity Polar Plot

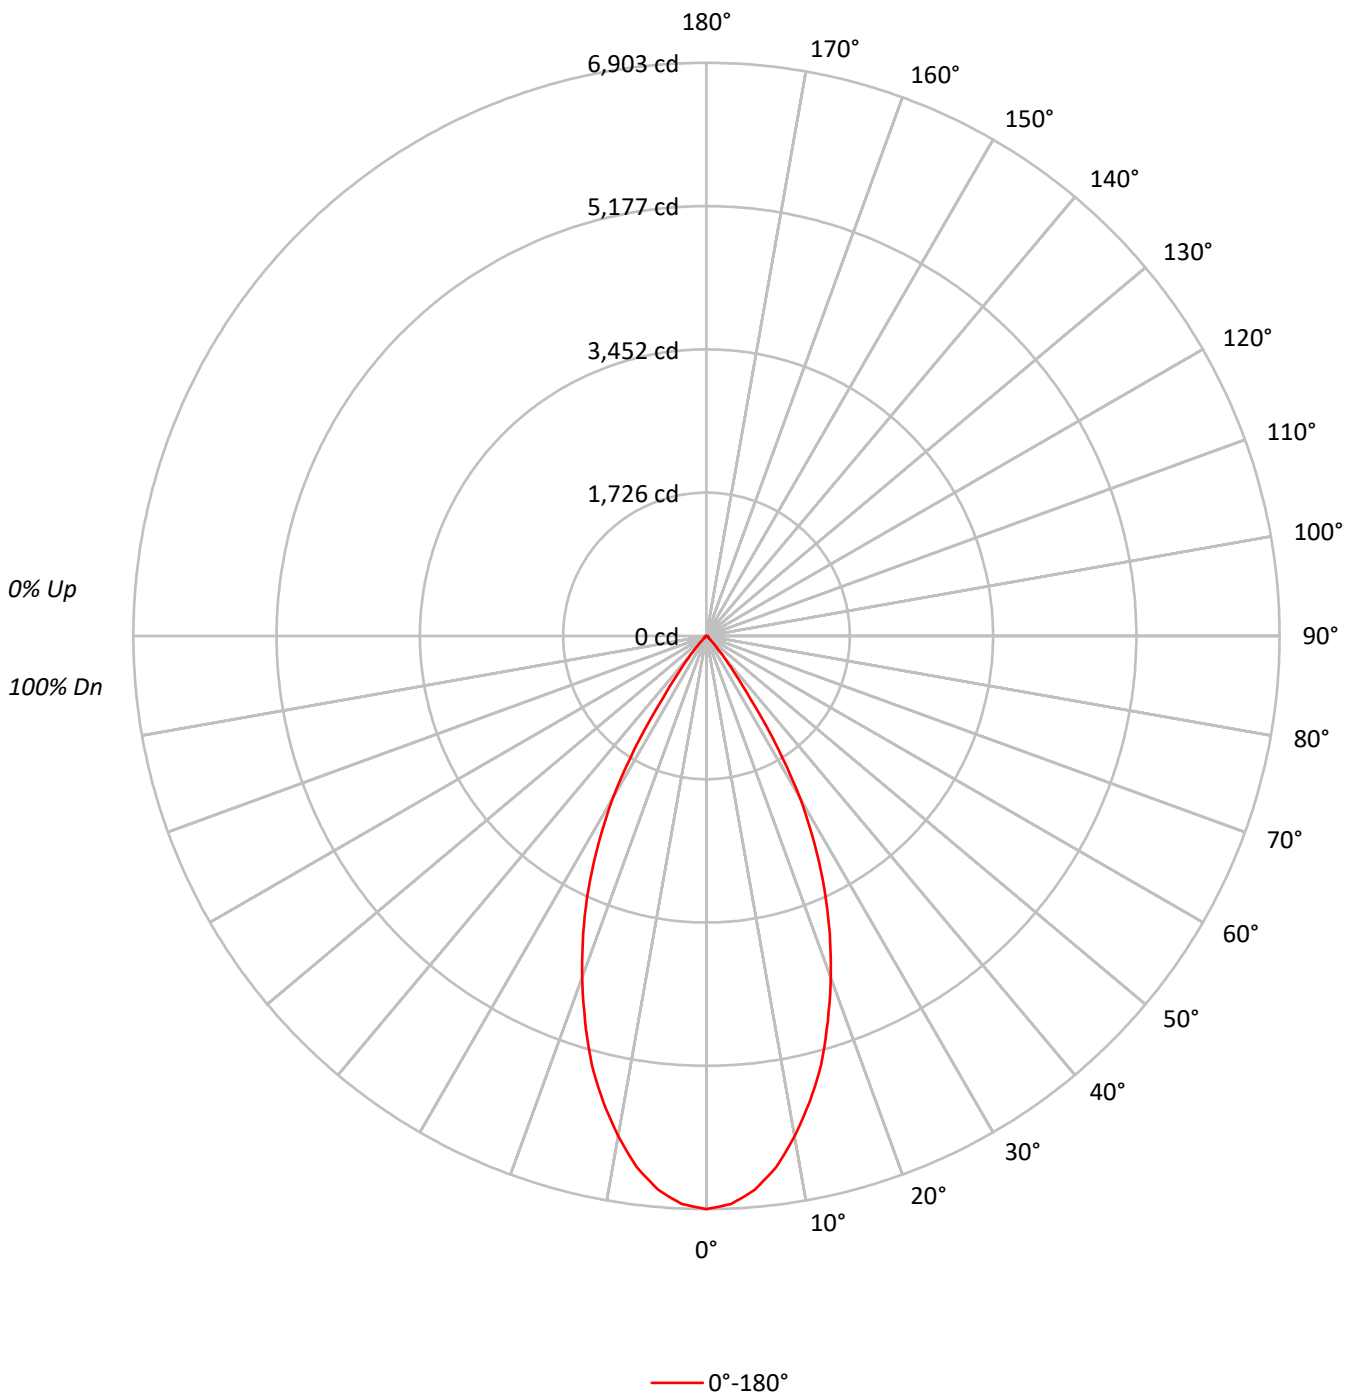



TEST NUMBER: P364995

CATALOG NUMBER: FLD6BX60D010TE-FEU6B67-8027-F6LBXVM1-LI-BTR94

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | | 50 | 30 | 10 | | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | | 106 | 106 | 106 | | 102 | 102 | 102 | 100 |
| 1 | 114 | 111 | 109 | 107 | 111 | 109 | 107 | 105 | 105 | 103 | 102 | | 101 | 100 | 99 | | 98 | 97 | 96 | 94 |
| 2 | 109 | 104 | 100 | 97 | 107 | 102 | 99 | 96 | 99 | 96 | 94 | | 96 | 94 | 92 | | 94 | 92 | 90 | 88 |
| 3 | 104 | 98 | 93 | 90 | 102 | 96 | 92 | 89 | 94 | 90 | 87 | | 92 | 89 | 86 | | 89 | 87 | 85 | 83 |
| 4 | 99 | 92 | 87 | 83 | 97 | 91 | 86 | 83 | 89 | 85 | 82 | | 87 | 84 | 81 | | 85 | 82 | 80 | 78 |
| 5 | 95 | 87 | 82 | 78 | 93 | 86 | 81 | 77 | 84 | 80 | 77 | | 83 | 79 | 76 | | 81 | 78 | 75 | 74 |
| 6 | 91 | 82 | 77 | 73 | 89 | 82 | 76 | 73 | 80 | 76 | 72 | | 79 | 75 | 72 | | 77 | 74 | 71 | 70 |
| 7 | 87 | 78 | 73 | 69 | 85 | 77 | 72 | 68 | 76 | 72 | 68 | | 75 | 71 | 68 | | 74 | 70 | 67 | 66 |
| 8 | 83 | 74 | 69 | 65 | 82 | 74 | 68 | 65 | 73 | 68 | 64 | | 72 | 67 | 64 | | 71 | 67 | 64 | 63 |
| 9 | 79 | 71 | 65 | 61 | 78 | 70 | 65 | 61 | 69 | 64 | 61 | | 68 | 64 | 61 | | 67 | 64 | 61 | 59 |
| 10 | 76 | 67 | 62 | 58 | 75 | 67 | 62 | 58 | 66 | 61 | 58 | | 65 | 61 | 58 | | 65 | 61 | 58 | 57 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 494289 |
| 5° | 481206 |
| 10° | 444803 |
| 15° | 395975 |
| 20° | 333492 |
| 25° | 265745 |
| 30° | 186143 |
| 35° | 78852 |
| 40° | 27508 |
| 45° | 7544 |
| 50° | 3832 |
| 55° | 3583 |
| 60° | 3551 |
| 65° | 3236 |
| 70° | 3203 |
| 75° | 4233 |
| 80° | 5525 |
| 85° | 7887 |



TEST NUMBER: P364995

CATALOG NUMBER: FLD6BX60D010TE-FEU6B67-8027-F6LBXVM1-LI-BTR94

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 620.7 | 14.1 |
| 10°-20° | 1476.8 | 33.4 |
| 20°-30° | 1519.1 | 34.4 |
| 30°-40° | 648.8 | 14.7 |
| 40°-50° | 81.0 | 1.8 |
| 50°-60° | 25.9 | 0.6 |
| 60°-70° | 19.1 | 0.4 |
| 70°-80° | 15.4 | 0.3 |
| 80°-90° | 9.1 | 0.2 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 3616.7 | 81.9 |
| 0°-40° | 4265.5 | 96.6 |
| 0°-60° | 4372.3 | 99.0 |
| 0°-90° | 4416.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 4416.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 6903 | |
| 5° | 6695 | 621 |
| 15° | 5342 | 1477 |
| 25° | 3364 | 1519 |
| 35° | 902 | 649 |
| 45° | 74 | 81 |
| 55° | 29 | 26 |
| 65° | 19 | 19 |
| 75° | 15 | 15 |
| 85° | 10 | 9 |
| 90° | 0 | |



TEST NUMBER: P364995

CATALOG NUMBER: FLD6BX60D010TE-FEU6B67-8027-F6LBXVM1-LI-BTR94

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 6903.3 |
| 2.5° | 6847.8 |
| 5° | 6695.0 |
| 7.5° | 6450.3 |
| 10° | 6117.8 |
| 12.5° | 5747.0 |
| 15° | 5341.8 |
| 17.5° | 4860.2 |
| 20° | 4376.7 |
| 22.5° | 3879.7 |
| 25° | 3363.7 |
| 27.5° | 2819.0 |
| 30° | 2251.4 |
| 32.5° | 1599.7 |
| 35° | 902.1 |
| 37.5° | 516.0 |
| 40° | 294.3 |
| 42.5° | 152.9 |
| 45° | 74.5 |
| 47.5° | 40.1 |
| 50° | 34.4 |
| 52.5° | 30.6 |
| 55° | 28.7 |
| 57.5° | 26.8 |
| 60° | 24.8 |
| 62.5° | 21.0 |
| 65° | 19.1 |
| 67.5° | 17.2 |
| 70° | 15.3 |
| 72.5° | 15.3 |
| 75° | 15.3 |
| 77.5° | 13.4 |
| 80° | 13.4 |
| 82.5° | 11.5 |
| 85° | 9.6 |
| 87.5° | 5.7 |
| 90° | 0.0 |

(END OF REPORT)