

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P574918

Luminaire Tested: **FLD6C-10-D010 FEU6C-X-90-40 F6X-N-X-LI**

Issue Date: 3/1/2023



**Test Information**

Test Method: LM-79-08  
Report Number: P574918  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/1/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: FLD6C-10-D010 FEU6C-X-90-40 F6X-N-X-LI  
Description: 6 INCH FAIL-SAFE LED DOWNLIGHT WITH 4000K, 90 CRI LEDS, 6LBNLI TRIM

Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 832.0 lumens  
Efficiency: N/A  
Efficacy: 85.3 lumens/watt  
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.57  
Luminous Opening: Circular (Dia: 0.5' x H: 0')  
CIE Type: Direct

Input Watts (W): 9.75  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P574918

CATALOG NUMBER: FLD6C-10-D010 FEU6C-X-90-40 F6X-N-X-LI

### Luminous Intensity Polar Plot

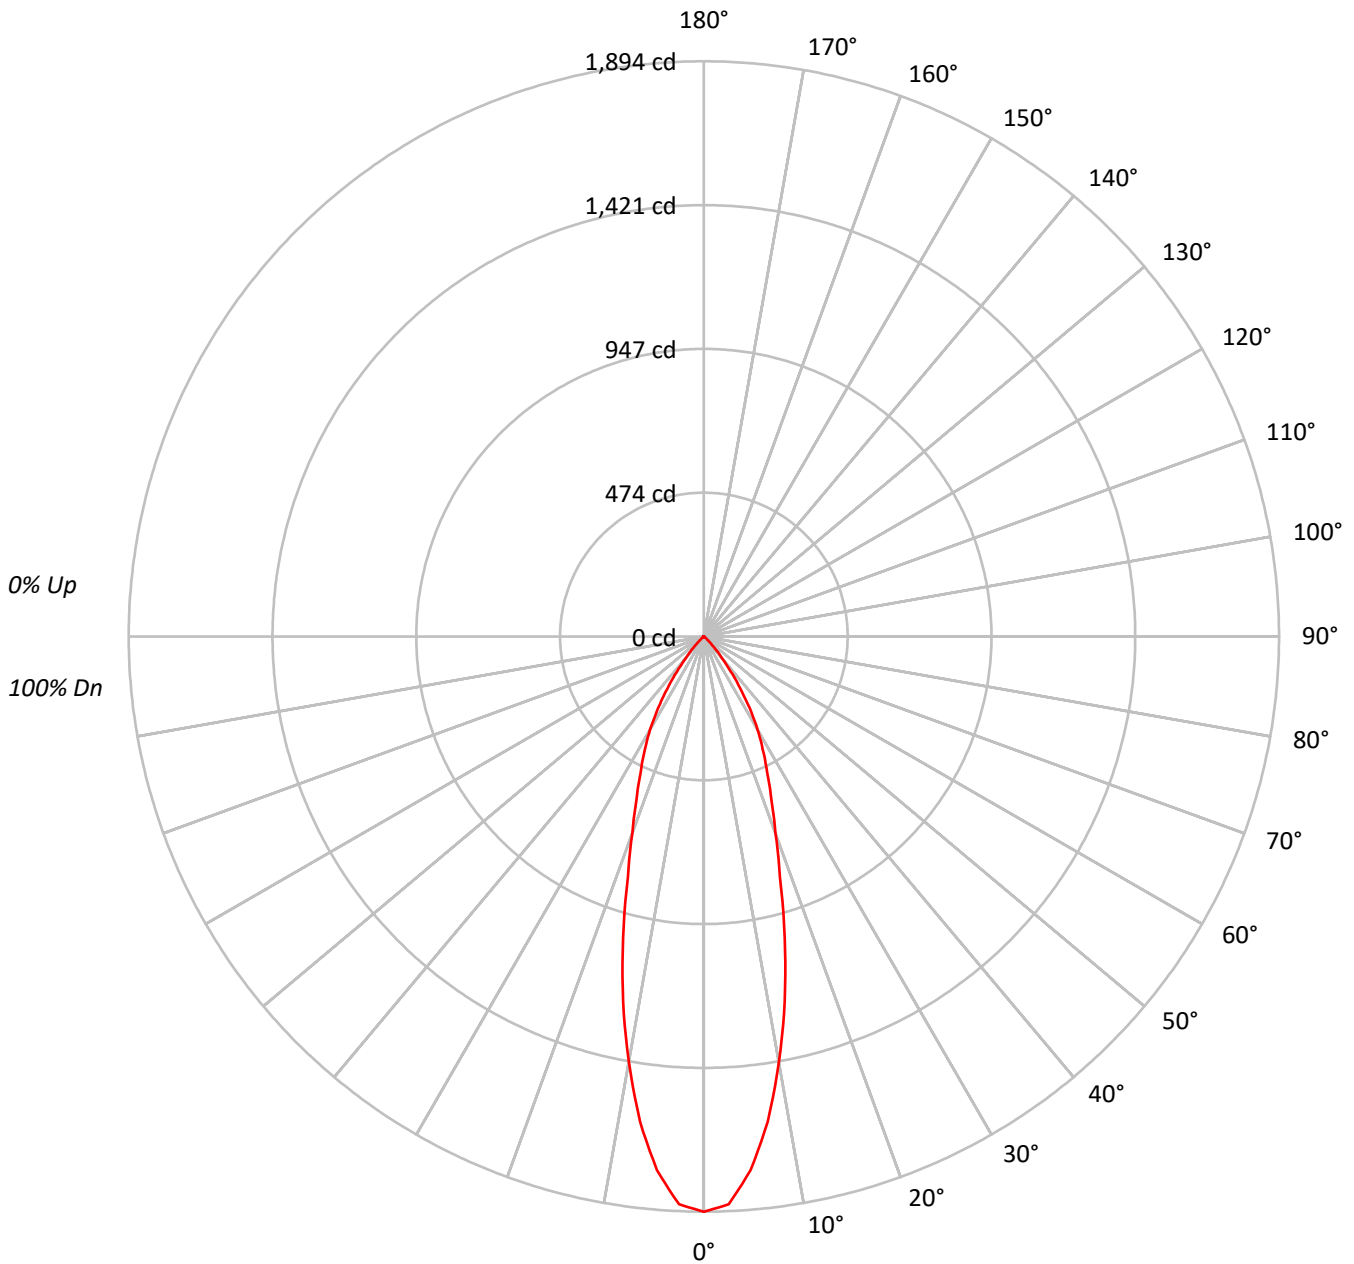



TEST NUMBER: P574918

CATALOG NUMBER: FLD6C-10-D010 FEU6C-X-90-40 F6X-N-X-LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	95			
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	89			
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	85			
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	80			
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	76			
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	72			
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	68			
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	65			
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	62			
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	59			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	103846
5°	97111
10°	79201
15°	58281
20°	40172
25°	29826
30°	22402
35°	13967
40°	6784
45°	2326
50°	307
55°	229
60°	132
65°	156
70°	192
75°	0
80°	0
85°	0



TEST NUMBER: P574918

CATALOG NUMBER: FLD6C-10-D010 FEU6C-X-90-40 F6X-N-X-LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	157.5	18.9
10°-20°	282.7	34.0
20°-30°	228.6	27.5
30°-40°	131.7	15.8
40°-50°	27.8	3.3
50°-60°	2.4	0.3
60°-70°	1.2	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	668.7	80.4
0°-40°	800.4	96.2
0°-60°	830.7	99.8
0°-90°	832.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	832.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1894	
5°	1765	157
15°	1027	283
25°	493	229
35°	209	132
45°	30	28
55°	2	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P574918

CATALOG NUMBER: FLD6C-10-D010 FEU6C-X-90-40 F6X-N-X-LI

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1894.3
2.5°	1871.5
5°	1764.7
7.5°	1611.2
10°	1422.8
12.5°	1229.7
15°	1026.9
17.5°	831.4
20°	688.6
22.5°	579.4
25°	493.1
27.5°	419.9
30°	353.9
32.5°	280.7
35°	208.7
37.5°	145.2
40°	94.8
42.5°	57.6
45°	30.0
47.5°	12.0
50°	3.6
52.5°	3.6
55°	2.4
57.5°	2.4
60°	1.2
62.5°	1.2
65°	1.2
67.5°	1.2
70°	1.2
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-MV3F9LC







— 0°-180°







(END OF REPORT)