

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P576818

Luminaire Tested: **FLD6C-35-D010 FEU6C-X-90-27 F6X-M-X-LI**

Issue Date: 3/1/2023



Test Information

Test Method: LM-79-08
Report Number: P576818
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/1/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6C-35-D010 FEU6C-X-90-27 F6X-M-X-LI
Description: 6 INCH FAIL-SAFE LED DOWNLIGHT WITH 2700K, 90 CRI LEDS, 6LBMLI TRIM

Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3050.0 lumens
Efficiency: N/A
Efficacy: 75.5 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P576818

CATALOG NUMBER: FLD6C-35-D010 FEU6C-X-90-27 F6X-M-X-LI

Luminous Intensity Polar Plot

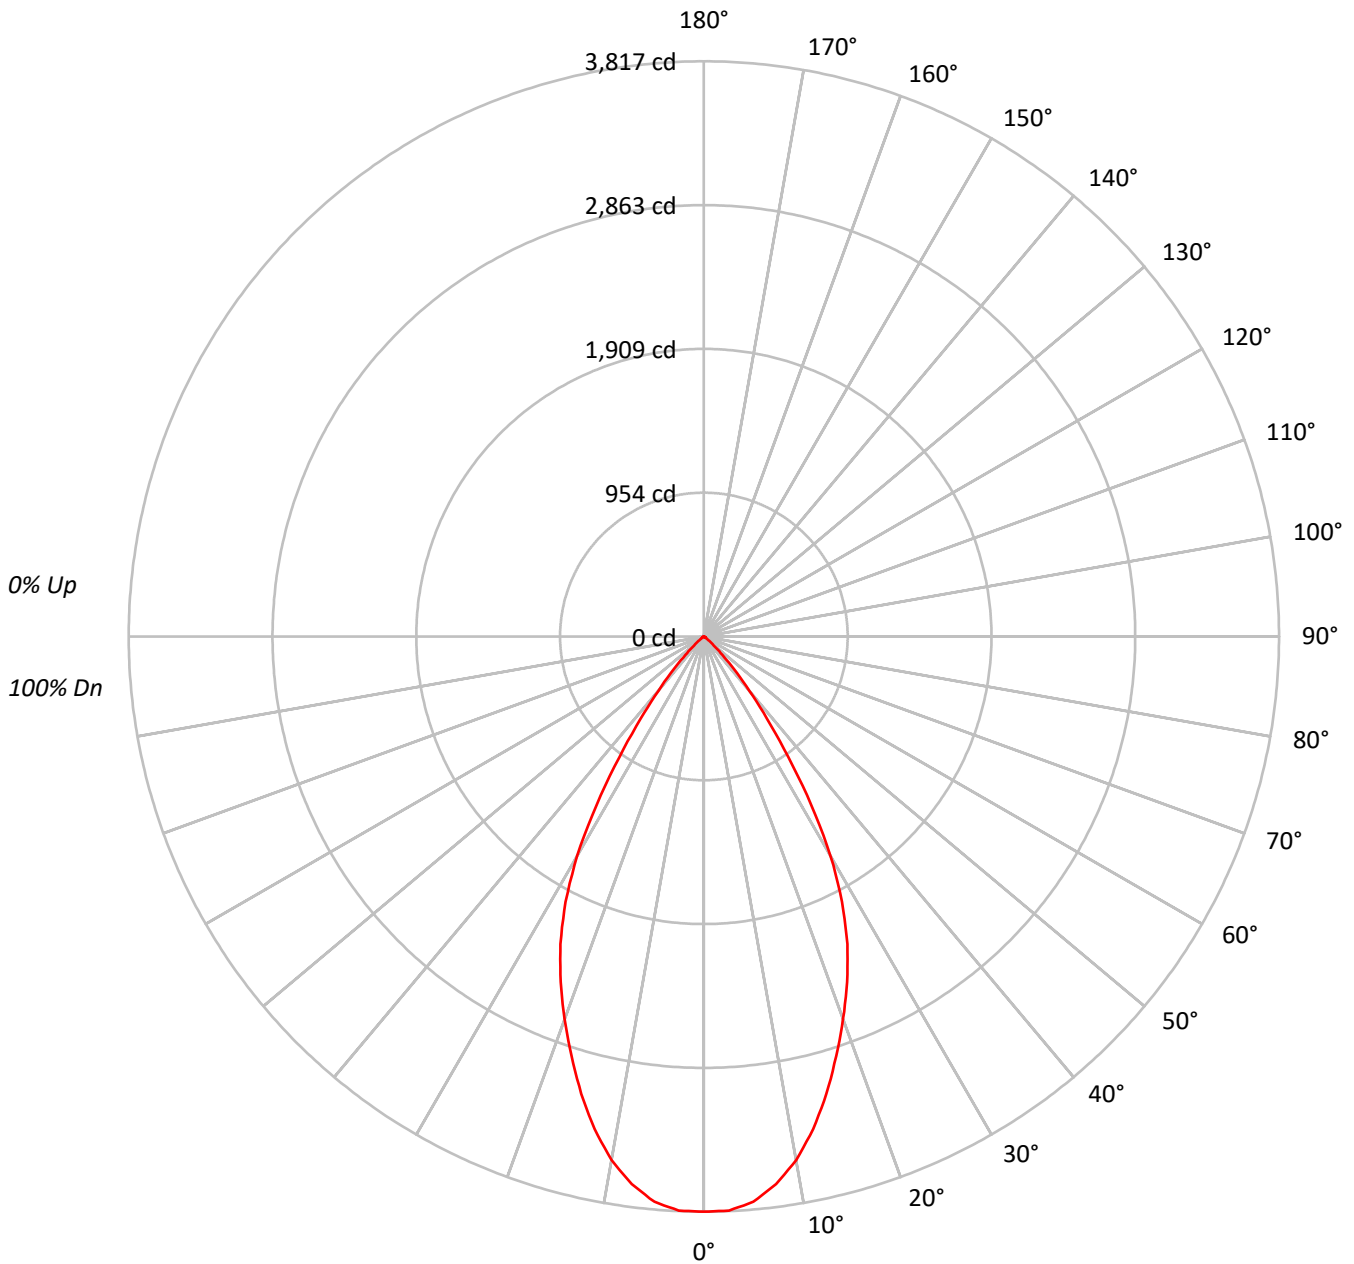



TEST NUMBER: P576818

CATALOG NUMBER: FLD6C-35-D010 FEU6C-X-90-27 F6X-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94																			
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88																			
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82																			
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76																			
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71																			
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67																			
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63																			
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59																			
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55																			
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	209243
5°	207252
10°	196395
15°	178304
20°	157560
25°	136218
30°	106478
35°	65297
40°	33513
45°	13311
50°	4324
55°	1491
60°	1283
65°	1025
70°	625
75°	826
80°	0
85°	0



TEST NUMBER: P576818

CATALOG NUMBER: FLD6C-35-D010 FEU6C-X-90-27 F6X-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	351.6	11.5
10°-20°	875.4	28.7
20°-30°	1017.6	33.4
30°-40°	623.2	20.4
40°-50°	154.7	5.1
50°-60°	18.1	0.6
60°-70°	6.8	0.2
70°-80°	2.6	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2244.7	73.6
0°-40°	2867.8	94.0
0°-60°	3040.7	99.7
0°-90°	3050.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3050.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3817	
5°	3766	352
15°	3142	875
25°	2252	1018
35°	976	623
45°	172	155
55°	16	18
65°	8	7
75°	4	3
85°	0	0
90°	0	



TEST NUMBER: P576818

CATALOG NUMBER: FLD6C-35-D010 FEU6C-X-90-27 F6X-M-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	3816.9
2.5°	3813.0
5°	3766.2
7.5°	3664.7
10°	3528.1
12.5°	3348.6
15°	3141.7
17.5°	2919.3
20°	2700.8
22.5°	2482.1
25°	2252.0
27.5°	1986.5
30°	1682.1
32.5°	1326.9
35°	975.7
37.5°	686.9
40°	468.3
42.5°	292.7
45°	171.7
47.5°	97.6
50°	50.7
52.5°	23.5
55°	15.6
57.5°	11.7
60°	11.7
62.5°	7.9
65°	7.9
67.5°	3.9
70°	3.9
72.5°	3.9
75°	3.9
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)