

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P578018

Luminaire Tested: **FLD6C-55-D010 FEU6C-X-90-27 F6X-M-X-LI**

Issue Date: 3/1/2023



Test Information

Test Method: LM-79-08
Report Number: P578018
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/1/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6C-55-D010 FEU6C-X-90-27 F6X-M-X-LI
Description: 6 INCH FAIL-SAFE LED DOWNLIGHT WITH 2700K, 90 CRI LEDS, 6LBMLI TRIM

Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5189.0 lumens
Efficiency: N/A
Efficacy: 81.2 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 63.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P578018

CATALOG NUMBER: FLD6C-55-D010 FEU6C-X-90-27 F6X-M-X-LI

Luminous Intensity Polar Plot

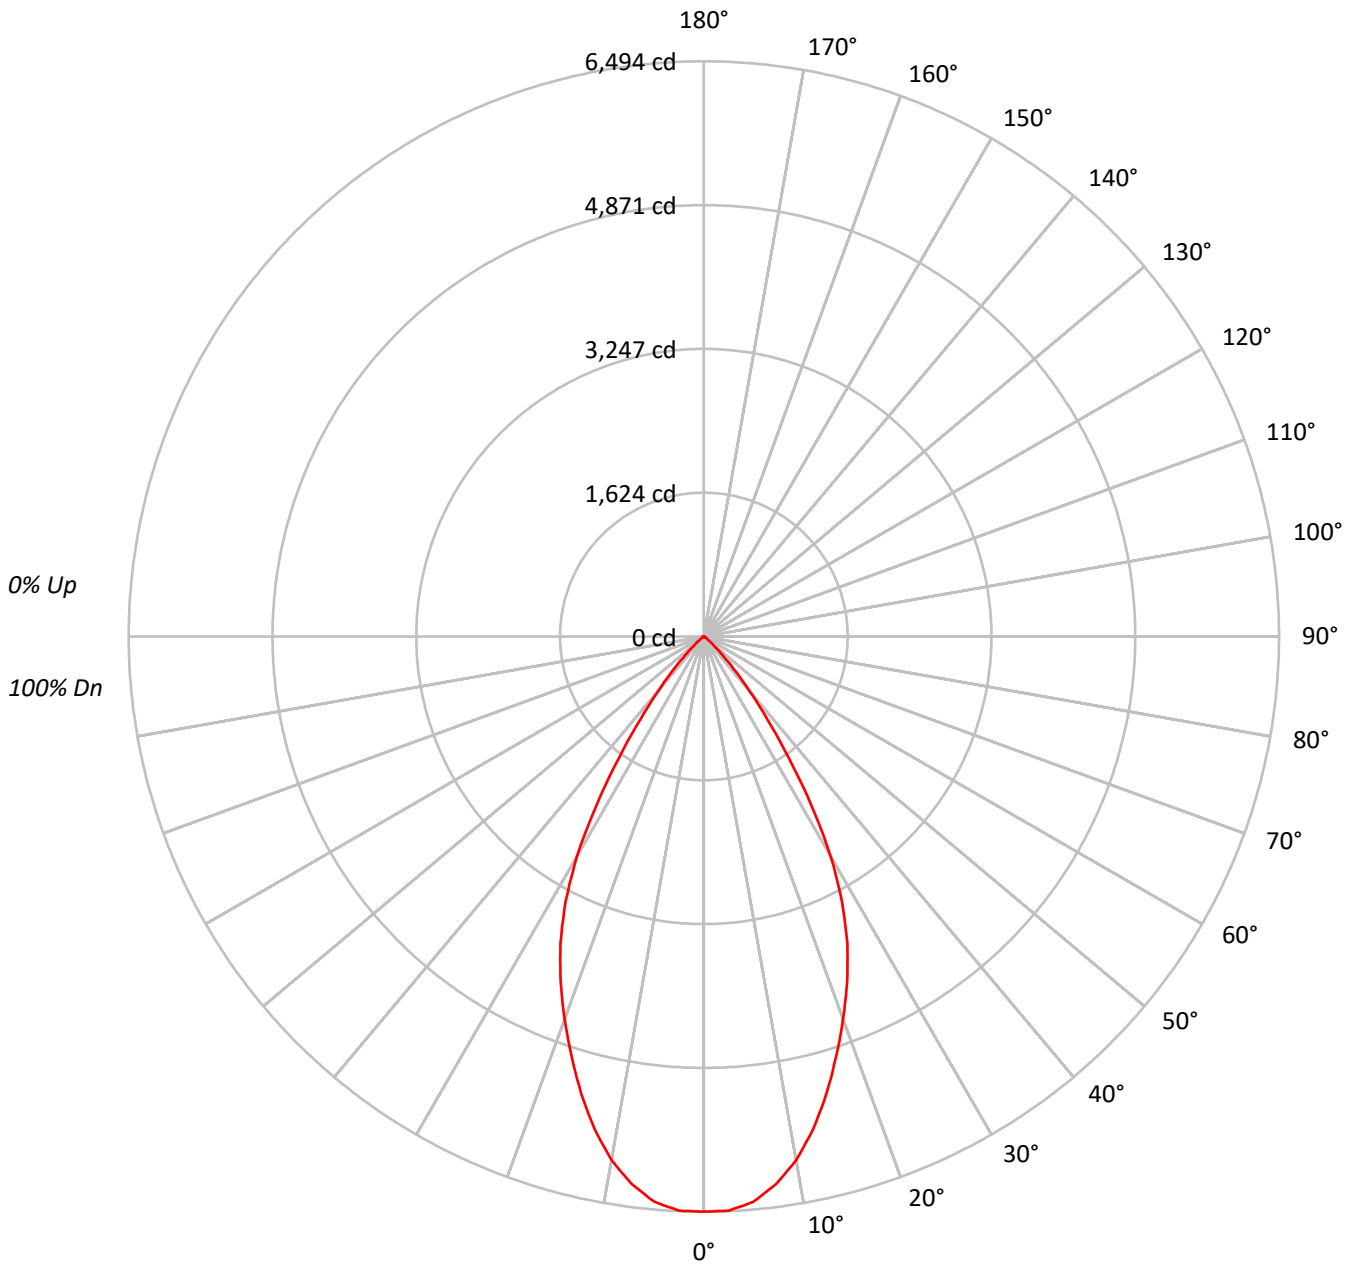



TEST NUMBER: P578018

CATALOG NUMBER: FLD6C-55-D010 FEU6C-X-90-27 F6X-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 114 | 111 | 109 | 106 | 111 | 109 | 107 | 105 | 105 | 103 | 101 | 101 | 100 | 98 | 98 | 97 | 96 | 94 | | | |
| 2 | 108 | 103 | 100 | 96 | 106 | 102 | 98 | 95 | 99 | 96 | 93 | 96 | 93 | 91 | 93 | 91 | 89 | 88 | | | |
| 3 | 103 | 97 | 92 | 88 | 101 | 95 | 91 | 87 | 93 | 89 | 86 | 90 | 87 | 85 | 88 | 85 | 83 | 82 | | | |
| 4 | 98 | 91 | 85 | 81 | 96 | 89 | 84 | 81 | 87 | 83 | 80 | 85 | 82 | 79 | 83 | 80 | 78 | 76 | | | |
| 5 | 93 | 85 | 79 | 75 | 91 | 84 | 79 | 75 | 82 | 78 | 74 | 81 | 77 | 73 | 79 | 76 | 73 | 71 | | | |
| 6 | 89 | 80 | 74 | 70 | 87 | 79 | 74 | 70 | 78 | 73 | 69 | 76 | 72 | 69 | 75 | 71 | 68 | 67 | | | |
| 7 | 84 | 75 | 69 | 65 | 83 | 75 | 69 | 65 | 73 | 68 | 65 | 72 | 68 | 64 | 71 | 67 | 64 | 63 | | | |
| 8 | 80 | 71 | 65 | 61 | 79 | 70 | 65 | 61 | 69 | 64 | 61 | 68 | 64 | 60 | 67 | 63 | 60 | 59 | | | |
| 9 | 77 | 67 | 61 | 57 | 75 | 67 | 61 | 57 | 66 | 61 | 57 | 65 | 60 | 57 | 64 | 60 | 57 | 55 | | | |
| 10 | 73 | 64 | 58 | 54 | 72 | 63 | 58 | 54 | 62 | 57 | 54 | 62 | 57 | 54 | 61 | 57 | 54 | 52 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° |
|-----|--------|
| 0° | 355991 |
| 5° | 352602 |
| 10° | 334123 |
| 15° | 303356 |
| 20° | 268059 |
| 25° | 231745 |
| 30° | 181154 |
| 35° | 111092 |
| 40° | 57021 |
| 45° | 22654 |
| 50° | 7352 |
| 55° | 2533 |
| 60° | 2171 |
| 65° | 1738 |
| 70° | 1074 |
| 75° | 1419 |
| 80° | 0 |
| 85° | 0 |



TEST NUMBER: P578018

CATALOG NUMBER: FLD6C-55-D010 FEU6C-X-90-27 F6X-M-X-LI

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 598.2 | 11.5 |
| 10°-20° | 1489.4 | 28.7 |
| 20°-30° | 1731.3 | 33.4 |
| 30°-40° | 1060.2 | 20.4 |
| 40°-50° | 263.3 | 5.1 |
| 50°-60° | 30.7 | 0.6 |
| 60°-70° | 11.5 | 0.2 |
| 70°-80° | 4.4 | 0.1 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 3818.9 | 73.6 |
| 0°-40° | 4879.1 | 94.0 |
| 0°-60° | 5173.1 | 99.7 |
| 0°-90° | 5189.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5189.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 6494 | |
| 5° | 6408 | 598 |
| 15° | 5345 | 1489 |
| 25° | 3831 | 1731 |
| 35° | 1660 | 1060 |
| 45° | 292 | 263 |
| 55° | 26 | 31 |
| 65° | 13 | 12 |
| 75° | 7 | 4 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P578018

CATALOG NUMBER: FLD6C-55-D010 FEU6C-X-90-27 F6X-M-X-LI

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 6493.8 |
| 2.5° | 6487.1 |
| 5° | 6407.5 |
| 7.5° | 6234.8 |
| 10° | 6002.3 |
| 12.5° | 5697.0 |
| 15° | 5345.1 |
| 17.5° | 4966.6 |
| 20° | 4594.9 |
| 22.5° | 4222.9 |
| 25° | 3831.3 |
| 27.5° | 3379.7 |
| 30° | 2861.8 |
| 32.5° | 2257.5 |
| 35° | 1660.0 |
| 37.5° | 1168.5 |
| 40° | 796.8 |
| 42.5° | 497.9 |
| 45° | 292.2 |
| 47.5° | 166.0 |
| 50° | 86.2 |
| 52.5° | 39.9 |
| 55° | 26.5 |
| 57.5° | 19.8 |
| 60° | 19.8 |
| 62.5° | 13.4 |
| 65° | 13.4 |
| 67.5° | 6.7 |
| 70° | 6.7 |
| 72.5° | 6.7 |
| 75° | 6.7 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)