

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P578938

Luminaire Tested: **FLD6C-70-D010 FEU6C-X-90-27 F6X-N-X-LI**

Issue Date: 3/1/2023



Test Information

Test Method: LM-79-08
Report Number: P578938
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/1/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6C-70-D010 FEU6C-X-90-27 F6X-N-X-LI
Description: 6 INCH FAIL-SAFE LED DOWNLIGHT WITH 2700K, 90 CRI LEDS, 6LBNLI TRIM

Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5477.0 lumens
Efficiency: N/A
Efficacy: 70.2 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 78
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P578938

CATALOG NUMBER: FLD6C-70-D010 FEU6C-X-90-27 F6X-N-X-LI

Luminous Intensity Polar Plot

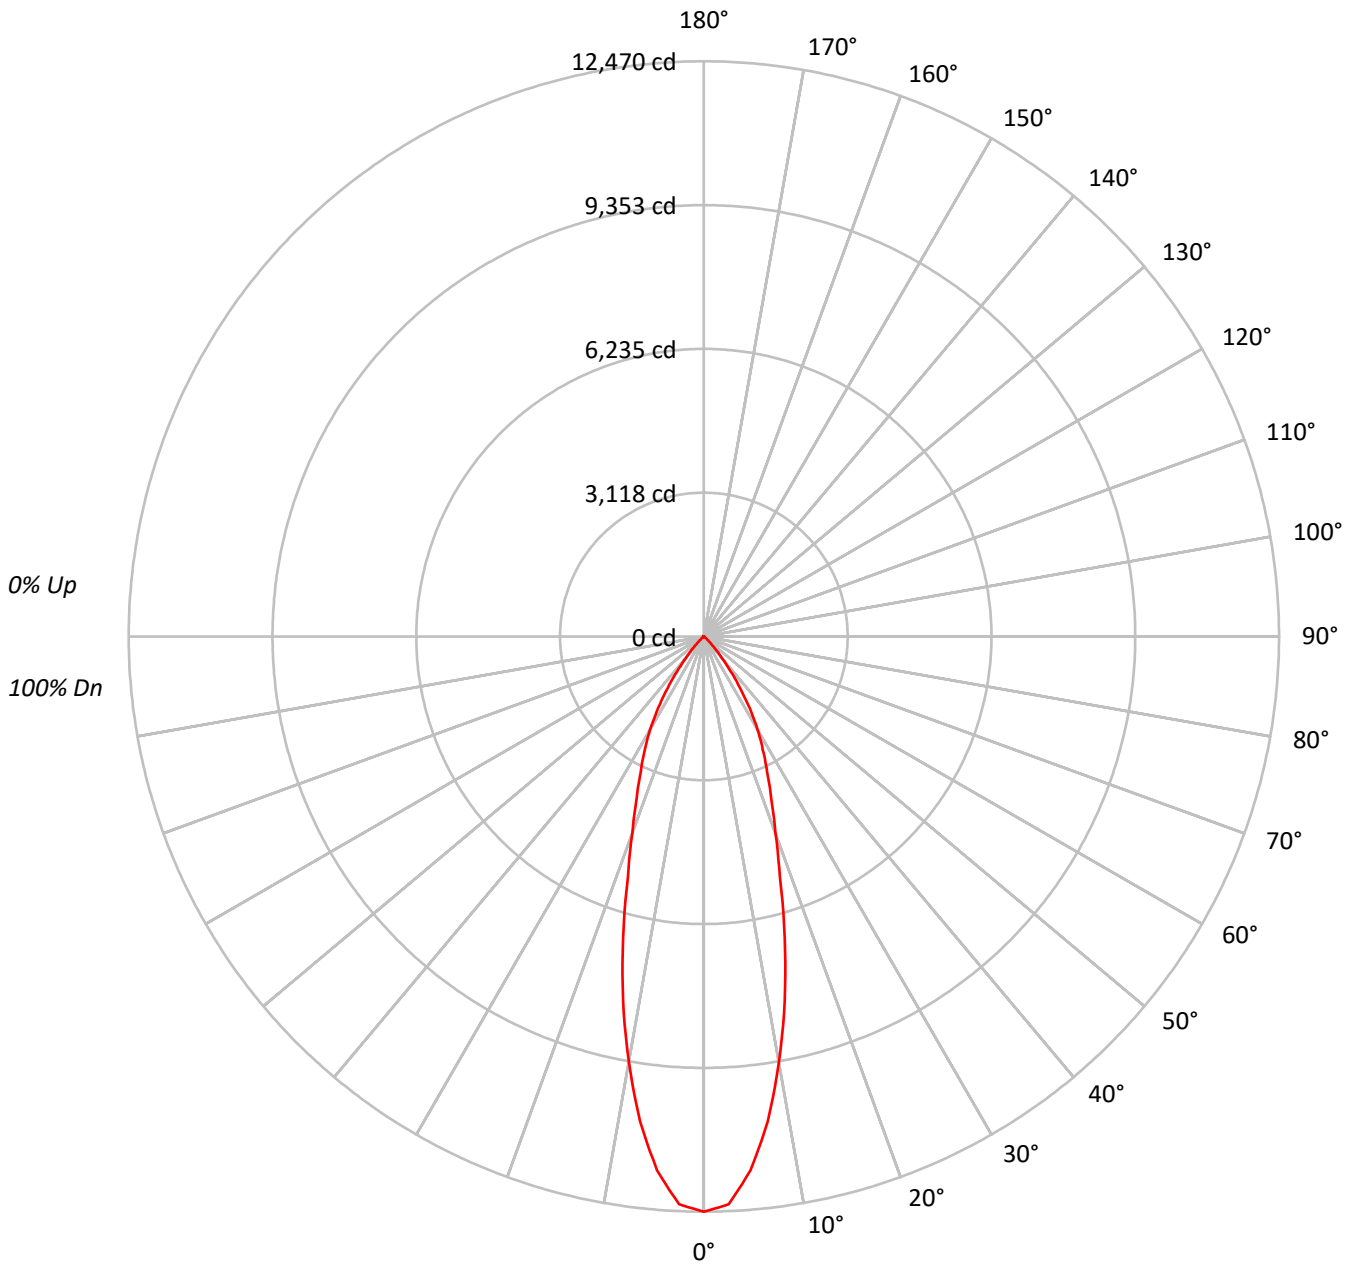



TEST NUMBER: P578938

CATALOG NUMBER: FLD6C-70-D010 FEU6C-X-90-27 F6X-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	95																			
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	89																			
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	85																			
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	80																			
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	76																			
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	72																			
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	68																			
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	65																			
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	62																			
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	59																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	683597
5°	639279
10°	521383
15°	383668
20°	264448
25°	196324
30°	147472
35°	91959
40°	44641
45°	15312
50°	2013
55°	1520
60°	866
65°	1025
70°	1266
75°	0
80°	0
85°	0



TEST NUMBER: P578938

CATALOG NUMBER: FLD6C-70-D010 FEU6C-X-90-27 F6X-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1036.8	18.9
10°-20°	1860.9	34.0
20°-30°	1504.6	27.5
30°-40°	866.7	15.8
40°-50°	183.2	3.3
50°-60°	15.8	0.3
60°-70°	7.8	0.1
70°-80°	1.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4402.3	80.4
0°-40°	5269.0	96.2
0°-60°	5468.1	99.8
0°-90°	5477.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5477.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	12470	
5°	11617	###
15°	6760	1861
25°	3246	1505
35°	1374	867
45°	198	183
55°	16	16
65°	8	8
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P578938

CATALOG NUMBER: FLD6C-70-D010 FEU6C-X-90-27 F6X-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	12469.8
2.5°	12320.0
5°	11617.0
7.5°	10606.2
10°	9366.3
12.5°	8094.9
15°	6760.2
17.5°	5472.9
20°	4533.0
22.5°	3814.5
25°	3245.7
27.5°	2764.1
30°	2329.7
32.5°	1848.1
35°	1374.1
37.5°	955.5
40°	623.8
42.5°	379.1
45°	197.5
47.5°	78.9
50°	23.6
52.5°	23.6
55°	15.9
57.5°	15.9
60°	7.9
62.5°	7.9
65°	7.9
67.5°	7.9
70°	7.9
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)