

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P579768

Luminaire Tested: **FLD6C-80-D010 FEU6C-X-90-50 F6X-N-X-H**

Issue Date: 3/1/2023



Test Information

Test Method: LM-79-08
Report Number: P579768
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P203666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 3/1/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLD6C-80-D010 FEU6C-X-90-50 F6X-N-X-H
Description: 6 INCH FAIL-SAFE LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 6LBNH TRIM

Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5928.0 lumens
Efficiency: N/A
Efficacy: 66.2 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.84
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 89.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P579768

CATALOG NUMBER: FLD6C-80-D010 FEU6C-X-90-50 F6X-N-X-H

Luminous Intensity Polar Plot

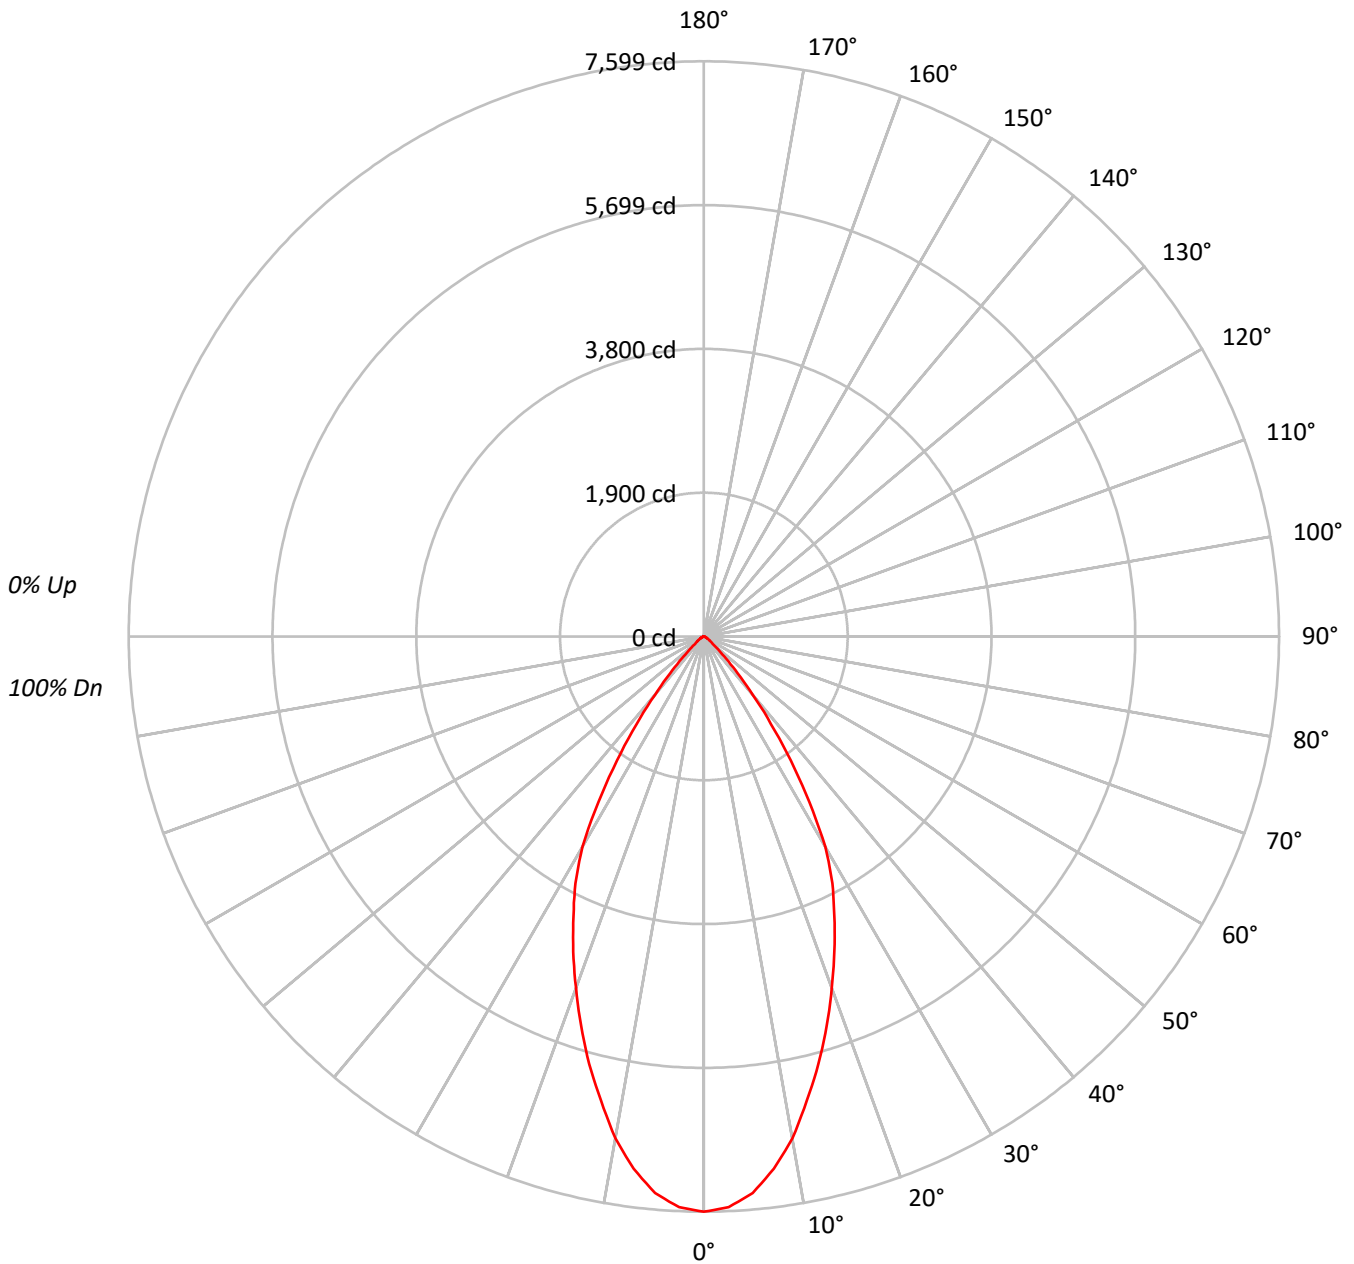



TEST NUMBER: P579768

CATALOG NUMBER: FLD6C-80-D010 FEU6C-X-90-50 F6X-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | |
| 1 | 113 | 111 | 108 | 106 | 111 | 109 | 106 | 104 | 104 | 103 | 101 | 101 | 99 | 98 | 97 | 96 | 95 | 93 | | | |
| 2 | 108 | 103 | 99 | 96 | 106 | 101 | 98 | 94 | 98 | 95 | 92 | 95 | 93 | 90 | 92 | 90 | 89 | 87 | | | |
| 3 | 102 | 96 | 91 | 87 | 100 | 95 | 90 | 86 | 92 | 88 | 85 | 90 | 86 | 84 | 87 | 85 | 82 | 81 | | | |
| 4 | 97 | 90 | 84 | 80 | 95 | 89 | 83 | 79 | 86 | 82 | 78 | 84 | 81 | 78 | 83 | 79 | 77 | 75 | | | |
| 5 | 92 | 84 | 78 | 74 | 91 | 83 | 78 | 73 | 81 | 76 | 73 | 80 | 75 | 72 | 78 | 74 | 72 | 70 | | | |
| 6 | 88 | 79 | 73 | 69 | 86 | 78 | 72 | 68 | 77 | 72 | 68 | 75 | 71 | 67 | 74 | 70 | 67 | 65 | | | |
| 7 | 83 | 74 | 68 | 64 | 82 | 73 | 68 | 64 | 72 | 67 | 63 | 71 | 66 | 63 | 70 | 66 | 63 | 61 | | | |
| 8 | 79 | 70 | 64 | 60 | 78 | 69 | 64 | 60 | 68 | 63 | 59 | 67 | 63 | 59 | 66 | 62 | 59 | 58 | | | |
| 9 | 76 | 66 | 60 | 56 | 75 | 66 | 60 | 56 | 65 | 59 | 56 | 64 | 59 | 56 | 63 | 59 | 55 | 54 | | | |
| 10 | 72 | 62 | 57 | 53 | 71 | 62 | 57 | 53 | 61 | 56 | 53 | 60 | 56 | 52 | 60 | 55 | 52 | 51 | | | |

AVERAGE LUMINANCE (cd/sqm):

| | 0° |
|-----|--------|
| 0° | 416584 |
| 5° | 406272 |
| 10° | 374876 |
| 15° | 331892 |
| 20° | 288174 |
| 25° | 246486 |
| 30° | 203215 |
| 35° | 133826 |
| 40° | 71942 |
| 45° | 31848 |
| 50° | 12912 |
| 55° | 9319 |
| 60° | 5921 |
| 65° | 4229 |
| 70° | 3478 |
| 75° | 2309 |
| 80° | 3441 |
| 85° | 0 |



TEST NUMBER: P579768

CATALOG NUMBER: FLD6C-80-D010 FEU6C-X-90-50 F6X-N-X-H

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 683.4 | 11.5 |
| 10°-20° | 1629.6 | 27.5 |
| 20°-30° | 1866.9 | 31.5 |
| 30°-40° | 1254.3 | 21.2 |
| 40°-50° | 358.4 | 6.0 |
| 50°-60° | 87.7 | 1.5 |
| 60°-70° | 33.3 | 0.6 |
| 70°-80° | 12.9 | 0.2 |
| 80°-90° | 1.5 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 4179.8 | 70.5 |
| 0°-40° | 5434.2 | 91.7 |
| 0°-60° | 5880.3 | 99.2 |
| 0°-90° | 5928.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 5928.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 7599 | |
| 5° | 7383 | 683 |
| 15° | 5848 | 1630 |
| 25° | 4075 | 1867 |
| 35° | 2000 | 1254 |
| 45° | 411 | 358 |
| 55° | 98 | 88 |
| 65° | 33 | 33 |
| 75° | 11 | 13 |
| 85° | 0 | 1 |
| 90° | 0 | |



TEST NUMBER: P579768

CATALOG NUMBER: FLD6C-80-D010 FEU6C-X-90-50 F6X-N-X-H

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 7599.1 |
| 2.5° | 7545.1 |
| 5° | 7382.8 |
| 7.5° | 7090.8 |
| 10° | 6734.4 |
| 12.5° | 6280.1 |
| 15° | 5847.9 |
| 17.5° | 5394.0 |
| 20° | 4939.7 |
| 22.5° | 4507.6 |
| 25° | 4075.0 |
| 27.5° | 3675.1 |
| 30° | 3210.3 |
| 32.5° | 2594.1 |
| 35° | 1999.7 |
| 37.5° | 1459.2 |
| 40° | 1005.3 |
| 42.5° | 659.3 |
| 45° | 410.8 |
| 47.5° | 248.5 |
| 50° | 151.4 |
| 52.5° | 118.8 |
| 55° | 97.5 |
| 57.5° | 75.7 |
| 60° | 54.0 |
| 62.5° | 43.1 |
| 65° | 32.6 |
| 67.5° | 21.7 |
| 70° | 21.7 |
| 72.5° | 10.9 |
| 75° | 10.9 |
| 77.5° | 10.9 |
| 80° | 10.9 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)