

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW
 Description: 4 INCH 10000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 2700K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 9564.0 lumens
 Efficiency: N/A
 Efficacy: 83.6 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 114.4
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

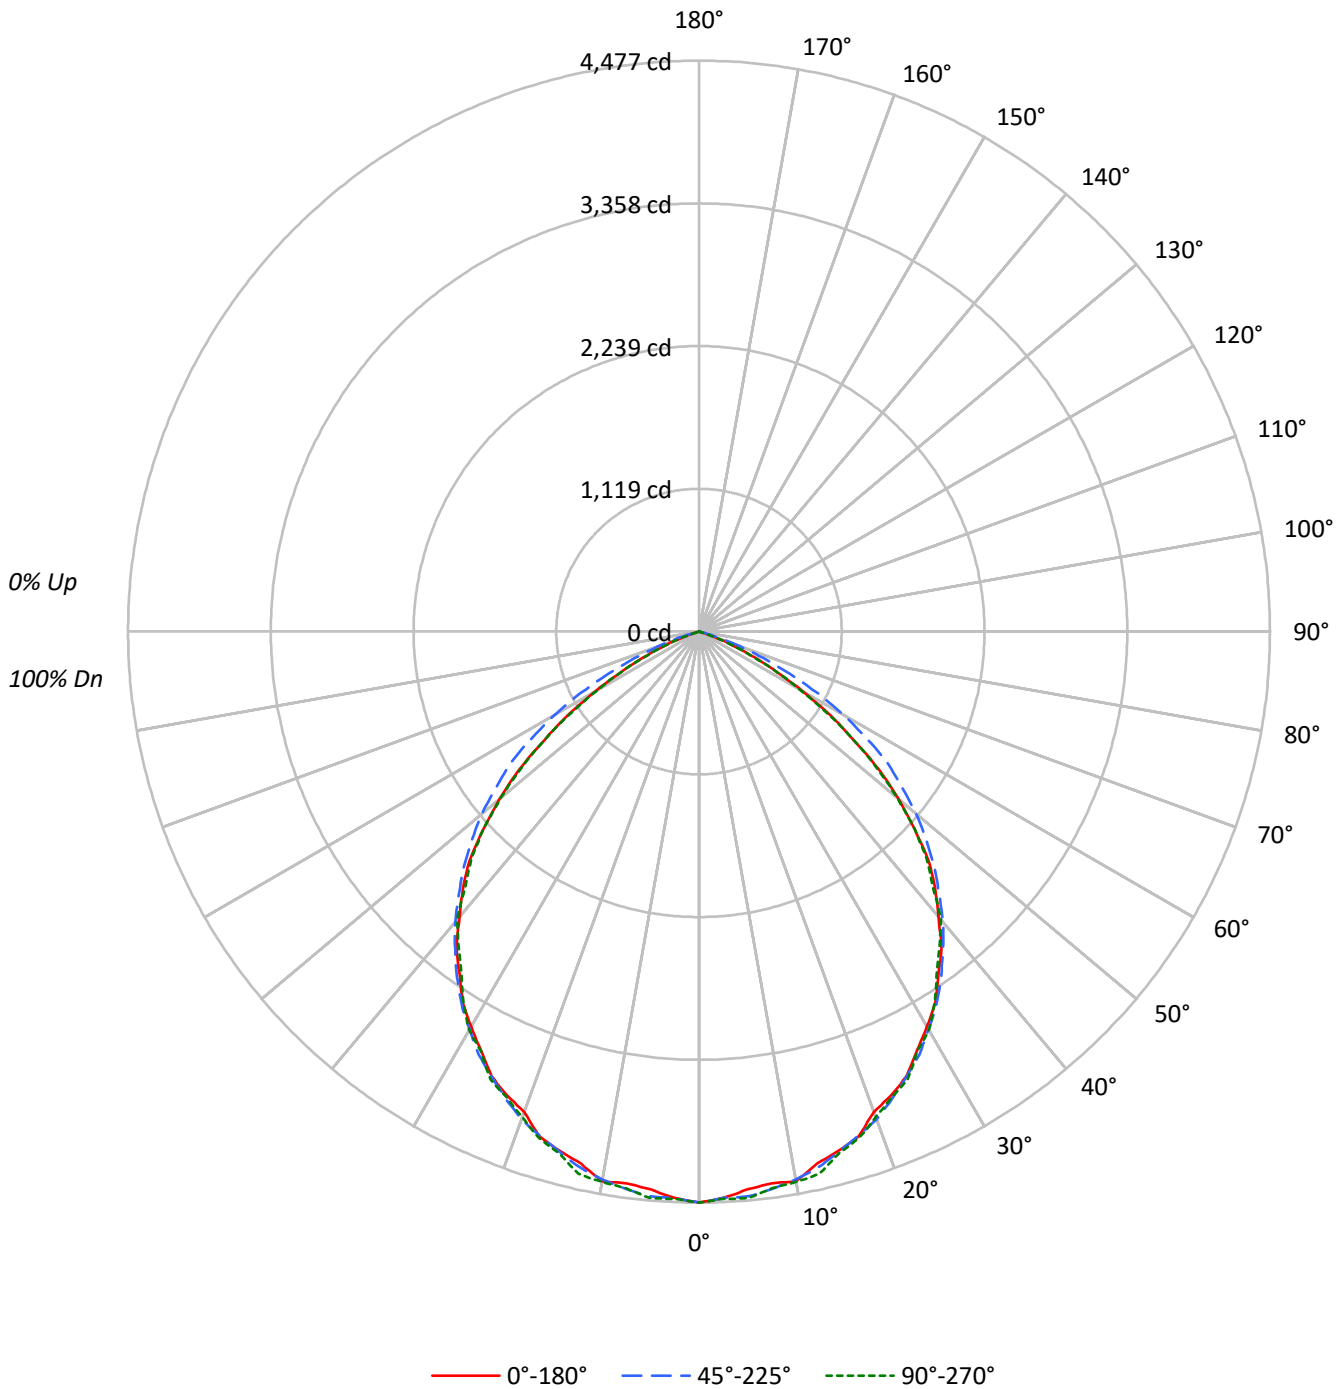

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	432000	432000	432000
5°	425030	430560	431791
10°	428700	427456	429308
15°	421187	421817	423085
20°	411393	417923	415972
25°	409619	409619	412323
30°	398200	401030	401754
35°	385778	389535	382774
40°	367682	374874	371662
45°	347976	355795	344510
50°	306450	333169	304543
55°	248197	304888	249273
60°	181611	252820	177964
65°	110366	180024	107467
70°	43051	96906	41273
75°	4735	26134	4735
80°	3612	3612	3612
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	422.6	4.4
10°-20°	1195.9	12.5
20°-30°	1774.4	18.6
30°-40°	2056.0	21.5
40°-50°	1971.3	20.6
50°-60°	1449.4	15.2
60°-70°	626.0	6.5
70°-80°	67.6	0.7
80°-90°	0.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3392.9	35.5
0°-40°	5448.9	57.0
0°-60°	8869.5	92.7
0°-90°	9564.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9564.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4477	4477	4477	4477	4477	
5°	4388	4433	4445	4452	4458	419
15°	4216	4242	4223	4229	4235	1188
25°	3848	3841	3848	3854	3873	1762
35°	3275	3294	3307	3300	3250	2048
45°	2550	2557	2607	2569	2525	1939
55°	1475	1628	1812	1622	1482	1328
65°	483	604	788	598	471	497
75°	13	19	70	13	13	39
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2
2.5°	4445.3	4496.2	4502.6	4470.7	4458.0	4439.1	4483.4	4451.8	4464.5	4451.8	4445.3
5°	4388.2	4445.3	4451.8	4451.8	4439.1	4432.6	4451.8	4445.3	4439.1	4426.3	4445.3
7.5°	4362.8	4394.4	4426.3	4388.2	4407.2	4400.9	4445.3	4426.3	4419.9	4419.9	4407.2
10°	4375.5	4369.0	4394.4	4356.3	4369.0	4356.3	4394.4	4394.4	4381.7	4369.0	4362.8
12.5°	4273.5	4324.4	4324.4	4318.1	4305.4	4286.2	4324.4	4350.1	4311.7	4311.7	4305.4
15°	4216.4	4229.1	4235.4	4235.4	4229.1	4241.9	4260.8	4235.4	4241.9	4210.0	4222.7
17.5°	4152.9	4127.4	4146.4	4133.7	4140.1	4152.9	4178.3	4178.3	4140.1	4133.7	4146.4
20°	4006.5	4082.8	4089.3	4051.1	4057.4	4057.4	4102.0	4063.9	4089.3	4057.4	4070.1
22.5°	3936.5	3987.3	3993.8	3943.0	3974.6	3936.5	3981.1	3923.8	3987.3	3943.0	3961.9
25°	3847.5	3841.2	3860.2	3834.8	3841.2	3841.2	3872.9	3847.5	3866.7	3841.2	3847.5
27.5°	3701.4	3752.2	3745.8	3720.3	3733.0	3726.8	3790.4	3720.3	3758.5	3726.8	3739.5
30°	3574.0	3618.6	3605.9	3580.5	3580.5	3561.3	3631.3	3612.1	3605.9	3605.9	3599.4
32.5°	3446.8	3453.3	3440.6	3446.8	3453.3	3427.9	3485.0	3459.6	3453.3	3459.6	3466.0
35°	3275.1	3275.1	3287.8	3268.8	3294.3	3294.3	3345.1	3313.2	3307.0	3287.8	3307.0
37.5°	3122.5	3103.6	3109.8	3109.8	3122.5	3135.2	3160.6	3147.9	3147.9	3129.0	3141.7
40°	2919.1	2906.4	2925.3	2925.3	2944.5	2944.5	2969.9	2957.2	2976.2	2976.2	2976.2
42.5°	2741.1	2741.1	2728.4	2747.3	2753.8	2747.3	2791.9	2785.4	2791.9	2779.2	2785.4
45°	2550.1	2550.1	2537.4	2531.2	2562.8	2556.6	2607.4	2588.2	2613.7	2601.0	2607.4
47.5°	2289.3	2321.2	2302.0	2321.2	2359.4	2365.9	2397.5	2384.8	2410.2	2391.3	2416.7
50°	2041.5	2041.5	2060.5	2085.9	2124.0	2130.5	2168.7	2194.1	2206.8	2213.0	2219.5
52.5°	1780.8	1774.3	1793.5	1825.1	1857.0	1882.5	1920.6	1958.8	1984.2	2022.3	2003.1
55°	1475.4	1488.1	1507.3	1545.4	1596.3	1627.9	1659.8	1710.7	1755.3	1774.3	1812.4
57.5°	1214.6	1201.9	1214.6	1265.5	1322.8	1348.2	1392.8	1443.7	1507.3	1545.4	1558.1
60°	941.1	947.6	960.3	1004.9	1049.3	1087.5	1106.6	1189.2	1246.5	1284.7	1310.1
62.5°	693.3	706.0	718.7	756.9	801.3	833.2	864.8	934.9	985.7	1023.9	1049.3
65°	483.4	489.6	508.8	527.8	572.4	604.1	629.5	686.8	737.7	769.6	788.5
67.5°	298.9	305.1	317.9	343.5	375.2	400.6	426.1	464.2	508.8	540.5	547.0
70°	152.6	159.1	165.3	184.5	209.9	222.6	241.6	273.5	305.1	330.6	343.5
72.5°	50.9	50.9	57.3	70.1	82.8	95.5	101.7	133.6	159.1	171.8	178.0
75°	12.7	12.7	12.7	12.7	12.7	19.2	19.2	38.1	50.9	63.6	70.1
77.5°	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	12.7	12.7
80°	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009027 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2	4477.2
2.5°	4477.2	4464.5	4458.0	4464.5	4464.5	4458.0	4477.2	4502.6	4534.3	4451.8
5°	4470.7	4458.0	4470.7	4432.6	4451.8	4439.1	4464.5	4458.0	4483.4	4458.0
7.5°	4451.8	4426.3	4432.6	4413.6	4439.1	4407.2	4426.3	4464.5	4439.1	4400.9
10°	4388.2	4375.5	4419.9	4356.3	4343.6	4369.0	4419.9	4381.7	4369.0	4381.7
12.5°	4324.4	4324.4	4343.6	4292.7	4299.0	4311.7	4337.1	4311.7	4324.4	4356.3
15°	4254.6	4241.9	4273.5	4235.4	4229.1	4216.4	4241.9	4241.9	4254.6	4235.4
17.5°	4171.8	4152.9	4152.9	4140.1	4133.7	4165.6	4178.3	4184.5	4191.0	4165.6
20°	4070.1	4063.9	4082.8	4063.9	4070.1	4076.6	4076.6	4063.9	4121.0	4051.1
22.5°	3961.9	3981.1	3955.7	3943.0	3955.7	3968.4	3968.4	3974.6	3961.9	3949.2
25°	3854.0	3866.7	3872.9	3834.8	3854.0	3834.8	3879.4	3885.6	3860.2	3872.9
27.5°	3758.5	3739.5	3733.0	3707.6	3720.3	3714.1	3720.3	3720.3	3758.5	3707.6
30°	3612.1	3593.2	3599.4	3580.5	3586.7	3580.5	3586.7	3586.7	3612.1	3605.9
32.5°	3472.3	3453.3	3459.6	3440.6	3440.6	3446.8	3434.1	3434.1	3453.3	3440.6
35°	3338.6	3294.3	3300.5	3294.3	3300.5	3275.1	3275.1	3268.8	3281.6	3249.6
37.5°	3147.9	3129.0	3122.5	3116.3	3122.5	3109.8	3122.5	3103.6	3122.5	3097.1
40°	2976.2	2963.4	2969.9	2931.8	2931.8	2938.0	2925.3	2919.1	2925.3	2950.7
42.5°	2804.6	2779.2	2766.5	2753.8	2760.0	2741.1	2734.6	2721.9	2734.6	2709.2
45°	2601.0	2601.0	2594.7	2562.8	2569.3	2569.3	2543.9	2518.4	2524.7	2524.7
47.5°	2416.7	2404.0	2397.5	2365.9	2359.4	2353.2	2327.5	2308.5	2308.5	2289.3
50°	2213.0	2200.3	2181.4	2149.5	2136.8	2098.6	2079.7	2054.2	2028.8	2028.8
52.5°	2022.3	1977.7	1952.3	1901.4	1882.5	1863.3	1812.4	1793.5	1774.3	1755.3
55°	1793.5	1755.3	1704.5	1647.1	1621.7	1589.8	1538.9	1500.8	1475.4	1481.8
57.5°	1570.8	1507.3	1456.4	1380.1	1348.2	1329.0	1278.2	1227.3	1201.9	1201.9
60°	1297.4	1246.5	1182.9	1112.9	1087.5	1055.8	992.0	960.3	941.1	922.2
62.5°	1036.6	998.5	941.1	852.1	833.2	801.3	756.9	718.7	699.5	699.5
65°	775.8	737.7	686.8	623.3	597.8	572.4	534.3	496.1	476.9	470.7
67.5°	547.0	502.3	458.0	407.1	387.9	375.2	337.1	311.6	298.9	292.4
70°	330.6	305.1	273.5	235.3	216.1	203.4	178.0	159.1	152.6	146.3
72.5°	171.8	152.6	127.1	101.7	89.0	76.3	63.6	50.9	44.6	44.6
75°	63.6	50.9	31.9	19.2	12.7	12.7	12.7	12.7	12.7	12.7
77.5°	12.7	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
80°	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)