

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW
 Description: 4 INCH 10000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3500K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 10083.0 lumens
 Efficiency: N/A
 Efficacy: 88.1 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 114.4
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

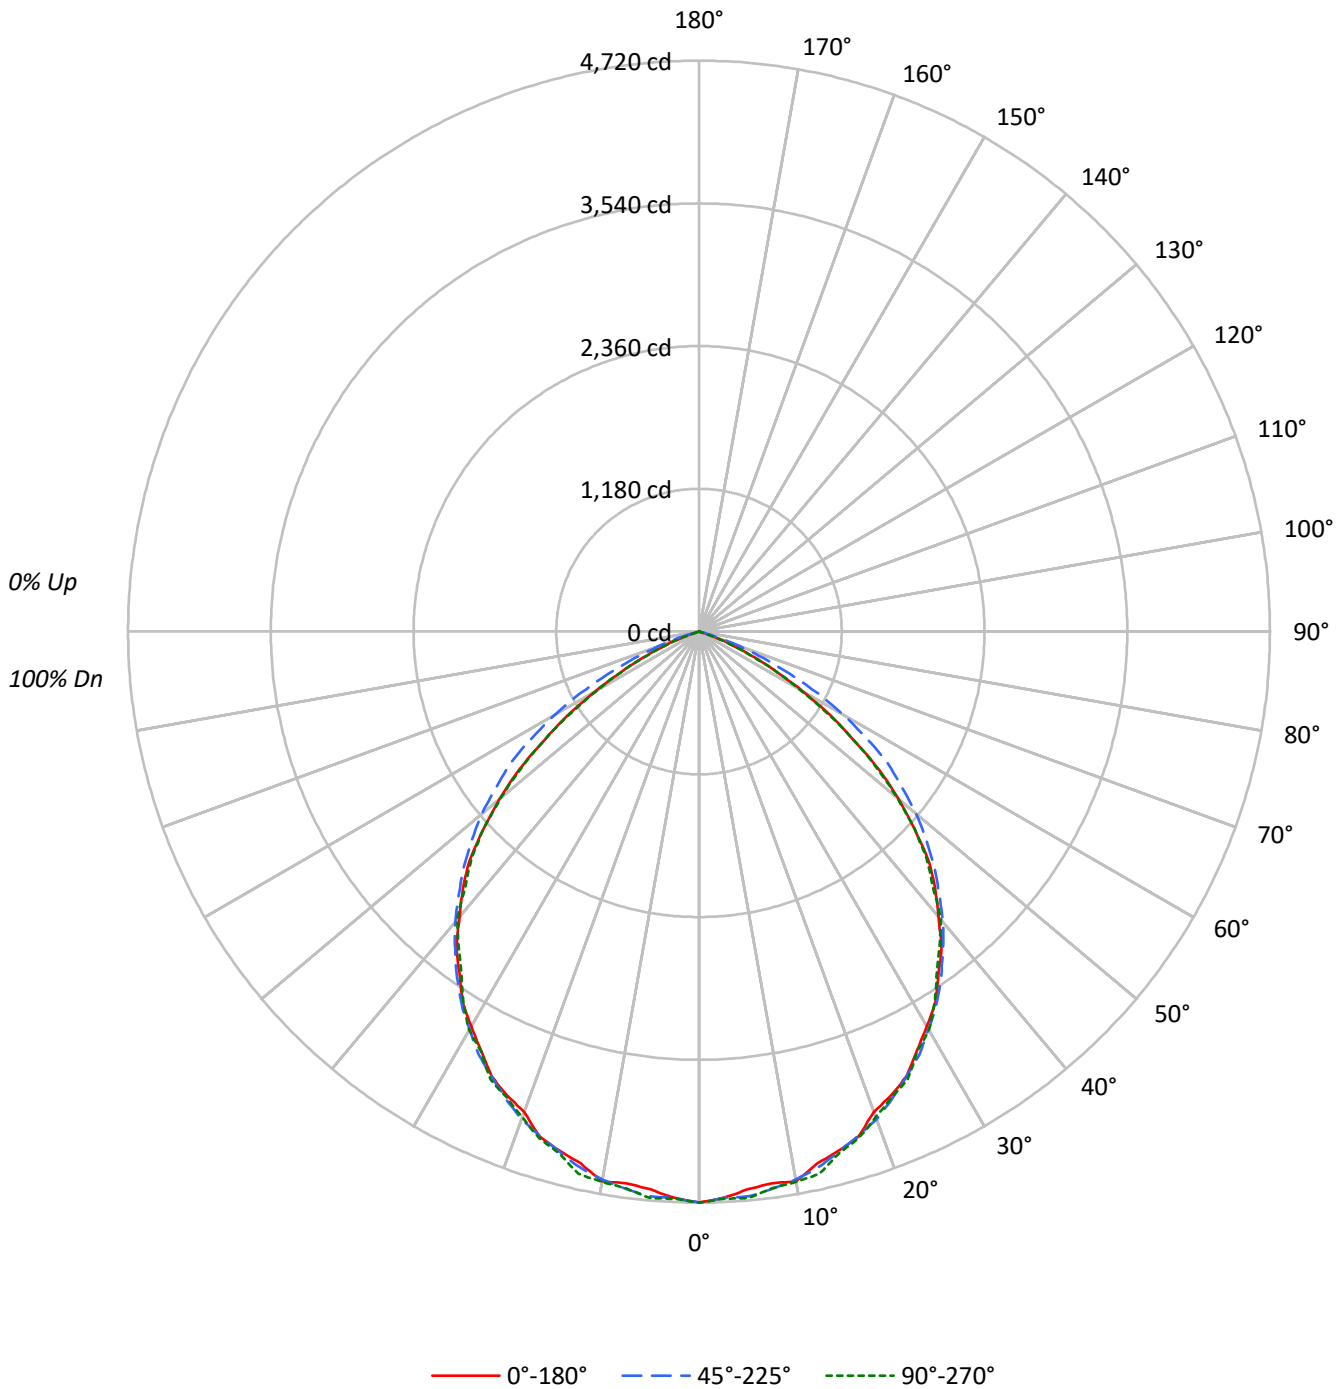

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	455447	455447	455447
5°	448092	453923	455220
10°	451960	450647	452607
15°	444043	444702	446041
20°	433716	440606	438552
25°	431849	431849	434702
30°	419804	422789	423558
35°	406709	410667	403553
40°	387634	395216	391841
45°	366862	375104	363205
50°	323082	351258	321070
55°	261654	321441	262815
60°	191473	266541	187613
65°	116348	189796	113289
70°	45392	102182	43530
75°	4996	27550	4996
80°	3778	3778	3778
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	445.5	4.4
10°-20°	1260.8	12.5
20°-30°	1870.7	18.6
30°-40°	2167.6	21.5
40°-50°	2078.2	20.6
50°-60°	1528.0	15.2
60°-70°	660.0	6.5
70°-80°	71.2	0.7
80°-90°	0.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3577.0	35.5
0°-40°	5744.6	57.0
0°-60°	9350.8	92.7
0°-90°	10083.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10083.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4720	4720	4720	4720	4720	
5°	4626	4673	4686	4693	4700	441
15°	4445	4472	4452	4459	4465	1253
25°	4056	4050	4056	4063	4083	1857
35°	3453	3473	3486	3480	3426	2159
45°	2688	2695	2749	2709	2662	2044
55°	1555	1716	1911	1710	1562	1400
65°	510	637	831	630	496	524
75°	13	20	74	13	13	41
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2
2.5°	4686.5	4740.1	4747.0	4713.3	4699.9	4680.0	4726.7	4693.4	4706.8	4693.4	4686.5
5°	4626.3	4686.5	4693.4	4693.4	4680.0	4673.1	4693.4	4686.5	4680.0	4666.5	4686.5
7.5°	4599.5	4632.9	4666.5	4626.3	4646.3	4639.7	4686.5	4666.5	4659.7	4659.7	4646.3
10°	4612.9	4606.1	4632.9	4592.7	4606.1	4592.7	4632.9	4632.9	4619.5	4606.1	4599.5
12.5°	4505.4	4559.0	4559.0	4552.5	4539.1	4518.8	4559.0	4586.1	4545.6	4545.6	4539.1
15°	4445.2	4458.6	4465.2	4465.2	4458.6	4472.1	4492.0	4465.2	4472.1	4438.4	4451.8
17.5°	4378.2	4351.4	4371.4	4358.0	4364.8	4378.2	4405.0	4405.0	4364.8	4358.0	4371.4
20°	4223.9	4304.4	4311.2	4271.0	4277.6	4277.6	4324.6	4284.4	4311.2	4277.6	4291.0
22.5°	4150.1	4203.7	4210.5	4156.9	4190.3	4150.1	4197.1	4136.7	4203.7	4156.9	4176.9
25°	4056.3	4049.7	4069.7	4042.9	4049.7	4049.7	4083.1	4056.3	4076.5	4049.7	4056.3
27.5°	3902.2	3955.9	3949.0	3922.2	3935.6	3929.0	3996.1	3922.2	3962.4	3929.0	3942.4
30°	3767.9	3815.0	3801.6	3774.8	3774.8	3754.5	3828.4	3808.1	3801.6	3801.6	3794.7
32.5°	3633.9	3640.7	3627.3	3633.9	3640.7	3613.9	3674.1	3647.3	3640.7	3647.3	3654.1
35°	3452.8	3452.8	3466.2	3446.2	3473.0	3473.0	3526.7	3493.0	3486.4	3466.2	3486.4
37.5°	3291.9	3272.0	3278.5	3278.5	3291.9	3305.4	3332.2	3318.8	3318.8	3298.8	3312.2
40°	3077.5	3064.1	3084.0	3084.0	3104.3	3104.3	3131.1	3117.7	3137.7	3137.7	3137.7
42.5°	2889.8	2889.8	2876.4	2896.4	2903.2	2896.4	2943.4	2936.6	2943.4	2930.0	2936.6
45°	2688.5	2688.5	2675.1	2668.5	2701.9	2695.3	2748.9	2728.7	2755.5	2742.1	2748.9
47.5°	2413.6	2447.2	2427.0	2447.2	2487.4	2494.3	2527.6	2514.2	2541.0	2521.1	2547.9
50°	2152.3	2152.3	2172.3	2199.1	2239.3	2246.1	2286.4	2313.2	2326.6	2333.1	2340.0
52.5°	1877.4	1870.6	1890.8	1924.2	1957.8	1984.6	2024.8	2065.1	2091.9	2132.1	2111.8
55°	1555.4	1568.8	1589.1	1629.3	1682.9	1716.3	1749.9	1803.5	1850.6	1870.6	1910.8
57.5°	1280.5	1267.1	1280.5	1334.1	1394.6	1421.4	1468.4	1522.0	1589.1	1629.3	1642.7
60°	992.2	999.0	1012.4	1059.5	1106.3	1146.5	1166.7	1253.7	1314.1	1354.4	1381.2
62.5°	730.9	744.3	757.7	798.0	844.7	878.4	911.8	985.6	1039.2	1079.4	1106.3
65°	509.6	516.2	536.4	556.4	603.5	636.8	663.6	724.1	777.7	811.4	831.3
67.5°	315.1	321.7	335.1	362.2	395.6	422.4	449.2	489.4	536.4	569.8	576.6
70°	160.9	167.7	174.3	194.5	221.3	234.7	254.7	288.3	321.7	348.5	362.2
72.5°	53.6	53.6	60.5	73.9	87.3	100.7	107.2	140.9	167.7	181.1	187.7
75°	13.4	13.4	13.4	13.4	13.4	20.2	20.2	40.2	53.6	67.0	73.9
77.5°	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	13.4	13.4
80°	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C100D010 FEU4C1009035 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2	4720.2
2.5°	4720.2	4706.8	4699.9	4706.8	4706.8	4699.9	4720.2	4747.0	4780.4	4693.4
5°	4713.3	4699.9	4713.3	4673.1	4693.4	4680.0	4706.8	4699.9	4726.7	4699.9
7.5°	4693.4	4666.5	4673.1	4653.1	4680.0	4646.3	4666.5	4706.8	4680.0	4639.7
10°	4626.3	4612.9	4659.7	4592.7	4579.3	4606.1	4659.7	4619.5	4606.1	4619.5
12.5°	4559.0	4559.0	4579.3	4525.7	4532.2	4545.6	4572.5	4545.6	4559.0	4592.7
15°	4485.5	4472.1	4505.4	4465.2	4458.6	4445.2	4472.1	4472.1	4485.5	4465.2
17.5°	4398.2	4378.2	4378.2	4364.8	4358.0	4391.6	4405.0	4411.6	4418.4	4391.6
20°	4291.0	4284.4	4304.4	4284.4	4291.0	4297.8	4297.8	4284.4	4344.6	4271.0
22.5°	4176.9	4197.1	4170.3	4156.9	4170.3	4183.7	4183.7	4190.3	4176.9	4163.5
25°	4063.1	4076.5	4083.1	4042.9	4063.1	4042.9	4089.9	4096.5	4069.7	4083.1
27.5°	3962.4	3942.4	3935.6	3908.8	3922.2	3915.6	3922.2	3922.2	3962.4	3908.8
30°	3808.1	3788.2	3794.7	3774.8	3781.3	3774.8	3781.3	3781.3	3808.1	3801.6
32.5°	3660.7	3640.7	3647.3	3627.3	3627.3	3633.9	3620.5	3620.5	3640.7	3627.3
35°	3519.8	3473.0	3479.6	3473.0	3479.6	3452.8	3452.8	3446.2	3459.6	3426.0
37.5°	3318.8	3298.8	3291.9	3285.4	3291.9	3278.5	3291.9	3272.0	3291.9	3265.1
40°	3137.7	3124.3	3131.1	3090.9	3090.9	3097.5	3084.0	3077.5	3084.0	3110.9
42.5°	2956.8	2930.0	2916.6	2903.2	2909.8	2889.8	2883.0	2869.6	2883.0	2856.2
45°	2742.1	2742.1	2735.5	2701.9	2708.7	2708.7	2681.9	2655.1	2661.7	2661.7
47.5°	2547.9	2534.5	2527.6	2494.3	2487.4	2480.9	2453.8	2433.8	2433.8	2413.6
50°	2333.1	2319.7	2299.8	2266.1	2252.7	2212.5	2192.5	2165.7	2138.9	2138.9
52.5°	2132.1	2085.0	2058.2	2004.6	1984.6	1964.4	1910.8	1890.8	1870.6	1850.6
55°	1890.8	1850.6	1797.0	1736.5	1709.7	1676.1	1622.4	1582.2	1555.4	1562.3
57.5°	1656.1	1589.1	1535.5	1455.0	1421.4	1401.1	1347.5	1293.9	1267.1	1267.1
60°	1367.8	1314.1	1247.1	1173.3	1146.5	1113.1	1045.8	1012.4	992.2	972.2
62.5°	1092.8	1052.6	992.2	898.4	878.4	844.7	798.0	757.7	737.5	737.5
65°	817.9	777.7	724.1	657.1	630.3	603.5	563.2	523.0	502.8	496.2
67.5°	576.6	529.6	482.8	429.2	409.0	395.6	355.3	328.5	315.1	308.3
70°	348.5	321.7	288.3	248.1	227.9	214.5	187.7	167.7	160.9	154.3
72.5°	181.1	160.9	134.0	107.2	93.8	80.4	67.0	53.6	47.0	47.0
75°	67.0	53.6	33.6	20.2	13.4	13.4	13.4	13.4	13.4	13.4
77.5°	13.4	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8
80°	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8	6.8
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)