

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.



**Test Information**

Test Method: LM-79-08  
 Report Number: P#  
 Test Lab: INNOVATION CENTER  
 Issue Date: 12/13/2022  
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
 Product Line: FAIL-SAFE  
 Catalog Number: FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW  
 Description: 4 INCH 2500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 5000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH  
 Light Source: -  
 Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
 Luminaire Lumens: 2545.0 lumens  
 Efficiency: N/A  
 Efficacy: 80.8 lumens/watt  
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29  
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')  
 CIE Type: Direct

Input Watts (W): 31.5  
 Input Voltage (V):  
 Input Current (Ain): NR  
 Voltage Rise (V): NR  
 Power Factor: NR  
 Total Harmonic Distortion (THDi): NR  
 Frequency (hertz): 60  
 Stabilization Time: NR  
 Operation Time: NR  
 Ambient Temperature (°C): NR  
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#  
CATALOG NUMBER: FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW

### Luminous Intensity Polar Plot

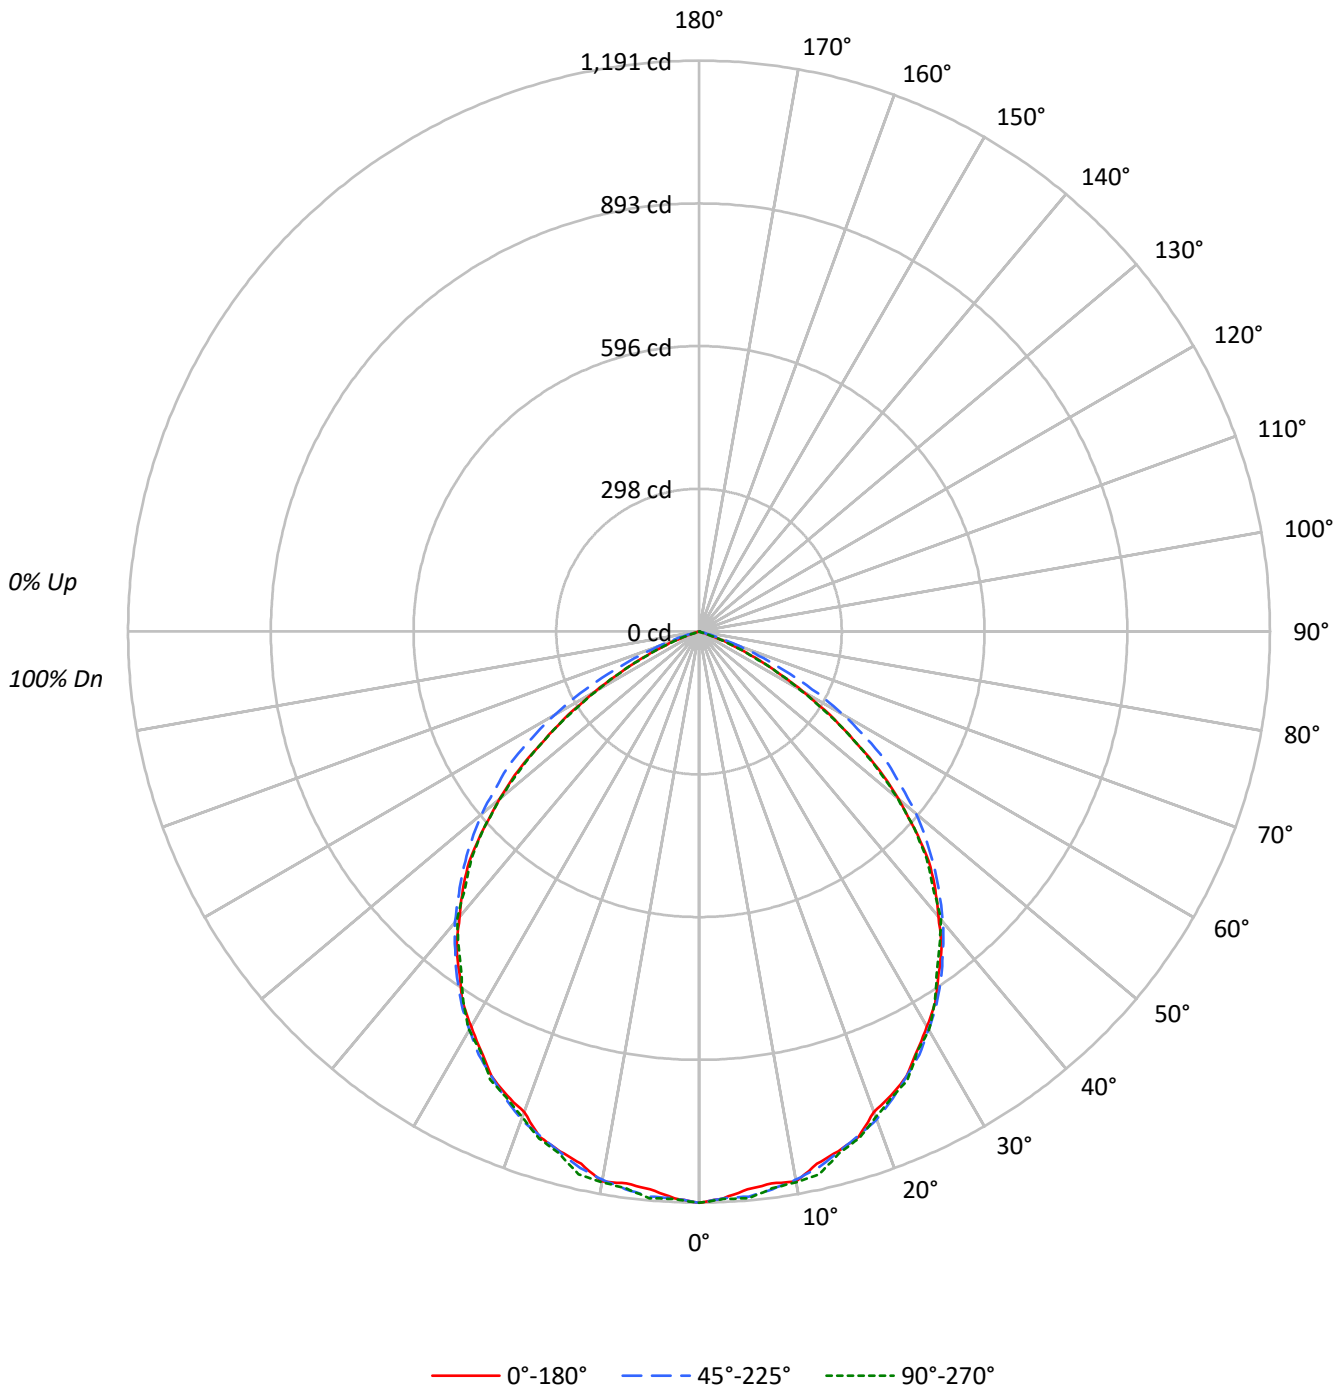

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	114957	114957	114957
5°	113100	114573	114902
10°	114075	113742	114242
15°	112080	112249	112579
20°	109469	111214	110690
25°	108998	108998	109722
30°	105956	106714	106903
35°	102655	103656	101854
40°	97844	99758	98902
45°	92599	94673	91671
50°	81555	88655	81044
55°	66044	81134	66330
60°	48322	67272	47357
65°	29361	47900	28585
70°	11454	25785	10974
75°	1268	6934	1268
80°	945	945	945
85°	0	0	0

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	112.5	4.4
10°-20°	318.2	12.5
20°-30°	472.2	18.6
30°-40°	547.1	21.5
40°-50°	524.6	20.6
50°-60°	385.7	15.2
60°-70°	166.6	6.5
70°-80°	18.0	0.7
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	902.9	35.5
0°-40°	1450.0	57.0
0°-60°	2360.2	92.7
0°-90°	2545.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2545.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1191	1191	1191	1191	1191	
5°	1168	1180	1183	1185	1186	111
15°	1122	1129	1124	1125	1127	316
25°	1024	1022	1024	1026	1031	469
35°	872	877	880	878	865	545
45°	679	680	694	684	672	516
55°	393	433	482	432	394	353
65°	129	161	210	159	125	132
75°	3	5	19	3	3	10
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4
2.5°	1182.9	1196.4	1198.2	1189.7	1186.3	1181.2	1193.1	1184.6	1188.0	1184.6	1182.9
5°	1167.7	1182.9	1184.6	1184.6	1181.2	1179.5	1184.6	1182.9	1181.2	1177.9	1182.9
7.5°	1160.9	1169.4	1177.9	1167.7	1172.8	1171.1	1182.9	1177.9	1176.1	1176.1	1172.8
10°	1164.3	1162.6	1169.4	1159.2	1162.6	1159.2	1169.4	1169.4	1166.0	1162.6	1160.9
12.5°	1137.2	1150.7	1150.7	1149.1	1145.7	1140.6	1150.7	1157.6	1147.3	1147.3	1145.7
15°	1122.0	1125.4	1127.0	1127.0	1125.4	1128.8	1133.8	1127.0	1128.8	1120.3	1123.7
17.5°	1105.1	1098.3	1103.4	1100.0	1101.7	1105.1	1111.9	1111.9	1101.7	1100.0	1103.4
20°	1066.1	1086.4	1088.2	1078.0	1079.7	1079.7	1091.6	1081.4	1088.2	1079.7	1083.1
22.5°	1047.5	1061.0	1062.8	1049.2	1057.7	1047.5	1059.4	1044.1	1061.0	1049.2	1054.3
25°	1023.8	1022.2	1027.2	1020.4	1022.2	1022.2	1030.6	1023.8	1028.9	1022.2	1023.8
27.5°	984.9	998.5	996.8	990.0	993.4	991.7	1008.6	990.0	1000.1	991.7	995.1
30°	951.0	962.9	959.5	952.8	952.8	947.7	966.3	961.2	959.5	959.5	957.8
32.5°	917.2	918.9	915.6	917.2	918.9	912.2	927.4	920.6	918.9	920.6	922.3
35°	871.5	871.5	874.9	869.8	876.6	876.6	890.1	881.7	880.0	874.9	880.0
37.5°	830.9	825.9	827.5	827.5	830.9	834.3	841.1	837.7	837.7	832.6	836.0
40°	776.8	773.4	778.4	778.4	783.5	783.5	790.3	786.9	792.0	792.0	792.0
42.5°	729.4	729.4	726.0	731.1	732.8	731.1	742.9	741.2	742.9	739.6	741.2
45°	678.6	678.6	675.2	673.5	682.0	680.3	693.8	688.7	695.5	692.1	693.8
47.5°	609.2	617.7	612.6	617.7	627.8	629.6	638.0	634.6	641.4	636.3	643.1
50°	543.3	543.3	548.3	555.1	565.2	566.9	577.1	583.9	587.2	588.9	590.6
52.5°	473.9	472.1	477.2	485.7	494.2	500.9	511.1	521.2	528.0	538.1	533.0
55°	392.6	396.0	401.1	411.2	424.8	433.2	441.7	455.2	467.1	472.1	482.3
57.5°	323.2	319.8	323.2	336.7	352.0	358.8	370.6	384.2	401.1	411.2	414.6
60°	250.4	252.2	255.5	267.4	279.2	289.4	294.5	316.4	331.7	341.8	348.6
62.5°	184.5	187.9	191.3	201.4	213.2	221.7	230.1	248.8	262.3	272.5	279.2
65°	128.6	130.3	135.4	140.4	152.3	160.7	167.5	182.8	196.3	204.8	209.8
67.5°	79.5	81.2	84.6	91.4	99.8	106.6	113.4	123.5	135.4	143.8	145.5
70°	40.6	42.3	44.0	49.1	55.9	59.2	64.3	72.8	81.2	88.0	91.4
72.5°	13.5	13.5	15.3	18.6	22.0	25.4	27.1	35.6	42.3	45.7	47.4
75°	3.4	3.4	3.4	3.4	3.4	5.1	5.1	10.1	13.5	16.9	18.6
77.5°	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	3.4	3.4
80°	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C25D010 FEU4C259050 F4LC-CSSQ-MW

**CANDELA DISTRIBUTION (continued):**

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4	1191.4
2.5°	1191.4	1188.0	1186.3	1188.0	1188.0	1186.3	1191.4	1198.2	1206.6	1184.6
5°	1189.7	1186.3	1189.7	1179.5	1184.6	1181.2	1188.0	1186.3	1193.1	1186.3
7.5°	1184.6	1177.9	1179.5	1174.5	1181.2	1172.8	1177.9	1188.0	1181.2	1171.1
10°	1167.7	1164.3	1176.1	1159.2	1155.8	1162.6	1176.1	1166.0	1162.6	1166.0
12.5°	1150.7	1150.7	1155.8	1142.3	1144.0	1147.3	1154.1	1147.3	1150.7	1159.2
15°	1132.2	1128.8	1137.2	1127.0	1125.4	1122.0	1128.8	1128.8	1132.2	1127.0
17.5°	1110.1	1105.1	1105.1	1101.7	1100.0	1108.5	1111.9	1113.5	1115.2	1108.5
20°	1083.1	1081.4	1086.4	1081.4	1083.1	1084.8	1084.8	1081.4	1096.6	1078.0
22.5°	1054.3	1059.4	1052.6	1049.2	1052.6	1056.0	1056.0	1057.7	1054.3	1050.9
25°	1025.5	1028.9	1030.6	1020.4	1025.5	1020.4	1032.3	1034.0	1027.2	1030.6
27.5°	1000.1	995.1	993.4	986.6	990.0	988.3	990.0	990.0	1000.1	986.6
30°	961.2	956.2	957.8	952.8	954.4	952.8	954.4	954.4	961.2	959.5
32.5°	924.0	918.9	920.6	915.6	915.6	917.2	913.8	913.8	918.9	915.6
35°	888.4	876.6	878.3	876.6	878.3	871.5	871.5	869.8	873.2	864.7
37.5°	837.7	832.6	830.9	829.2	830.9	827.5	830.9	825.9	830.9	824.1
40°	792.0	788.6	790.3	780.2	780.2	781.8	778.4	776.8	778.4	785.2
42.5°	746.3	739.6	736.2	732.8	734.4	729.4	727.7	724.3	727.7	720.9
45°	692.1	692.1	690.5	682.0	683.7	683.7	676.9	670.2	671.8	671.8
47.5°	643.1	639.7	638.0	629.6	627.8	626.2	619.3	614.3	614.3	609.2
50°	588.9	585.5	580.5	572.0	568.6	558.4	553.4	546.6	539.9	539.9
52.5°	538.1	526.3	519.5	506.0	500.9	495.8	482.3	477.2	472.1	467.1
55°	477.2	467.1	453.6	438.3	431.5	423.0	409.5	399.4	392.6	394.3
57.5°	418.0	401.1	387.6	367.3	358.8	353.7	340.1	326.6	319.8	319.8
60°	345.2	331.7	314.8	296.1	289.4	280.9	264.0	255.5	250.4	245.4
62.5°	275.8	265.7	250.4	226.7	221.7	213.2	201.4	191.3	186.1	186.1
65°	206.4	196.3	182.8	165.8	159.1	152.3	142.2	132.0	126.9	125.2
67.5°	145.5	133.7	121.9	108.3	103.2	99.8	89.7	82.9	79.5	77.8
70°	88.0	81.2	72.8	62.6	57.5	54.1	47.4	42.3	40.6	38.9
72.5°	45.7	40.6	33.8	27.1	23.7	20.3	16.9	13.5	11.9	11.9
75°	16.9	13.5	8.5	5.1	3.4	3.4	3.4	3.4	3.4	3.4
77.5°	3.4	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
80°	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)