

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

**Test Information**

Test Method: LM-79-08  
 Report Number: P#  
 Test Lab: INNOVATION CENTER  
 Issue Date: 12/13/2022  
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
 Product Line: FAIL-SAFE  
 Catalog Number: FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW  
 Description: 4 INCH 4000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 2700K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH  
 Light Source: -  
 Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
 Luminaire Lumens: 3798.0 lumens  
 Efficiency: N/A  
 Efficacy: 80.8 lumens/watt  
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29  
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')  
 CIE Type: Direct

Input Watts (W): 47  
 Input Voltage (V):  
 Input Current (Ain): NR  
 Voltage Rise (V): NR  
 Power Factor: NR  
 Total Harmonic Distortion (THDi): NR  
 Frequency (hertz): 60  
 Stabilization Time: NR  
 Operation Time: NR  
 Ambient Temperature (°C): NR  
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#  
CATALOG NUMBER: FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW

### Luminous Intensity Polar Plot

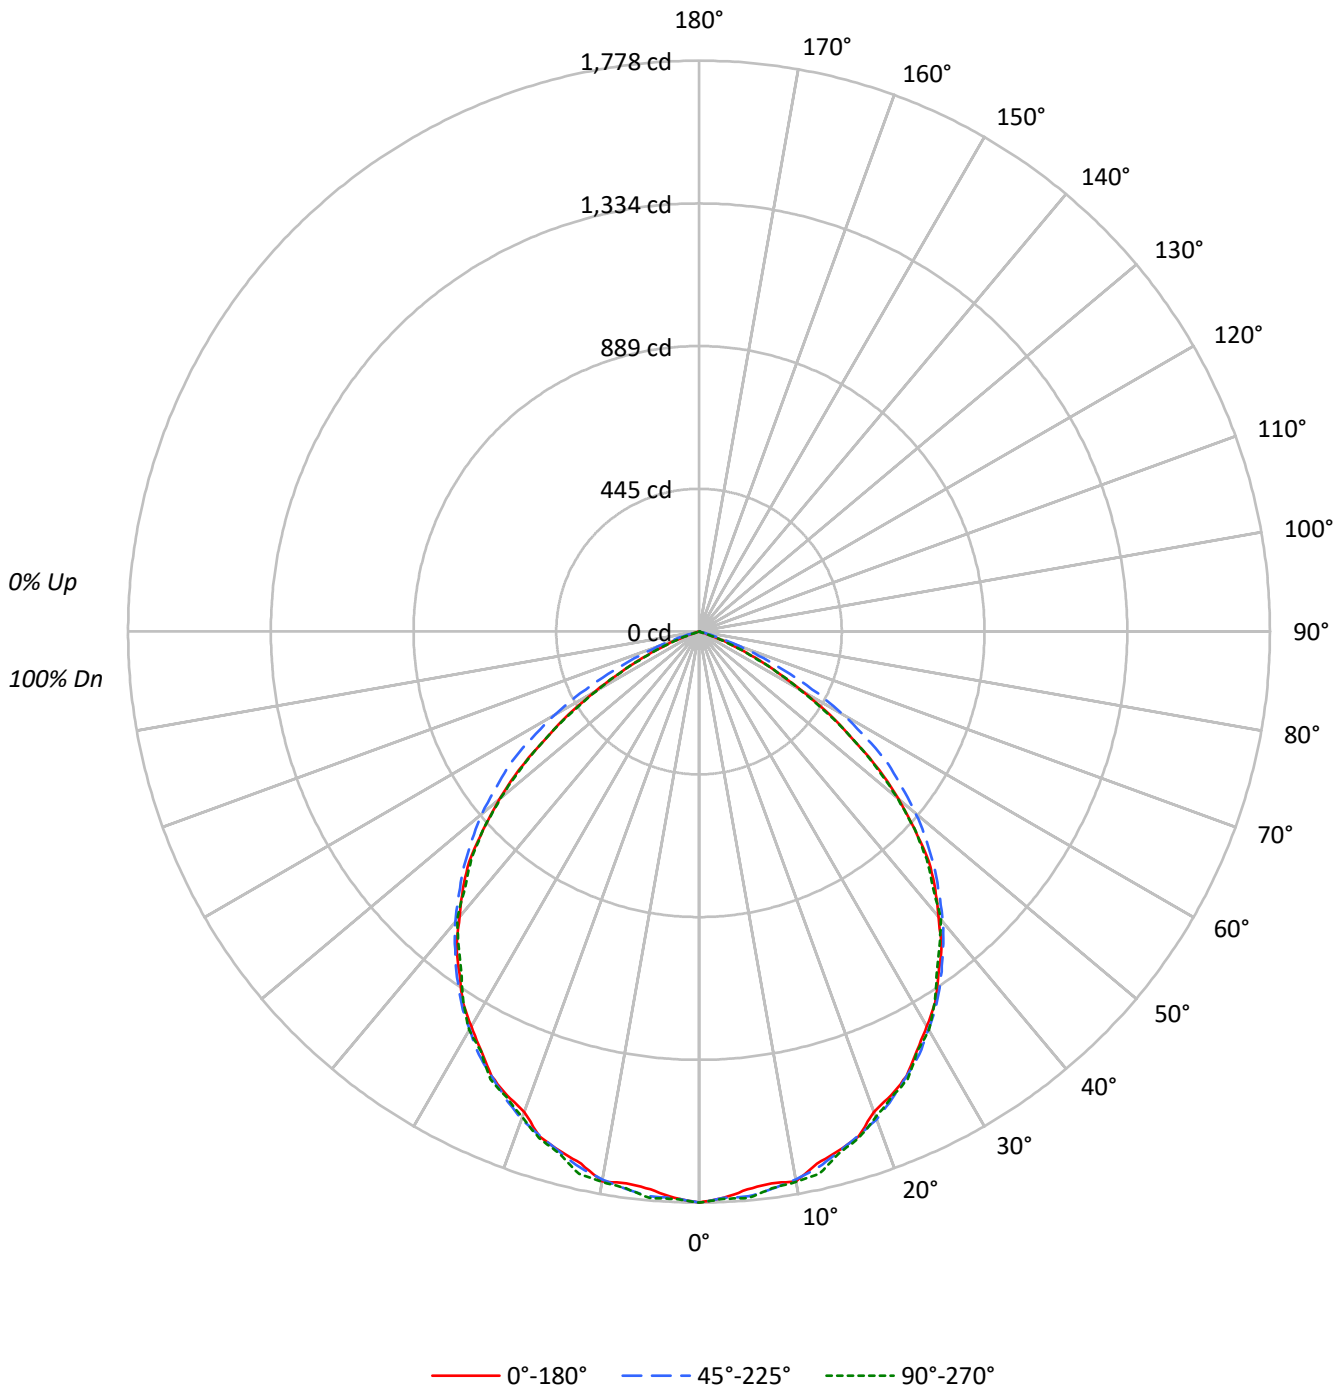

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	171557	171557	171557
5°	168784	170982	171467
10°	170246	169746	170481
15°	167260	167510	168009
20°	163366	165964	165194
25°	162666	162666	163741
30°	158132	159258	159547
35°	153199	154683	152010
40°	146010	148869	147597
45°	138189	141300	136811
50°	121694	132307	120944
55°	98562	121070	98999
60°	72116	100406	70668
65°	43836	71485	42672
70°	17096	38480	16391
75°	1864	10364	1864
80°	1445	1445	1445
85°	0	0	0

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	167.8	4.4
10°-20°	474.9	12.5
20°-30°	704.6	18.6
30°-40°	816.5	21.5
40°-50°	782.8	20.6
50°-60°	575.6	15.2
60°-70°	248.6	6.5
70°-80°	26.8	0.7
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1347.4	35.5
0°-40°	2163.8	57.0
0°-60°	3522.2	92.7
0°-90°	3798.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3798.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1778	1778	1778	1778	1778	
5°	1743	1760	1765	1768	1770	166
15°	1674	1684	1677	1680	1682	472
25°	1528	1525	1528	1530	1538	700
35°	1301	1308	1313	1311	1290	813
45°	1013	1015	1036	1020	1003	770
55°	586	646	720	644	588	527
65°	192	240	313	237	187	197
75°	5	8	28	5	5	16
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0
2.5°	1765.3	1785.5	1788.1	1775.4	1770.3	1762.8	1780.4	1767.9	1772.9	1767.9	1765.3
5°	1742.6	1765.3	1767.9	1767.9	1762.8	1760.2	1767.9	1765.3	1762.8	1757.8	1765.3
7.5°	1732.5	1745.1	1757.8	1742.6	1750.1	1747.7	1765.3	1757.8	1755.2	1755.2	1750.1
10°	1737.6	1735.0	1745.1	1729.9	1735.0	1729.9	1745.1	1745.1	1740.0	1735.0	1732.5
12.5°	1697.1	1717.3	1717.3	1714.8	1709.7	1702.1	1717.3	1727.5	1712.2	1712.2	1709.7
15°	1674.4	1679.5	1681.9	1681.9	1679.5	1684.5	1692.0	1681.9	1684.5	1671.8	1676.9
17.5°	1649.2	1639.1	1646.6	1641.5	1644.1	1649.2	1659.3	1659.3	1644.1	1641.5	1646.6
20°	1591.0	1621.3	1623.9	1608.8	1611.2	1611.2	1629.0	1613.8	1623.9	1611.2	1616.3
22.5°	1563.2	1583.4	1586.0	1565.8	1578.4	1563.2	1580.9	1558.2	1583.4	1565.8	1573.3
25°	1527.9	1525.4	1532.9	1522.8	1525.4	1525.4	1538.0	1527.9	1535.5	1525.4	1527.9
27.5°	1469.9	1490.1	1487.5	1477.4	1482.4	1480.0	1505.2	1477.4	1492.5	1480.0	1485.0
30°	1419.3	1437.0	1432.0	1421.9	1421.9	1414.2	1442.1	1434.4	1432.0	1432.0	1429.4
32.5°	1368.8	1371.4	1366.3	1368.8	1371.4	1361.3	1383.9	1373.8	1371.4	1373.8	1376.4
35°	1300.6	1300.6	1305.6	1298.1	1308.2	1308.2	1328.4	1315.7	1313.2	1305.6	1313.2
37.5°	1240.0	1232.5	1234.9	1234.9	1240.0	1245.0	1255.1	1250.1	1250.1	1242.6	1247.6
40°	1159.2	1154.2	1161.7	1161.7	1169.3	1169.3	1179.4	1174.4	1181.9	1181.9	1181.9
42.5°	1088.5	1088.5	1083.5	1091.0	1093.6	1091.0	1108.7	1106.1	1108.7	1103.7	1106.1
45°	1012.7	1012.7	1007.6	1005.2	1017.7	1015.3	1035.5	1027.8	1037.9	1032.9	1035.5
47.5°	909.1	921.8	914.2	921.8	936.9	939.5	952.1	947.0	957.1	949.6	959.7
50°	810.7	810.7	818.2	828.3	843.5	846.1	861.2	871.3	876.4	878.8	881.4
52.5°	707.2	704.6	712.2	724.8	737.5	747.6	762.7	777.9	787.9	803.1	795.5
55°	585.9	590.9	598.6	613.7	633.9	646.5	659.1	679.3	697.1	704.6	719.7
57.5°	482.3	477.3	482.3	502.5	525.3	535.4	553.1	573.3	598.6	613.7	618.8
60°	373.7	376.3	381.4	399.1	416.7	431.8	439.5	472.2	495.0	510.2	520.3
62.5°	275.3	280.4	285.4	300.6	318.2	330.9	343.4	371.3	391.5	406.6	416.7
65°	192.0	194.4	202.1	209.6	227.3	239.9	250.0	272.7	292.9	305.6	313.1
67.5°	118.7	121.2	126.2	136.4	149.0	159.1	169.2	184.3	202.1	214.6	217.2
70°	60.6	63.2	65.6	73.3	83.4	88.4	95.9	108.6	121.2	131.3	136.4
72.5°	20.2	20.2	22.8	27.8	32.9	37.9	40.4	53.1	63.2	68.2	70.7
75°	5.0	5.0	5.0	5.0	5.0	7.6	7.6	15.1	20.2	25.2	27.8
77.5°	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	5.0	5.0
80°	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409027 F4LC-DFSSQ-MW

**CANDELA DISTRIBUTION (continued):**

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0	1778.0
2.5°	1778.0	1772.9	1770.3	1772.9	1772.9	1770.3	1778.0	1788.1	1800.6	1767.9
5°	1775.4	1770.3	1775.4	1760.2	1767.9	1762.8	1772.9	1770.3	1780.4	1770.3
7.5°	1767.9	1757.8	1760.2	1752.7	1762.8	1750.1	1757.8	1772.9	1762.8	1747.7
10°	1742.6	1737.6	1755.2	1729.9	1724.9	1735.0	1755.2	1740.0	1735.0	1740.0
12.5°	1717.3	1717.3	1724.9	1704.7	1707.2	1712.2	1722.3	1712.2	1717.3	1729.9
15°	1689.6	1684.5	1697.1	1681.9	1679.5	1674.4	1684.5	1684.5	1689.6	1681.9
17.5°	1656.7	1649.2	1649.2	1644.1	1641.5	1654.2	1659.3	1661.7	1664.3	1654.2
20°	1616.3	1613.8	1621.3	1613.8	1616.3	1618.9	1618.9	1613.8	1636.5	1608.8
22.5°	1573.3	1580.9	1570.9	1565.8	1570.9	1575.9	1575.9	1578.4	1573.3	1568.3
25°	1530.5	1535.5	1538.0	1522.8	1530.5	1522.8	1540.6	1543.0	1532.9	1538.0
27.5°	1492.5	1485.0	1482.4	1472.3	1477.4	1474.9	1477.4	1477.4	1492.5	1472.3
30°	1434.4	1426.9	1429.4	1421.9	1424.3	1421.9	1424.3	1424.3	1434.4	1432.0
32.5°	1378.9	1371.4	1373.8	1366.3	1366.3	1368.8	1363.7	1363.7	1371.4	1366.3
35°	1325.8	1308.2	1310.7	1308.2	1310.7	1300.6	1300.6	1298.1	1303.2	1290.5
37.5°	1250.1	1242.6	1240.0	1237.5	1240.0	1234.9	1240.0	1232.5	1240.0	1229.9
40°	1181.9	1176.8	1179.4	1164.3	1164.3	1166.7	1161.7	1159.2	1161.7	1171.8
42.5°	1113.8	1103.7	1098.6	1093.6	1096.0	1088.5	1085.9	1080.9	1085.9	1075.8
45°	1032.9	1032.9	1030.4	1017.7	1020.3	1020.3	1010.2	1000.1	1002.6	1002.6
47.5°	959.7	954.7	952.1	939.5	936.9	934.5	924.3	916.8	916.8	909.1
50°	878.8	873.8	866.3	853.6	848.5	833.4	825.9	815.8	805.7	805.7
52.5°	803.1	785.4	775.3	755.1	747.6	739.9	719.7	712.2	704.6	697.1
55°	712.2	697.1	676.9	654.1	644.0	631.3	611.1	596.0	585.9	588.5
57.5°	623.8	598.6	578.4	548.1	535.4	527.8	507.6	487.4	477.3	477.3
60°	515.2	495.0	469.8	441.9	431.8	419.3	393.9	381.4	373.7	366.2
62.5°	411.6	396.5	373.7	338.4	330.9	318.2	300.6	285.4	277.8	277.8
65°	308.1	292.9	272.7	247.5	237.4	227.3	212.2	197.0	189.4	186.9
67.5°	217.2	199.5	181.9	161.7	154.0	149.0	133.8	123.8	118.7	116.1
70°	131.3	121.2	108.6	93.5	85.8	80.8	70.7	63.2	60.6	58.1
72.5°	68.2	60.6	50.5	40.4	35.3	30.3	25.2	20.2	17.7	17.7
75°	25.2	20.2	12.7	7.6	5.0	5.0	5.0	5.0	5.0	5.0
77.5°	5.0	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
80°	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)