

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.



Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW
 Description: 4 INCH 4000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3500K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 4004.0 lumens
 Efficiency: N/A
 Efficacy: 85.2 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 47
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

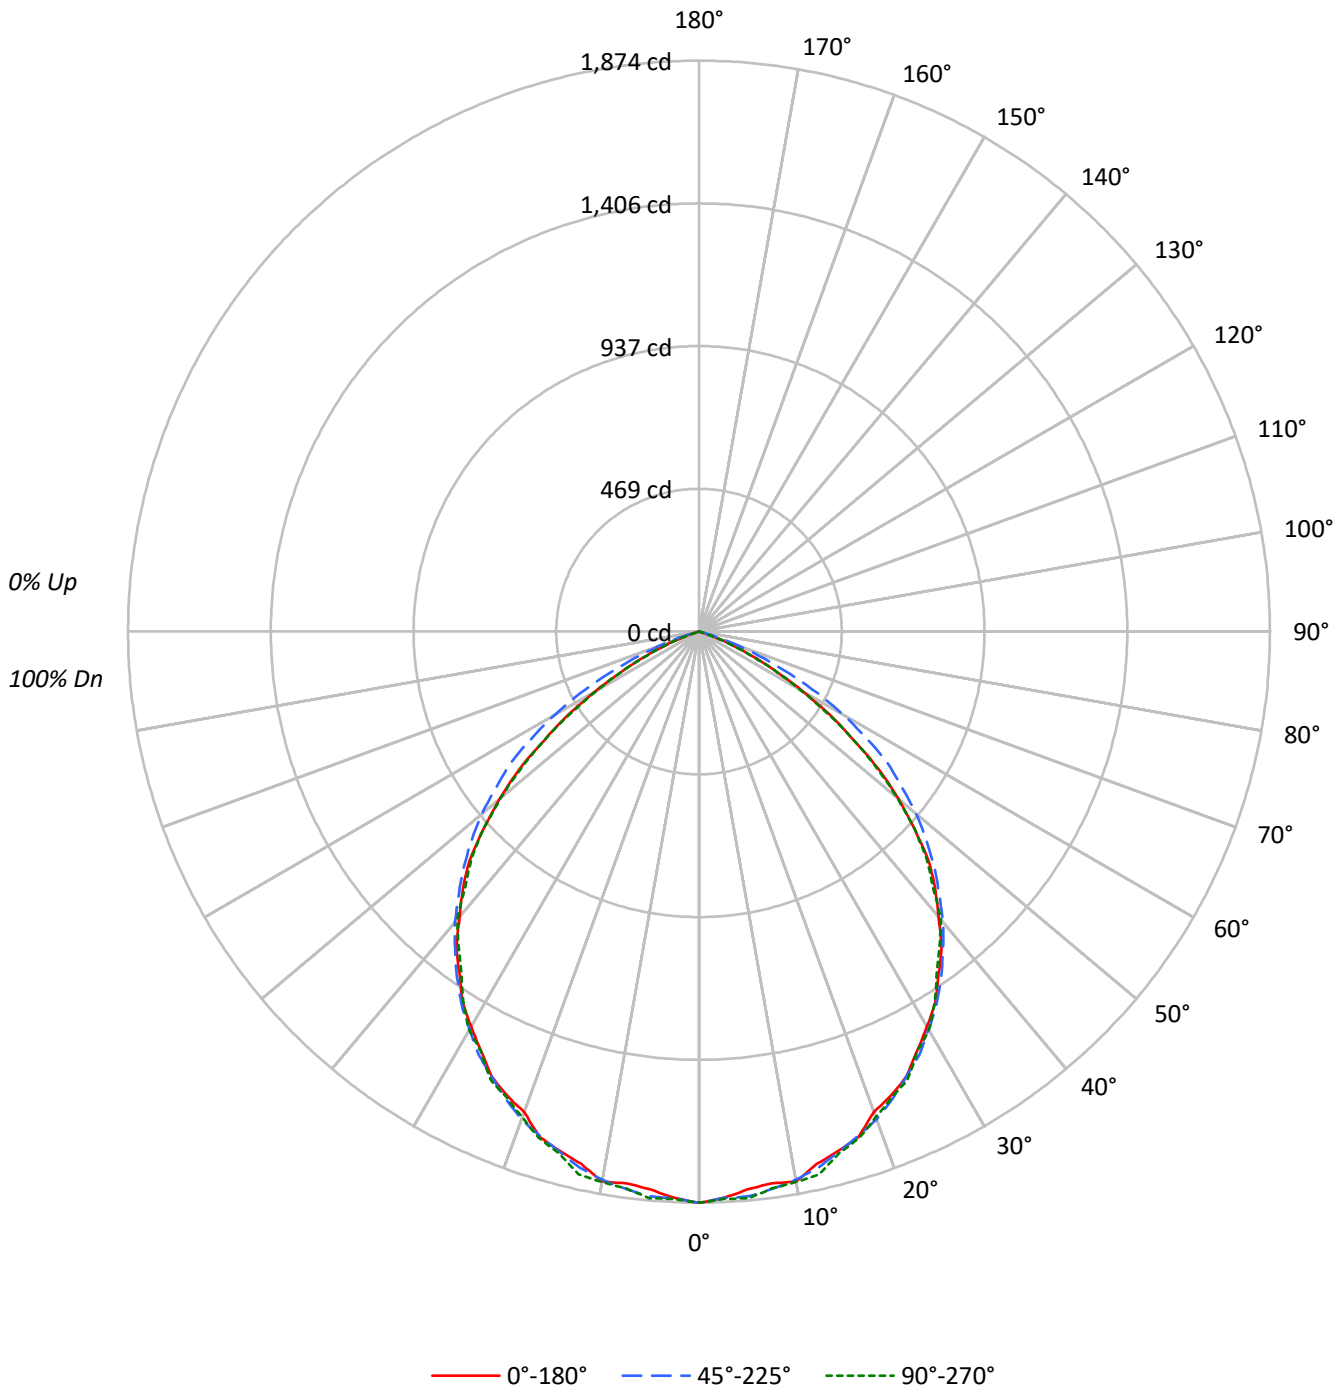

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	180859	180859	180859
5°	177937	180252	180775
10°	179475	178956	179730
15°	176331	176590	177130
20°	172227	174969	174148
25°	171492	171492	172620
30°	166711	167892	168193
35°	161504	163082	160255
40°	153932	156943	155595
45°	145680	148955	144234
50°	128299	139482	127503
55°	103912	127648	104366
60°	76033	105848	74509
65°	46210	75366	45000
70°	18027	40568	17294
75°	1976	10923	1976
80°	1500	1500	1500
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	176.9	4.4
10°-20°	500.7	12.5
20°-30°	742.9	18.6
30°-40°	860.8	21.5
40°-50°	825.3	20.6
50°-60°	606.8	15.2
60°-70°	262.1	6.5
70°-80°	28.3	0.7
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1420.4	35.5
0°-40°	2281.2	57.0
0°-60°	3713.3	92.7
0°-90°	4004.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4004.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1874	1874	1874	1874	1874	
5°	1837	1856	1861	1864	1866	175
15°	1765	1776	1768	1770	1773	498
25°	1611	1608	1611	1614	1621	737
35°	1371	1379	1384	1382	1360	857
45°	1068	1070	1092	1076	1057	812
55°	618	682	759	679	620	556
65°	202	253	330	250	197	208
75°	5	8	29	5	5	16
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4
2.5°	1861.0	1882.3	1885.0	1871.7	1866.4	1858.4	1877.0	1863.8	1869.1	1863.8	1861.0
5°	1837.1	1861.0	1863.8	1863.8	1858.4	1855.7	1863.8	1861.0	1858.4	1853.1	1861.0
7.5°	1826.5	1839.7	1853.1	1837.1	1845.1	1842.5	1861.0	1853.1	1850.4	1850.4	1845.1
10°	1831.8	1829.1	1839.7	1823.8	1829.1	1823.8	1839.7	1839.7	1834.4	1829.1	1826.5
12.5°	1789.1	1810.4	1810.4	1807.8	1802.5	1794.4	1810.4	1821.2	1805.1	1805.1	1802.5
15°	1765.2	1770.5	1773.2	1773.2	1770.5	1775.9	1783.8	1773.2	1775.9	1762.5	1767.8
17.5°	1738.6	1728.0	1735.9	1730.6	1733.3	1738.6	1749.3	1749.3	1733.3	1730.6	1735.9
20°	1677.3	1709.3	1712.0	1696.0	1698.6	1698.6	1717.3	1701.3	1712.0	1698.6	1704.0
22.5°	1648.0	1669.3	1672.0	1650.7	1664.0	1648.0	1666.7	1642.7	1669.3	1650.7	1658.7
25°	1610.8	1608.1	1616.1	1605.4	1608.1	1608.1	1621.4	1610.8	1618.8	1608.1	1610.8
27.5°	1549.6	1570.9	1568.2	1557.5	1562.8	1560.2	1586.9	1557.5	1573.5	1560.2	1565.6
30°	1496.3	1514.9	1509.6	1499.0	1499.0	1490.9	1520.3	1512.2	1509.6	1509.6	1506.9
32.5°	1443.0	1445.7	1440.4	1443.0	1445.7	1435.1	1459.0	1448.4	1445.7	1448.4	1451.1
35°	1371.1	1371.1	1376.4	1368.5	1379.2	1379.2	1400.4	1387.1	1384.5	1376.4	1384.5
37.5°	1307.2	1299.3	1301.9	1301.9	1307.2	1312.6	1323.2	1317.9	1317.9	1310.0	1315.3
40°	1222.1	1216.8	1224.7	1224.7	1232.7	1232.7	1243.4	1238.0	1246.0	1246.0	1246.0
42.5°	1147.6	1147.6	1142.2	1150.2	1152.9	1150.2	1168.8	1166.1	1168.8	1163.5	1166.1
45°	1067.6	1067.6	1062.3	1059.7	1072.9	1070.3	1091.6	1083.6	1094.2	1088.9	1091.6
47.5°	958.4	971.8	963.8	971.8	987.8	990.5	1003.7	998.4	1009.1	1001.1	1011.8
50°	854.7	854.7	862.6	873.3	889.2	892.0	907.9	918.6	923.9	926.5	929.2
52.5°	745.5	742.8	750.8	764.1	777.5	788.1	804.1	820.0	830.7	846.7	838.6
55°	617.7	623.0	631.0	647.0	668.3	681.5	694.9	716.2	734.9	742.8	758.8
57.5°	508.5	503.2	508.5	529.8	553.8	564.4	583.1	604.4	631.0	647.0	652.3
60°	394.0	396.7	402.0	420.7	439.3	455.3	463.3	497.8	521.9	537.8	548.5
62.5°	290.3	295.6	300.9	316.9	335.4	348.8	362.1	391.4	412.7	428.7	439.3
65°	202.4	205.0	213.0	221.0	239.6	252.9	263.5	287.5	308.8	322.2	330.1
67.5°	125.1	127.7	133.1	143.8	157.1	167.7	178.4	194.3	213.0	226.3	229.0
70°	63.9	66.6	69.2	77.2	87.9	93.2	101.1	114.5	127.7	138.4	143.8
72.5°	21.3	21.3	24.0	29.3	34.7	40.0	42.6	55.9	66.6	71.9	74.5
75°	5.3	5.3	5.3	5.3	5.3	8.0	8.0	16.0	21.3	26.6	29.3
77.5°	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	5.3	5.3
80°	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409035 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4	1874.4
2.5°	1874.4	1869.1	1866.4	1869.1	1869.1	1866.4	1874.4	1885.0	1898.3	1863.8
5°	1871.7	1866.4	1871.7	1855.7	1863.8	1858.4	1869.1	1866.4	1877.0	1866.4
7.5°	1863.8	1853.1	1855.7	1847.8	1858.4	1845.1	1853.1	1869.1	1858.4	1842.5
10°	1837.1	1831.8	1850.4	1823.8	1818.5	1829.1	1850.4	1834.4	1829.1	1834.4
12.5°	1810.4	1810.4	1818.5	1797.2	1799.8	1805.1	1815.7	1805.1	1810.4	1823.8
15°	1781.2	1775.9	1789.1	1773.2	1770.5	1765.2	1775.9	1775.9	1781.2	1773.2
17.5°	1746.5	1738.6	1738.6	1733.3	1730.6	1743.9	1749.3	1751.9	1754.6	1743.9
20°	1704.0	1701.3	1709.3	1701.3	1704.0	1706.7	1706.7	1701.3	1725.3	1696.0
22.5°	1658.7	1666.7	1656.1	1650.7	1656.1	1661.4	1661.4	1664.0	1658.7	1653.3
25°	1613.5	1618.8	1621.4	1605.4	1613.5	1605.4	1624.1	1626.7	1616.1	1621.4
27.5°	1573.5	1565.6	1562.8	1552.2	1557.5	1554.9	1557.5	1557.5	1573.5	1552.2
30°	1512.2	1504.3	1506.9	1499.0	1501.6	1499.0	1501.6	1501.6	1512.2	1509.6
32.5°	1453.7	1445.7	1448.4	1440.4	1440.4	1443.0	1437.7	1437.7	1445.7	1440.4
35°	1397.7	1379.2	1381.8	1379.2	1381.8	1371.1	1371.1	1368.5	1373.8	1360.5
37.5°	1317.9	1310.0	1307.2	1304.6	1307.2	1301.9	1307.2	1299.3	1307.2	1296.6
40°	1246.0	1240.7	1243.4	1227.4	1227.4	1230.0	1224.7	1222.1	1224.7	1235.3
42.5°	1174.2	1163.5	1158.2	1152.9	1155.5	1147.6	1144.8	1139.5	1144.8	1134.2
45°	1088.9	1088.9	1086.3	1072.9	1075.6	1075.6	1065.0	1054.4	1057.0	1057.0
47.5°	1011.8	1006.4	1003.7	990.5	987.8	985.2	974.4	966.5	966.5	958.4
50°	926.5	921.2	913.2	899.9	894.6	878.6	870.7	860.0	849.4	849.4
52.5°	846.7	828.0	817.3	796.0	788.1	780.1	758.8	750.8	742.8	734.9
55°	750.8	734.9	713.6	689.6	678.9	665.6	644.3	628.3	617.7	620.4
57.5°	657.6	631.0	609.7	577.8	564.4	556.4	535.1	513.8	503.2	503.2
60°	543.1	521.9	495.2	465.9	455.3	442.0	415.3	402.0	394.0	386.1
62.5°	434.0	418.0	394.0	356.7	348.8	335.4	316.9	300.9	292.9	292.9
65°	324.8	308.8	287.5	260.9	250.3	239.6	223.7	207.7	199.7	197.1
67.5°	229.0	210.3	191.7	170.4	162.4	157.1	141.1	130.5	125.1	122.4
70°	138.4	127.7	114.5	98.5	90.5	85.2	74.5	66.6	63.9	61.3
72.5°	71.9	63.9	53.2	42.6	37.3	31.9	26.6	21.3	18.7	18.7
75°	26.6	21.3	13.4	8.0	5.3	5.3	5.3	5.3	5.3	5.3
77.5°	5.3	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
80°	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)