

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW
 Description: 4 INCH 4000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 4000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 4010.0 lumens
 Efficiency: N/A
 Efficacy: 85.3 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 47
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

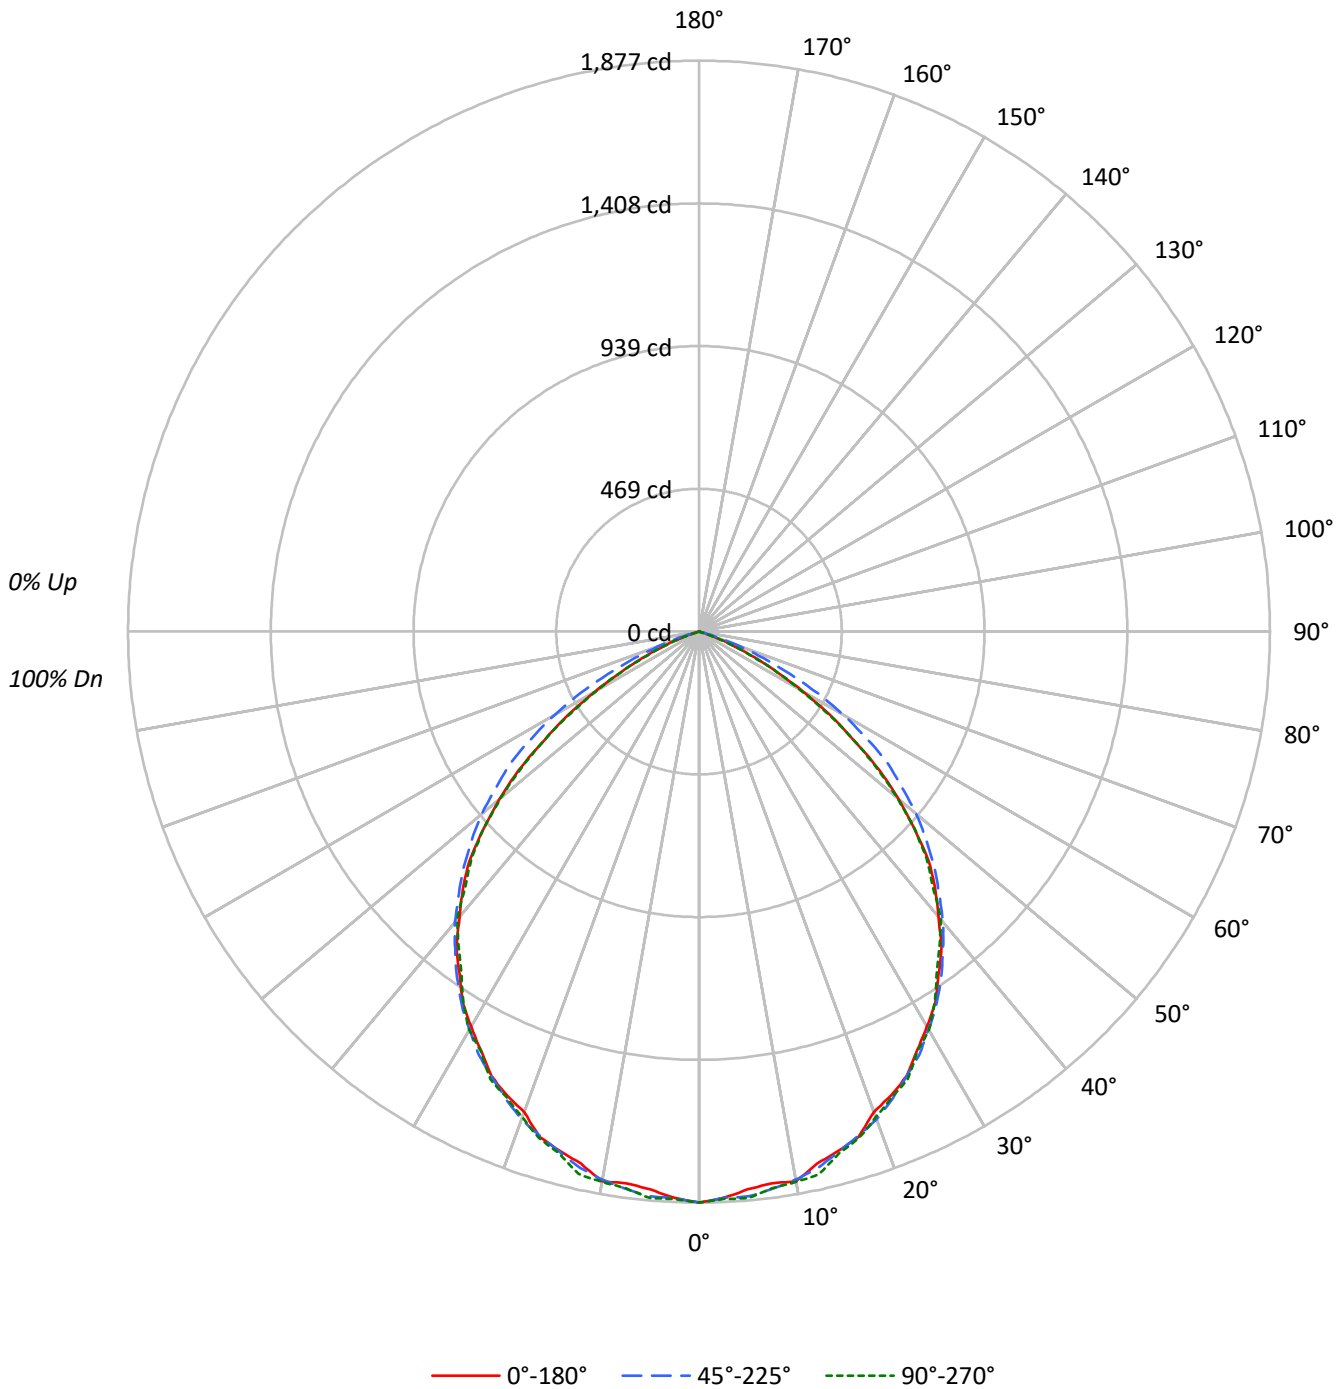

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	181129	181129	181129
5°	178208	180523	181046
10°	179749	179220	180004
15°	176600	176860	177389
20°	172494	175226	174415
25°	171747	171747	172876
30°	166957	168149	168450
35°	161751	163329	160490
40°	154159	157170	155834
45°	145899	149187	144439
50°	128494	139692	127684
55°	104063	127833	104517
60°	76149	106003	74605
65°	46279	75480	45046
70°	18055	40625	17322
75°	1976	10960	1976
80°	1500	1500	1500
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	177.2	4.4
10°-20°	501.4	12.5
20°-30°	744.0	18.6
30°-40°	862.0	21.5
40°-50°	826.5	20.6
50°-60°	607.7	15.2
60°-70°	262.5	6.5
70°-80°	28.3	0.7
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1422.6	35.5
0°-40°	2284.6	57.0
0°-60°	3718.8	92.7
0°-90°	4010.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4010.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1877	1877	1877	1877	1877	
5°	1840	1858	1864	1866	1869	176
15°	1768	1778	1770	1773	1776	498
25°	1613	1611	1613	1616	1624	739
35°	1373	1381	1387	1384	1362	859
45°	1069	1072	1093	1077	1058	813
55°	619	683	760	680	621	557
65°	203	253	331	251	197	208
75°	5	8	29	5	5	16
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2
2.5°	1863.8	1885.1	1887.9	1874.5	1869.2	1861.2	1879.8	1866.5	1871.9	1866.5	1863.8
5°	1839.9	1863.8	1866.5	1866.5	1861.2	1858.5	1866.5	1863.8	1861.2	1855.9	1863.8
7.5°	1829.2	1842.5	1855.9	1839.9	1847.8	1845.2	1863.8	1855.9	1853.2	1853.2	1847.8
10°	1834.6	1831.8	1842.5	1826.5	1831.8	1826.5	1842.5	1842.5	1837.2	1831.8	1829.2
12.5°	1791.8	1813.1	1813.1	1810.5	1805.2	1797.1	1813.1	1823.9	1807.8	1807.8	1805.2
15°	1767.9	1773.2	1775.8	1775.8	1773.2	1778.5	1786.5	1775.8	1778.5	1765.2	1770.5
17.5°	1741.2	1730.6	1738.5	1733.2	1735.9	1741.2	1751.9	1751.9	1735.9	1733.2	1738.5
20°	1679.9	1711.8	1714.6	1698.6	1701.2	1701.2	1719.9	1703.9	1714.6	1701.2	1706.5
22.5°	1650.5	1671.8	1674.5	1653.2	1666.5	1650.5	1669.2	1645.2	1671.8	1653.2	1661.1
25°	1613.2	1610.6	1618.5	1607.8	1610.6	1610.6	1623.8	1613.2	1621.2	1610.6	1613.2
27.5°	1551.9	1573.2	1570.5	1559.9	1565.2	1562.6	1589.2	1559.9	1575.9	1562.6	1567.9
30°	1498.5	1517.2	1511.9	1501.2	1501.2	1493.2	1522.5	1514.5	1511.9	1511.9	1509.2
32.5°	1445.2	1447.9	1442.6	1445.2	1447.9	1437.2	1461.2	1450.5	1447.9	1450.5	1453.2
35°	1373.2	1373.2	1378.5	1370.6	1381.2	1381.2	1402.5	1389.2	1386.6	1378.5	1386.6
37.5°	1309.2	1301.3	1303.9	1303.9	1309.2	1314.5	1325.2	1319.9	1319.9	1311.9	1317.3
40°	1223.9	1218.6	1226.5	1226.5	1234.6	1234.6	1245.2	1239.9	1247.8	1247.8	1247.8
42.5°	1149.3	1149.3	1143.9	1151.9	1154.6	1151.9	1170.6	1167.9	1170.6	1165.3	1167.9
45°	1069.2	1069.2	1063.9	1061.3	1074.5	1071.9	1093.3	1085.2	1095.9	1090.5	1093.3
47.5°	959.9	973.3	965.2	973.3	989.2	992.0	1005.2	999.9	1010.6	1002.6	1013.3
50°	856.0	856.0	863.9	874.6	890.6	893.3	909.3	919.9	925.3	927.9	930.6
52.5°	746.6	743.9	752.0	765.2	778.6	789.3	805.3	821.3	831.9	847.9	839.9
55°	618.6	623.9	632.0	648.0	669.3	682.6	695.9	717.3	736.0	743.9	759.9
57.5°	509.3	503.9	509.3	530.6	554.6	565.3	584.0	605.3	632.0	648.0	653.3
60°	394.6	397.3	402.6	421.3	440.0	455.9	464.0	498.6	522.6	538.6	549.3
62.5°	290.7	296.0	301.4	317.3	336.0	349.3	362.6	392.0	413.3	429.3	440.0
65°	202.7	205.3	213.3	221.3	240.0	253.3	263.9	288.0	309.3	322.7	330.6
67.5°	125.3	127.9	133.3	144.0	157.3	168.0	178.6	194.6	213.3	226.6	229.3
70°	64.0	66.7	69.3	77.4	88.0	93.3	101.3	114.7	127.9	138.6	144.0
72.5°	21.3	21.3	24.0	29.4	34.7	40.0	42.6	56.0	66.7	72.0	74.6
75°	5.3	5.3	5.3	5.3	5.3	8.0	8.0	16.0	21.3	26.7	29.4
77.5°	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	5.3	5.3
80°	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C40D010 FEU4C409040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2	1877.2
2.5°	1877.2	1871.9	1869.2	1871.9	1871.9	1869.2	1877.2	1887.9	1901.1	1866.5
5°	1874.5	1869.2	1874.5	1858.5	1866.5	1861.2	1871.9	1869.2	1879.8	1869.2
7.5°	1866.5	1855.9	1858.5	1850.6	1861.2	1847.8	1855.9	1871.9	1861.2	1845.2
10°	1839.9	1834.6	1853.2	1826.5	1821.2	1831.8	1853.2	1837.2	1831.8	1837.2
12.5°	1813.1	1813.1	1821.2	1799.9	1802.5	1807.8	1818.5	1807.8	1813.1	1826.5
15°	1783.9	1778.5	1791.8	1775.8	1773.2	1767.9	1778.5	1778.5	1783.9	1775.8
17.5°	1749.2	1741.2	1741.2	1735.9	1733.2	1746.5	1751.9	1754.5	1757.2	1746.5
20°	1706.5	1703.9	1711.8	1703.9	1706.5	1709.2	1709.2	1703.9	1727.8	1698.6
22.5°	1661.1	1669.2	1658.5	1653.2	1658.5	1663.9	1663.9	1666.5	1661.1	1655.8
25°	1615.9	1621.2	1623.8	1607.8	1615.9	1607.8	1626.5	1629.2	1618.5	1623.8
27.5°	1575.9	1567.9	1565.2	1554.5	1559.9	1557.2	1559.9	1559.9	1575.9	1554.5
30°	1514.5	1506.6	1509.2	1501.2	1503.8	1501.2	1503.8	1503.8	1514.5	1511.9
32.5°	1455.9	1447.9	1450.5	1442.6	1442.6	1445.2	1439.9	1439.9	1447.9	1442.6
35°	1399.8	1381.2	1383.8	1381.2	1383.8	1373.2	1373.2	1370.6	1375.9	1362.5
37.5°	1319.9	1311.9	1309.2	1306.6	1309.2	1303.9	1309.2	1301.3	1309.2	1298.5
40°	1247.8	1242.5	1245.2	1229.2	1229.2	1231.9	1226.5	1223.9	1226.5	1237.2
42.5°	1175.9	1165.3	1159.9	1154.6	1157.2	1149.3	1146.6	1141.2	1146.6	1135.9
45°	1090.5	1090.5	1087.9	1074.5	1077.3	1077.3	1066.6	1055.9	1058.5	1058.5
47.5°	1013.3	1008.0	1005.2	992.0	989.2	986.6	975.9	967.9	967.9	959.9
50°	927.9	922.6	914.6	901.2	895.9	879.9	872.0	861.3	850.6	850.6
52.5°	847.9	829.2	818.6	797.2	789.3	781.2	759.9	752.0	743.9	736.0
55°	752.0	736.0	714.7	690.6	679.9	666.6	645.2	629.3	618.6	621.3
57.5°	658.6	632.0	610.6	578.7	565.3	557.2	535.9	514.6	503.9	503.9
60°	544.0	522.6	496.0	466.6	455.9	442.7	415.9	402.6	394.6	386.6
62.5°	434.6	418.6	394.6	357.3	349.3	336.0	317.3	301.4	293.3	293.3
65°	325.3	309.3	288.0	261.3	250.7	240.0	224.0	208.0	200.0	197.3
67.5°	229.3	210.6	192.0	170.7	162.6	157.3	141.3	130.7	125.3	122.6
70°	138.6	127.9	114.7	98.7	90.6	85.3	74.6	66.7	64.0	61.4
72.5°	72.0	64.0	53.3	42.6	37.3	32.0	26.7	21.3	18.7	18.7
75°	26.7	21.3	13.4	8.0	5.3	5.3	5.3	5.3	5.3	5.3
77.5°	5.3	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
80°	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)