

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW
 Description: 4 INCH 4500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 5000K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 4738.0 lumens
 Efficiency: N/A
 Efficacy: 95.5 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 49.6
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

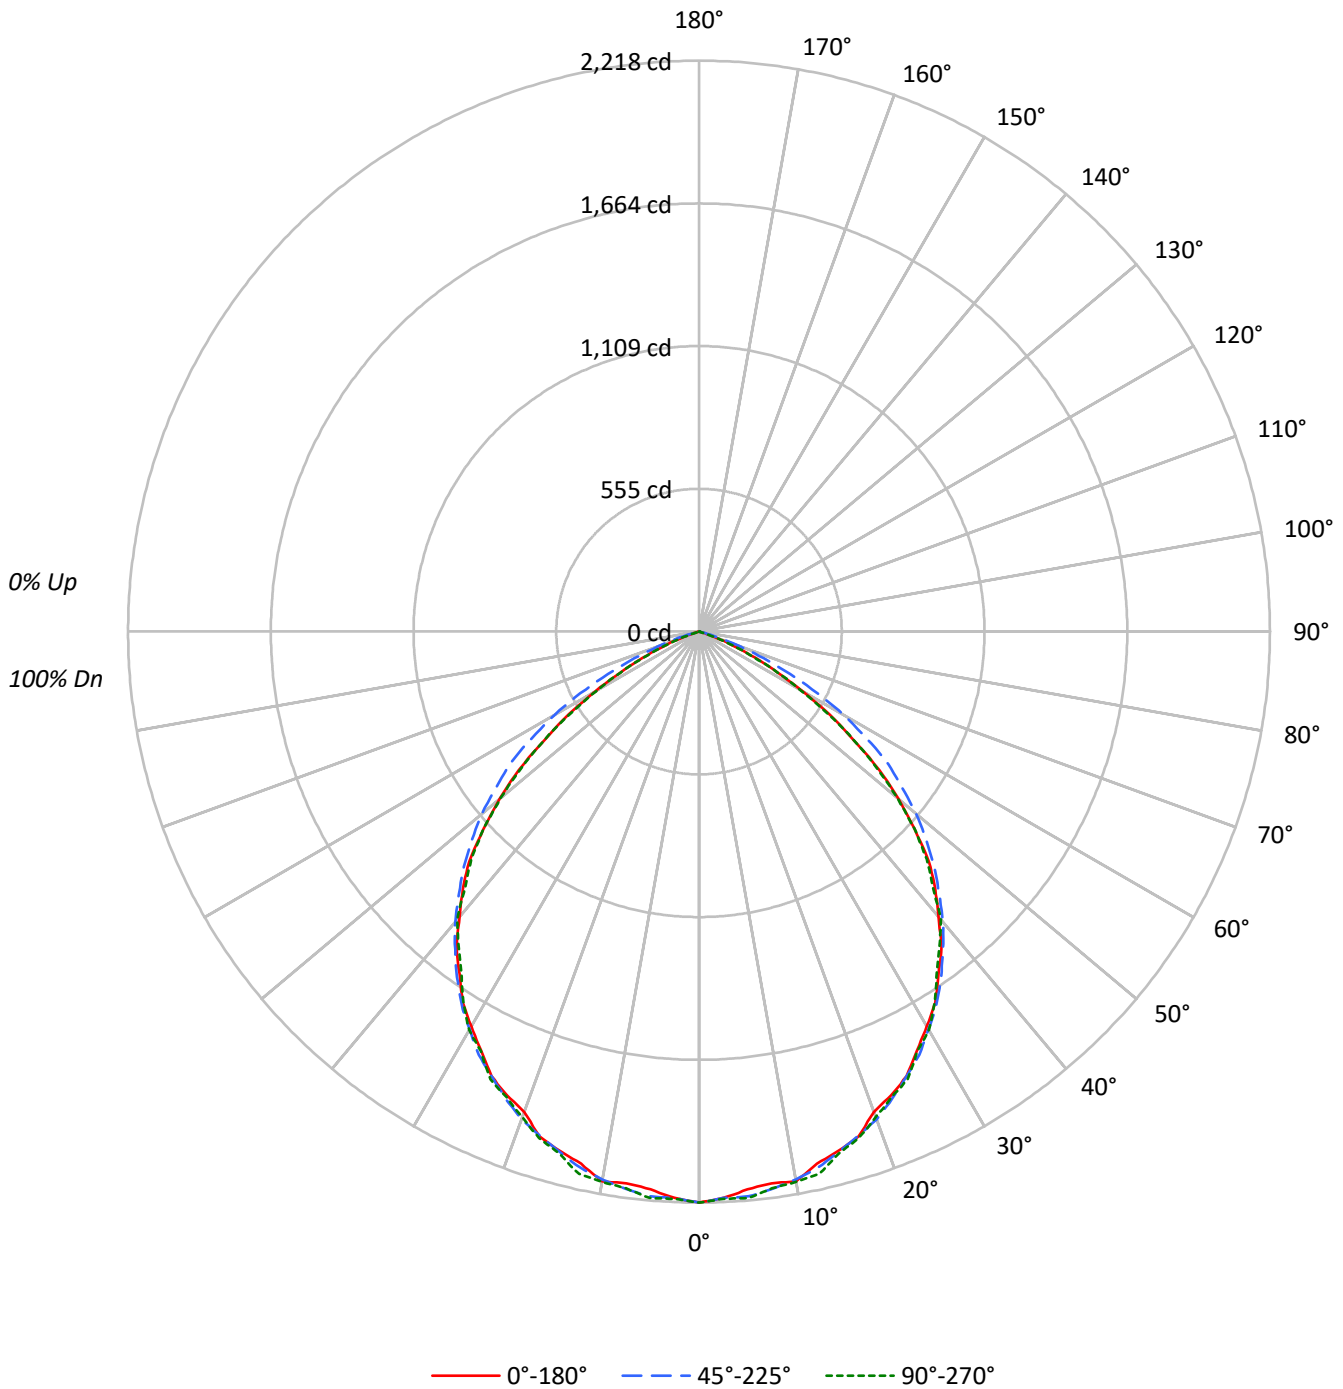

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	214012	214012	214012
5°	210558	213300	213910
10°	212376	211759	212680
15°	208656	208965	209595
20°	203802	207036	206071
25°	202920	202920	204261
30°	197273	198665	199033
35°	191116	192977	189632
40°	182147	185711	184124
45°	172385	176260	170665
50°	151821	165061	150876
55°	122954	151048	123493
60°	89966	125243	88152
65°	54681	89179	53242
70°	21328	48016	20453
75°	2349	12936	2349
80°	1778	1778	1778
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.4	4.4
10°-20°	592.4	12.5
20°-30°	879.0	18.6
30°-40°	1018.6	21.5
40°-50°	976.6	20.6
50°-60°	718.0	15.2
60°-70°	310.1	6.5
70°-80°	33.5	0.7
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1680.8	35.5
0°-40°	2699.4	57.0
0°-60°	4394.0	92.7
0°-90°	4738.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4738.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2218	2218	2218	2218	2218	
5°	2174	2196	2202	2205	2208	207
15°	2089	2101	2092	2095	2098	589
25°	1906	1903	1906	1909	1919	873
35°	1622	1632	1638	1635	1610	1015
45°	1263	1266	1292	1273	1251	960
55°	731	806	898	803	734	658
65°	240	299	391	296	233	246
75°	6	10	35	6	6	19
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0
2.5°	2202.2	2227.4	2230.6	2214.8	2208.5	2199.1	2221.1	2205.4	2211.7	2205.4	2202.2
5°	2173.9	2202.2	2205.4	2205.4	2199.1	2195.9	2205.4	2202.2	2199.1	2192.8	2202.2
7.5°	2161.3	2177.0	2192.8	2173.9	2183.3	2180.2	2202.2	2192.8	2189.6	2189.6	2183.3
10°	2167.6	2164.4	2177.0	2158.1	2164.4	2158.1	2177.0	2177.0	2170.7	2164.4	2161.3
12.5°	2117.1	2142.3	2142.3	2139.2	2132.9	2123.4	2142.3	2155.0	2136.0	2136.0	2132.9
15°	2088.8	2095.1	2098.2	2098.2	2095.1	2101.4	2110.8	2098.2	2101.4	2085.6	2091.9
17.5°	2057.3	2044.7	2054.1	2047.8	2051.0	2057.3	2069.9	2069.9	2051.0	2047.8	2054.1
20°	1984.8	2022.6	2025.8	2006.9	2010.0	2010.0	2032.1	2013.2	2025.8	2010.0	2016.3
22.5°	1950.1	1975.3	1978.5	1953.3	1969.0	1950.1	1972.2	1943.8	1975.3	1953.3	1962.7
25°	1906.0	1902.9	1912.3	1899.7	1902.9	1902.9	1918.6	1906.0	1915.5	1902.9	1906.0
27.5°	1833.7	1858.9	1855.6	1843.0	1849.3	1846.3	1877.8	1843.0	1861.9	1846.3	1852.6
30°	1770.6	1792.7	1786.4	1773.8	1773.8	1764.3	1799.0	1789.4	1786.4	1786.4	1783.1
32.5°	1707.6	1710.8	1704.5	1707.6	1710.8	1698.2	1726.5	1713.9	1710.8	1713.9	1717.1
35°	1622.5	1622.5	1628.8	1619.4	1632.0	1632.0	1657.2	1641.4	1638.3	1628.8	1638.3
37.5°	1546.9	1537.5	1540.6	1540.6	1546.9	1553.2	1565.8	1559.5	1559.5	1550.1	1556.4
40°	1446.1	1439.8	1449.2	1449.2	1458.7	1458.7	1471.3	1465.0	1474.4	1474.4	1474.4
42.5°	1357.9	1357.9	1351.6	1361.0	1364.2	1361.0	1383.1	1379.9	1383.1	1376.8	1379.9
45°	1263.3	1263.3	1257.0	1253.9	1269.6	1266.5	1291.7	1282.2	1294.8	1288.5	1291.7
47.5°	1134.1	1149.9	1140.4	1149.9	1168.8	1172.1	1187.7	1181.4	1194.0	1184.6	1197.2
50°	1011.4	1011.4	1020.8	1033.4	1052.3	1055.5	1074.4	1087.0	1093.3	1096.3	1099.6
52.5°	882.2	879.0	888.5	904.2	920.0	932.6	951.5	970.4	983.0	1001.9	992.4
55°	730.9	737.2	746.7	765.6	790.8	806.5	822.3	847.5	869.6	879.0	897.9
57.5°	601.7	595.4	601.7	626.9	655.3	667.9	690.0	715.2	746.7	765.6	771.9
60°	466.2	469.4	475.7	497.8	519.8	538.7	548.2	589.1	617.5	636.4	649.0
62.5°	343.5	349.8	356.1	375.0	396.9	412.7	428.4	463.1	488.3	507.2	519.8
65°	239.5	242.6	252.1	261.5	283.6	299.2	311.8	340.3	365.4	381.3	390.6
67.5°	148.1	151.2	157.5	170.2	185.9	198.5	211.1	230.0	252.1	267.8	271.0
70°	75.6	78.8	81.9	91.4	104.0	110.3	119.7	135.5	151.2	163.8	170.2
72.5°	25.2	25.2	28.4	34.7	41.0	47.3	50.4	66.2	78.8	85.1	88.2
75°	6.3	6.3	6.3	6.3	6.3	9.5	9.5	18.9	25.2	31.5	34.7
77.5°	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	6.3	6.3
80°	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C45D010 FEU4C459050 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0	2218.0
2.5°	2218.0	2211.7	2208.5	2211.7	2211.7	2208.5	2218.0	2230.6	2246.3	2205.4
5°	2214.8	2208.5	2214.8	2195.9	2205.4	2199.1	2211.7	2208.5	2221.1	2208.5
7.5°	2205.4	2192.8	2195.9	2186.5	2199.1	2183.3	2192.8	2211.7	2199.1	2180.2
10°	2173.9	2167.6	2189.6	2158.1	2151.8	2164.4	2189.6	2170.7	2164.4	2170.7
12.5°	2142.3	2142.3	2151.8	2126.6	2129.7	2136.0	2148.6	2136.0	2142.3	2158.1
15°	2107.7	2101.4	2117.1	2098.2	2095.1	2088.8	2101.4	2101.4	2107.7	2098.2
17.5°	2066.7	2057.3	2057.3	2051.0	2047.8	2063.6	2069.9	2073.0	2076.2	2063.6
20°	2016.3	2013.2	2022.6	2013.2	2016.3	2019.5	2019.5	2013.2	2041.5	2006.9
22.5°	1962.7	1972.2	1959.6	1953.3	1959.6	1965.9	1965.9	1969.0	1962.7	1956.4
25°	1909.2	1915.5	1918.6	1899.7	1909.2	1899.7	1921.8	1924.9	1912.3	1918.6
27.5°	1861.9	1852.6	1849.3	1836.7	1843.0	1840.0	1843.0	1843.0	1861.9	1836.7
30°	1789.4	1780.1	1783.1	1773.8	1776.8	1773.8	1776.8	1776.8	1789.4	1786.4
32.5°	1720.2	1710.8	1713.9	1704.5	1704.5	1707.6	1701.3	1701.3	1710.8	1704.5
35°	1654.0	1632.0	1635.1	1632.0	1635.1	1622.5	1622.5	1619.4	1625.7	1609.9
37.5°	1559.5	1550.1	1546.9	1543.8	1546.9	1540.6	1546.9	1537.5	1546.9	1534.3
40°	1474.4	1468.1	1471.3	1452.4	1452.4	1455.5	1449.2	1446.1	1449.2	1461.8
42.5°	1389.4	1376.8	1370.5	1364.2	1367.3	1357.9	1354.7	1348.4	1354.7	1342.1
45°	1288.5	1288.5	1285.4	1269.6	1272.8	1272.8	1260.2	1247.6	1250.7	1250.7
47.5°	1197.2	1190.9	1187.7	1172.1	1168.8	1165.8	1153.0	1143.6	1143.6	1134.1
50°	1096.3	1090.0	1080.7	1064.8	1058.6	1039.7	1030.3	1017.7	1005.1	1005.1
52.5°	1001.9	979.8	967.2	942.0	932.6	923.1	897.9	888.5	879.0	869.6
55°	888.5	869.6	844.4	816.0	803.4	787.6	762.4	743.5	730.9	734.1
57.5°	778.2	746.7	721.5	683.7	667.9	658.4	633.2	608.0	595.4	595.4
60°	642.7	617.5	586.0	551.3	538.7	523.0	491.4	475.7	466.2	456.8
62.5°	513.5	494.6	466.2	422.1	412.7	396.9	375.0	356.1	346.6	346.6
65°	384.3	365.4	340.3	308.8	296.2	283.6	264.7	245.8	236.3	233.2
67.5°	271.0	248.9	226.9	201.7	192.2	185.9	167.0	154.4	148.1	144.9
70°	163.8	151.2	135.5	116.6	107.1	100.8	88.2	78.8	75.6	72.5
72.5°	85.1	75.6	63.0	50.4	44.1	37.8	31.5	25.2	22.1	22.1
75°	31.5	25.2	15.8	9.5	6.3	6.3	6.3	6.3	6.3	6.3
77.5°	6.3	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
80°	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)