

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW
 Description: 4 INCH 5000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 2700K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 4980.0 lumens
 Efficiency: N/A
 Efficacy: 85.3 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 58.4
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

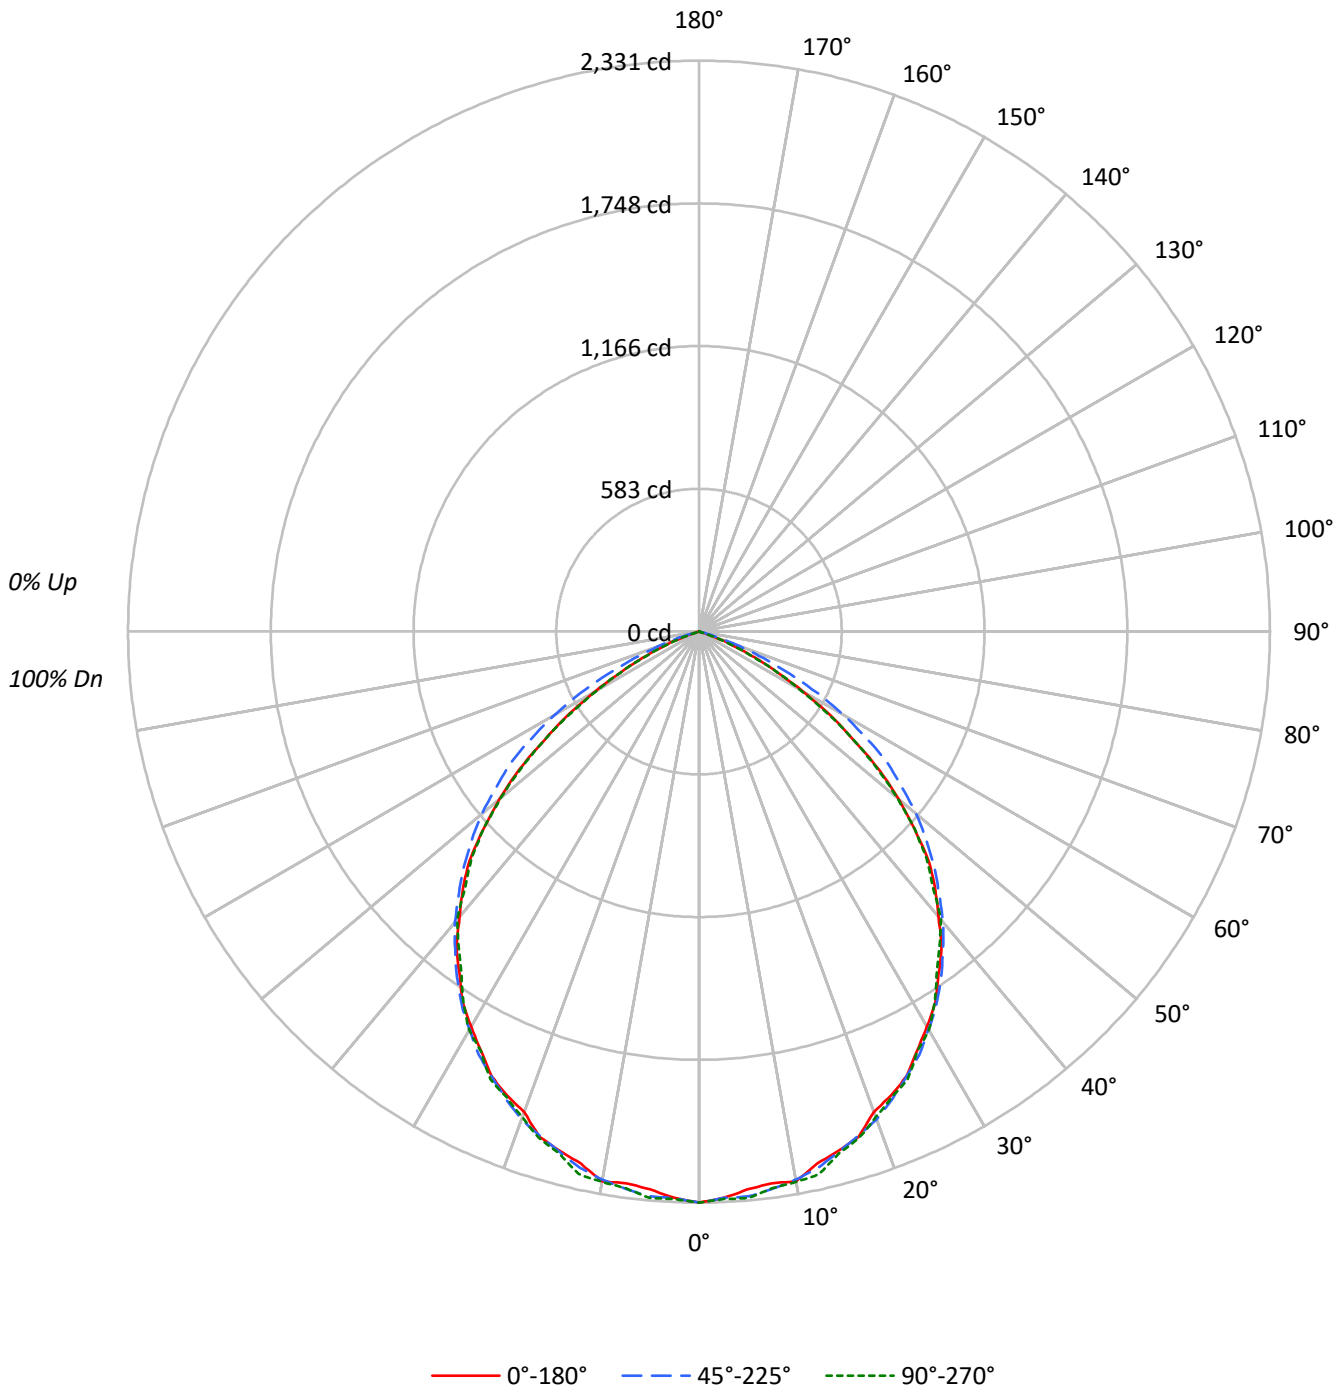

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	224945	224945	224945
5°	221310	224196	224835
10°	223222	222575	223545
15°	219314	219644	220303
20°	214214	217613	216596
25°	213289	213289	214695
30°	207345	208815	209194
35°	200869	202836	199314
40°	191455	195196	193533
45°	181186	185266	179385
50°	159567	173482	158576
55°	129229	158752	129801
60°	94559	131649	92668
65°	57466	93745	55959
70°	22400	50470	21497
75°	2461	13607	2461
80°	1889	1889	1889
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.1	4.4
10°-20°	622.7	12.5
20°-30°	923.9	18.6
30°-40°	1070.6	21.5
40°-50°	1026.4	20.6
50°-60°	754.7	15.2
60°-70°	326.0	6.5
70°-80°	35.2	0.7
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1766.7	35.5
0°-40°	2837.3	57.0
0°-60°	4618.4	92.7
0°-90°	4980.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4980.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2331	2331	2331	2331	2331	
5°	2285	2308	2315	2318	2321	218
15°	2196	2209	2199	2202	2205	619
25°	2003	2000	2003	2007	2017	917
35°	1705	1715	1722	1719	1692	1066
45°	1328	1331	1358	1338	1315	1009
55°	768	848	944	844	772	691
65°	252	314	411	311	245	259
75°	7	10	36	7	7	20
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3
2.5°	2314.7	2341.2	2344.5	2327.9	2321.3	2311.4	2334.5	2318.1	2324.7	2318.1	2314.7
5°	2284.9	2314.7	2318.1	2318.1	2311.4	2308.1	2318.1	2314.7	2311.4	2304.8	2314.7
7.5°	2271.7	2288.2	2304.8	2284.9	2294.8	2291.6	2314.7	2304.8	2301.4	2301.4	2294.8
10°	2278.3	2275.0	2288.2	2268.3	2275.0	2268.3	2288.2	2288.2	2281.6	2275.0	2271.7
12.5°	2225.2	2251.7	2251.7	2248.5	2241.9	2231.9	2251.7	2265.1	2245.1	2245.1	2241.9
15°	2195.5	2202.1	2205.4	2205.4	2202.1	2208.7	2218.6	2205.4	2208.7	2192.1	2198.8
17.5°	2162.4	2149.2	2159.0	2152.4	2155.8	2162.4	2175.6	2175.6	2155.8	2152.4	2159.0
20°	2086.2	2125.9	2129.3	2109.4	2112.7	2112.7	2135.9	2116.1	2129.3	2112.7	2119.3
22.5°	2049.7	2076.2	2079.6	2053.1	2069.6	2049.7	2073.0	2043.1	2076.2	2053.1	2063.0
25°	2003.4	2000.1	2010.0	1996.8	2000.1	2000.1	2016.6	2003.4	2013.4	2000.1	2003.4
27.5°	1927.3	1953.8	1950.4	1937.2	1943.8	1940.6	1973.7	1937.2	1957.0	1940.6	1947.2
30°	1861.0	1884.2	1877.6	1864.4	1864.4	1854.4	1890.8	1880.8	1877.6	1877.6	1874.2
32.5°	1794.8	1798.2	1791.5	1794.8	1798.2	1784.9	1814.6	1801.4	1798.2	1801.4	1804.8
35°	1705.3	1705.3	1712.0	1702.1	1715.3	1715.3	1741.8	1725.2	1722.0	1712.0	1722.0
37.5°	1625.9	1616.0	1619.3	1619.3	1625.9	1632.5	1645.8	1639.1	1639.1	1629.3	1635.9
40°	1520.0	1513.3	1523.2	1523.2	1533.2	1533.2	1546.4	1539.8	1549.7	1549.7	1549.7
42.5°	1427.3	1427.3	1420.7	1430.5	1433.9	1430.5	1453.8	1450.4	1453.8	1447.1	1450.4
45°	1327.8	1327.8	1321.2	1318.0	1334.5	1331.2	1357.7	1347.7	1360.9	1354.3	1357.7
47.5°	1192.1	1208.7	1198.7	1208.7	1228.5	1231.9	1248.4	1241.8	1255.0	1245.2	1258.4
50°	1063.0	1063.0	1072.9	1086.1	1106.0	1109.4	1129.2	1142.5	1149.1	1152.3	1155.7
52.5°	927.2	923.9	933.9	950.4	967.0	980.2	1000.1	1019.9	1033.2	1053.0	1043.0
55°	768.2	774.8	784.8	804.7	831.2	847.7	864.3	890.8	914.0	923.9	943.7
57.5°	632.4	625.8	632.4	658.9	688.8	702.0	725.3	751.7	784.8	804.7	811.3
60°	490.0	493.4	500.0	523.3	546.4	566.2	576.2	619.2	649.1	668.9	682.2
62.5°	361.0	367.6	374.2	394.1	417.2	433.8	450.3	486.8	513.3	533.1	546.4
65°	251.7	255.0	264.9	274.8	298.0	314.5	327.8	357.6	384.1	400.7	410.6
67.5°	155.6	158.9	165.5	178.9	195.4	208.6	221.8	241.7	264.9	281.4	284.8
70°	79.4	82.8	86.1	96.1	109.3	115.9	125.8	142.4	158.9	172.1	178.9
72.5°	26.5	26.5	29.9	36.5	43.1	49.7	53.0	69.6	82.8	89.4	92.7
75°	6.6	6.6	6.6	6.6	6.6	10.0	10.0	19.9	26.5	33.1	36.5
77.5°	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	6.6	6.6
80°	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C50D010 FEU4C509027 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3	2331.3
2.5°	2331.3	2324.7	2321.3	2324.7	2324.7	2321.3	2331.3	2344.5	2361.0	2318.1
5°	2327.9	2321.3	2327.9	2308.1	2318.1	2311.4	2324.7	2321.3	2334.5	2321.3
7.5°	2318.1	2304.8	2308.1	2298.2	2311.4	2294.8	2304.8	2324.7	2311.4	2291.6
10°	2284.9	2278.3	2301.4	2268.3	2261.7	2275.0	2301.4	2281.6	2275.0	2281.6
12.5°	2251.7	2251.7	2261.7	2235.2	2238.5	2245.1	2258.3	2245.1	2251.7	2268.3
15°	2215.4	2208.7	2225.2	2205.4	2202.1	2195.5	2208.7	2208.7	2215.4	2205.4
17.5°	2172.3	2162.4	2162.4	2155.8	2152.4	2169.0	2175.6	2178.9	2182.3	2169.0
20°	2119.3	2116.1	2125.9	2116.1	2119.3	2122.7	2122.7	2116.1	2145.8	2109.4
22.5°	2063.0	2073.0	2059.7	2053.1	2059.7	2066.3	2066.3	2069.6	2063.0	2056.4
25°	2006.8	2013.4	2016.6	1996.8	2006.8	1996.8	2020.0	2023.2	2010.0	2016.6
27.5°	1957.0	1947.2	1943.8	1930.6	1937.2	1933.9	1937.2	1937.2	1957.0	1930.6
30°	1880.8	1871.0	1874.2	1864.4	1867.6	1864.4	1867.6	1867.6	1880.8	1877.6
32.5°	1808.0	1798.2	1801.4	1791.5	1791.5	1794.8	1788.2	1788.2	1798.2	1791.5
35°	1738.4	1715.3	1718.6	1715.3	1718.6	1705.3	1705.3	1702.1	1708.7	1692.1
37.5°	1639.1	1629.3	1625.9	1622.6	1625.9	1619.3	1625.9	1616.0	1625.9	1612.7
40°	1549.7	1543.1	1546.4	1526.6	1526.6	1529.8	1523.2	1520.0	1523.2	1536.5
42.5°	1460.4	1447.1	1440.5	1433.9	1437.1	1427.3	1423.9	1417.3	1423.9	1410.7
45°	1354.3	1354.3	1351.1	1334.5	1337.8	1337.8	1324.6	1311.4	1314.6	1314.6
47.5°	1258.4	1251.8	1248.4	1231.9	1228.5	1225.3	1211.9	1202.1	1202.1	1192.1
50°	1152.3	1145.7	1135.9	1119.2	1112.6	1092.8	1082.9	1069.7	1056.4	1056.4
52.5°	1053.0	1029.8	1016.6	990.1	980.2	970.2	943.7	933.9	923.9	914.0
55°	933.9	914.0	887.5	857.7	844.4	827.8	801.3	781.5	768.2	771.6
57.5°	817.9	784.8	758.4	718.6	702.0	692.0	665.5	639.1	625.8	625.8
60°	675.5	649.1	616.0	579.5	566.2	549.8	516.5	500.0	490.0	480.2
62.5°	539.8	519.9	490.0	443.7	433.8	417.2	394.1	374.2	364.3	364.3
65°	404.0	384.1	357.6	324.5	311.3	298.0	278.2	258.3	248.3	245.1
67.5°	284.8	261.6	238.5	212.0	202.0	195.4	175.5	162.3	155.6	152.3
70°	172.1	158.9	142.4	122.5	112.5	105.9	92.7	82.8	79.4	76.2
72.5°	89.4	79.4	66.2	53.0	46.3	39.7	33.1	26.5	23.2	23.2
75°	33.1	26.5	16.6	10.0	6.6	6.6	6.6	6.6	6.6	6.6
77.5°	6.6	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4
80°	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)