

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.



Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW
 Description: 4 INCH 5500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 4000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 5878.0 lumens
 Efficiency: N/A
 Efficacy: 92.0 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 63.9
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

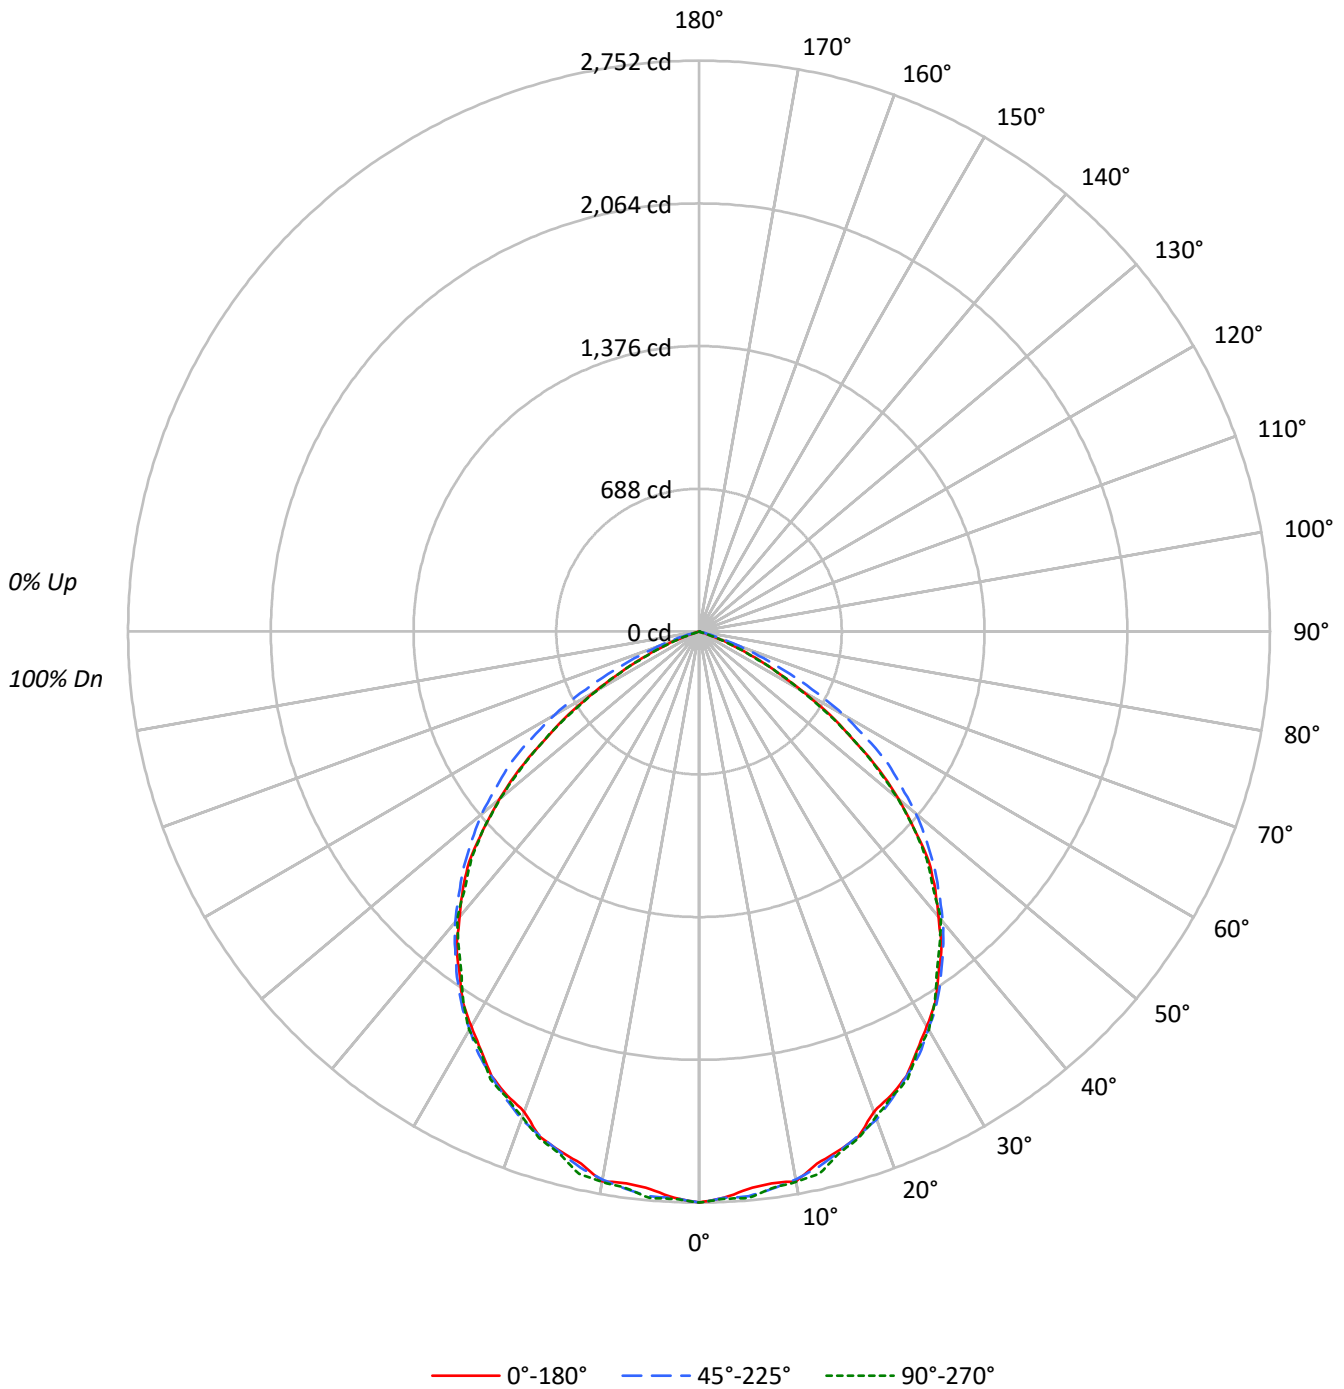

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	265508	265508	265508
5°	261225	264624	265380
10°	263481	262707	263853
15°	258862	259241	260031
20°	252843	256857	255656
25°	251744	251744	253416
30°	244736	246474	246920
35°	237090	239411	235253
40°	225980	230389	228424
45°	213867	218671	211739
50°	188343	204765	187172
55°	152545	187384	153201
60°	111618	155386	109380
65°	67832	110640	66051
70°	26462	59554	25362
75°	2908	16068	2908
80°	2223	2223	2223
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	259.7	4.4
10°-20°	735.0	12.5
20°-30°	1090.5	18.6
30°-40°	1263.6	21.5
40°-50°	1211.5	20.6
50°-60°	890.8	15.2
60°-70°	384.7	6.5
70°-80°	41.5	0.7
80°-90°	0.5	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2085.3	35.5
0°-40°	3348.9	57.0
0°-60°	5451.2	92.7
0°-90°	5878.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5878.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2752	2752	2752	2752	2752	
5°	2697	2724	2732	2736	2740	257
15°	2591	2607	2595	2599	2603	730
25°	2365	2361	2365	2369	2380	1083
35°	2013	2025	2032	2028	1997	1259
45°	1567	1571	1602	1579	1552	1191
55°	907	1000	1114	997	911	816
65°	297	371	485	367	289	305
75°	8	12	43	8	8	24
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7
2.5°	2732.1	2763.3	2767.3	2747.7	2739.9	2728.2	2755.5	2736.0	2743.9	2736.0	2732.1
5°	2697.0	2732.1	2736.0	2736.0	2728.2	2724.2	2736.0	2732.1	2728.2	2720.4	2732.1
7.5°	2681.3	2700.8	2720.4	2697.0	2708.6	2704.8	2732.1	2720.4	2716.4	2716.4	2708.6
10°	2689.2	2685.2	2700.8	2677.4	2685.2	2677.4	2700.8	2700.8	2693.0	2685.2	2681.3
12.5°	2626.5	2657.7	2657.7	2653.9	2646.1	2634.3	2657.7	2673.5	2649.9	2649.9	2646.1
15°	2591.4	2599.2	2603.1	2603.1	2599.2	2607.0	2618.7	2603.1	2607.0	2587.4	2595.2
17.5°	2552.3	2536.7	2548.4	2540.5	2544.5	2552.3	2568.0	2568.0	2544.5	2540.5	2548.4
20°	2462.4	2509.3	2513.3	2489.8	2493.7	2493.7	2521.1	2497.6	2513.3	2493.7	2501.5
22.5°	2419.3	2450.6	2454.6	2423.3	2442.8	2419.3	2446.8	2411.5	2450.6	2423.3	2435.0
25°	2364.6	2360.8	2372.5	2356.8	2360.8	2360.8	2380.3	2364.6	2376.4	2360.8	2364.6
27.5°	2274.9	2306.1	2302.1	2286.5	2294.3	2290.5	2329.6	2286.5	2309.9	2290.5	2298.3
30°	2196.6	2224.0	2216.2	2200.5	2200.5	2188.7	2231.8	2220.0	2216.2	2216.2	2212.2
32.5°	2118.4	2122.4	2114.6	2118.4	2122.4	2106.8	2141.9	2126.2	2122.4	2126.2	2130.2
35°	2012.8	2012.8	2020.7	2009.0	2024.6	2024.6	2055.9	2036.3	2032.5	2020.7	2032.5
37.5°	1919.1	1907.4	1911.3	1911.3	1919.1	1926.9	1942.5	1934.7	1934.7	1923.1	1930.9
40°	1794.1	1786.2	1797.9	1797.9	1809.7	1809.7	1825.3	1817.5	1829.1	1829.1	1829.1
42.5°	1684.7	1684.7	1676.8	1688.5	1692.5	1688.5	1715.9	1711.9	1715.9	1708.1	1711.9
45°	1567.3	1567.3	1559.5	1555.6	1575.1	1571.3	1602.5	1590.7	1606.4	1598.5	1602.5
47.5°	1407.0	1426.6	1414.8	1426.6	1450.1	1454.1	1473.5	1465.7	1481.3	1469.7	1485.3
50°	1254.7	1254.7	1266.4	1282.0	1305.4	1309.4	1332.9	1348.5	1356.3	1360.1	1364.1
52.5°	1094.4	1090.5	1102.3	1121.7	1141.3	1157.0	1180.4	1203.8	1219.5	1242.9	1231.1
55°	906.8	914.6	926.4	949.8	981.1	1000.5	1020.1	1051.4	1078.8	1090.5	1113.9
57.5°	746.5	738.7	746.5	777.7	813.0	828.6	856.0	887.3	926.4	949.8	957.6
60°	578.4	582.4	590.2	617.6	644.9	668.3	680.1	730.9	766.1	789.5	805.2
62.5°	426.1	433.9	441.7	465.2	492.4	512.1	531.5	574.6	605.8	629.3	644.9
65°	297.1	300.9	312.7	324.4	351.8	371.3	386.9	422.1	453.4	473.0	484.6
67.5°	183.7	187.5	195.4	211.1	230.6	246.2	261.9	285.3	312.7	332.2	336.2
70°	93.8	97.8	101.6	113.4	129.0	136.8	148.5	168.1	187.5	203.2	211.1
72.5°	31.3	31.3	35.2	43.1	50.9	58.7	62.5	82.1	97.8	105.6	109.4
75°	7.8	7.8	7.8	7.8	7.8	11.8	11.8	23.4	31.3	39.1	43.1
77.5°	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	7.8	7.8
80°	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C55D010 FEU4C559040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7	2751.7
2.5°	2751.7	2743.9	2739.9	2743.9	2743.9	2739.9	2751.7	2767.3	2786.8	2736.0
5°	2747.7	2739.9	2747.7	2724.2	2736.0	2728.2	2743.9	2739.9	2755.5	2739.9
7.5°	2736.0	2720.4	2724.2	2712.6	2728.2	2708.6	2720.4	2743.9	2728.2	2704.8
10°	2697.0	2689.2	2716.4	2677.4	2669.5	2685.2	2716.4	2693.0	2685.2	2693.0
12.5°	2657.7	2657.7	2669.5	2638.3	2642.1	2649.9	2665.6	2649.9	2657.7	2677.4
15°	2614.8	2607.0	2626.5	2603.1	2599.2	2591.4	2607.0	2607.0	2614.8	2603.1
17.5°	2564.0	2552.3	2552.3	2544.5	2540.5	2560.1	2568.0	2571.8	2575.8	2560.1
20°	2501.5	2497.6	2509.3	2497.6	2501.5	2505.4	2505.4	2497.6	2532.7	2489.8
22.5°	2435.0	2446.8	2431.1	2423.3	2431.1	2439.0	2439.0	2442.8	2435.0	2427.2
25°	2368.6	2376.4	2380.3	2356.8	2368.6	2356.8	2384.3	2388.1	2372.5	2380.3
27.5°	2309.9	2298.3	2294.3	2278.7	2286.5	2282.7	2286.5	2286.5	2309.9	2278.7
30°	2220.0	2208.4	2212.2	2200.5	2204.4	2200.5	2204.4	2204.4	2220.0	2216.2
32.5°	2134.0	2122.4	2126.2	2114.6	2114.6	2118.4	2110.6	2110.6	2122.4	2114.6
35°	2051.9	2024.6	2028.5	2024.6	2028.5	2012.8	2012.8	2009.0	2016.8	1997.2
37.5°	1934.7	1923.1	1919.1	1915.2	1919.1	1911.3	1919.1	1907.4	1919.1	1903.4
40°	1829.1	1821.3	1825.3	1801.9	1801.9	1805.7	1797.9	1794.1	1797.9	1813.5
42.5°	1723.7	1708.1	1700.3	1692.5	1696.3	1684.7	1680.7	1672.9	1680.7	1665.0
45°	1598.5	1598.5	1594.7	1575.1	1579.1	1579.1	1563.5	1547.8	1551.7	1551.7
47.5°	1485.3	1477.5	1473.5	1454.1	1450.1	1446.2	1430.5	1418.8	1418.8	1407.0
50°	1360.1	1352.3	1340.7	1321.1	1313.2	1289.8	1278.2	1262.5	1246.9	1246.9
52.5°	1242.9	1215.5	1199.9	1168.6	1157.0	1145.2	1113.9	1102.3	1090.5	1078.8
55°	1102.3	1078.8	1047.6	1012.3	996.7	977.1	945.8	922.4	906.8	910.7
57.5°	965.4	926.4	895.1	848.2	828.6	816.8	785.6	754.3	738.7	738.7
60°	797.4	766.1	727.0	684.0	668.3	648.9	609.7	590.2	578.4	566.8
62.5°	637.1	613.6	578.4	523.7	512.1	492.4	465.2	441.7	429.9	429.9
65°	476.8	453.4	422.1	383.0	367.4	351.8	328.3	304.9	293.1	289.3
67.5°	336.2	308.7	281.5	250.2	238.4	230.6	207.2	191.5	183.7	179.7
70°	203.2	187.5	168.1	144.6	132.8	125.0	109.4	97.8	93.8	89.9
72.5°	105.6	93.8	78.1	62.5	54.7	46.9	39.1	31.3	27.4	27.4
75°	39.1	31.3	19.6	11.8	7.8	7.8	7.8	7.8	7.8	7.8
77.5°	7.8	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
80°	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)