

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.



Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW
 Description: 4 INCH 6000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3000K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 6258.0 lumens
 Efficiency: N/A
 Efficacy: 86.9 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 72
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

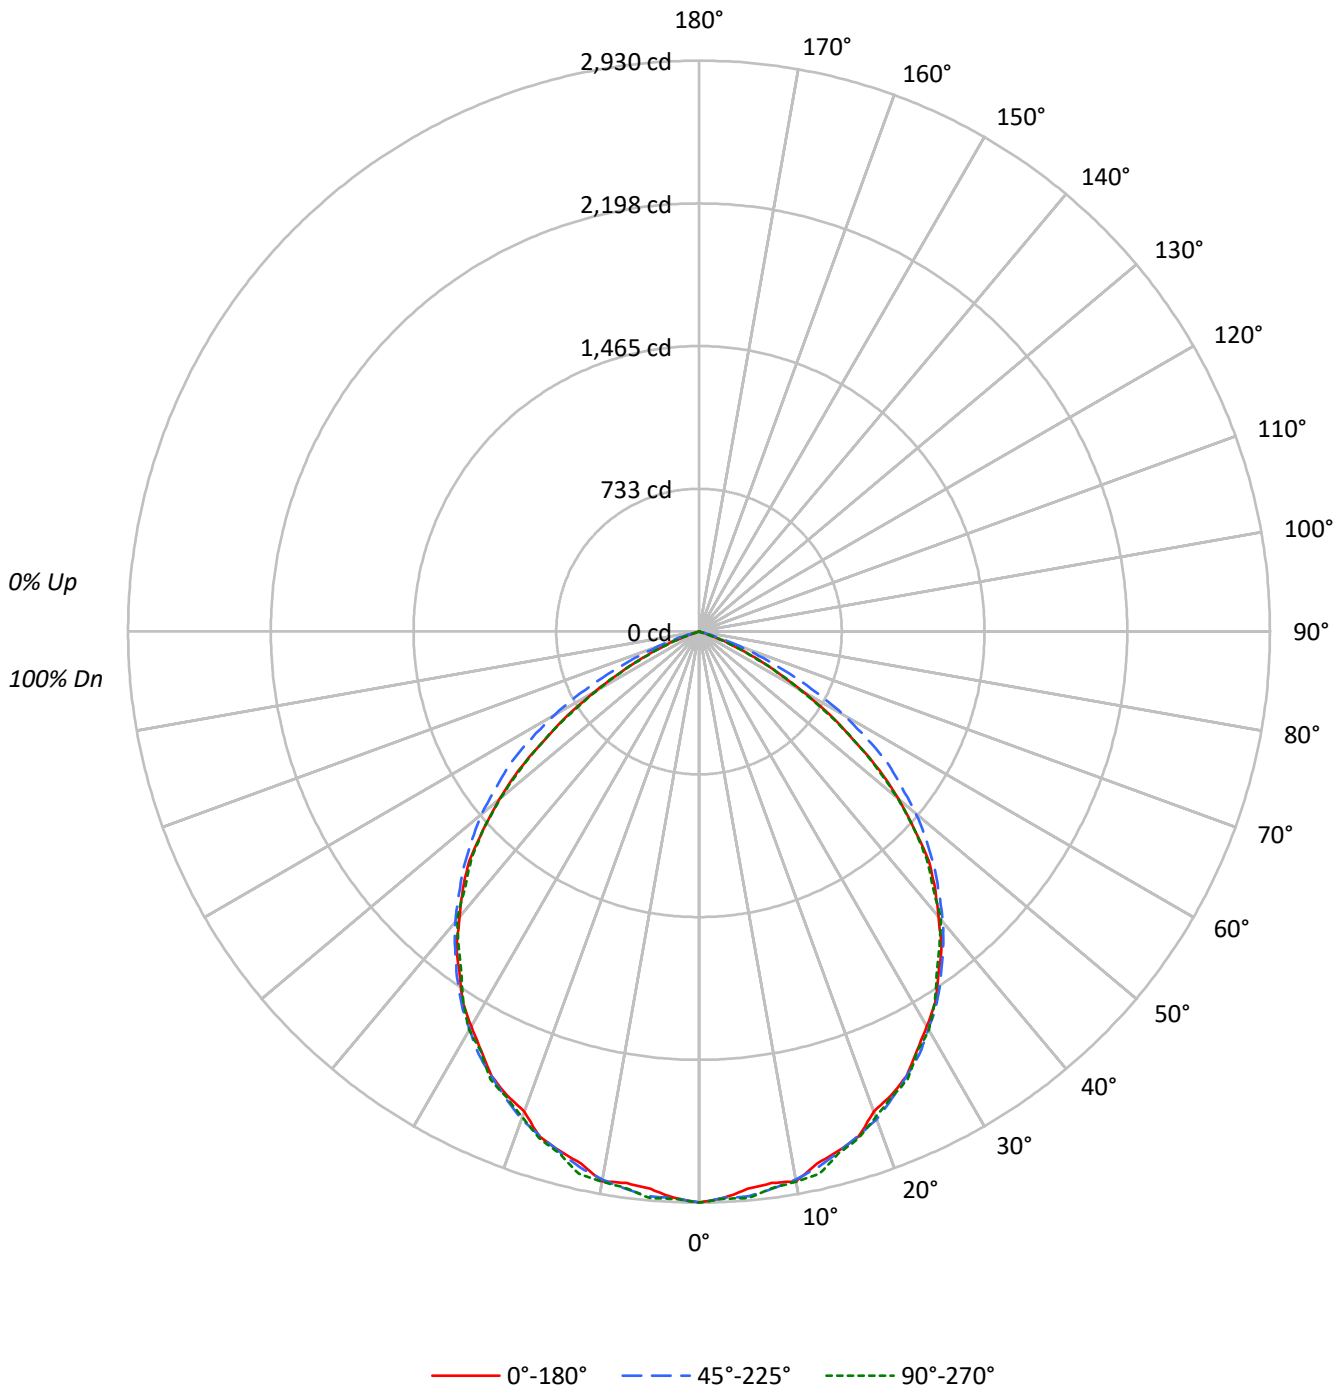

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	282674	282674	282674
5°	278107	281729	282533
10°	280509	279696	280911
15°	275594	276003	276833
20°	269189	273461	272188
25°	268022	268022	269790
30°	260557	262406	262874
35°	252427	254888	250459
40°	240578	245289	243186
45°	227690	232807	225425
50°	200517	218005	199271
55°	162403	199496	163109
60°	118836	165421	116443
65°	72215	117809	70320
70°	28155	63419	27027
75°	3094	17074	3094
80°	2334	2334	2334
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.5	4.4
10°-20°	782.5	12.5
20°-30°	1161.0	18.6
30°-40°	1345.3	21.5
40°-50°	1289.9	20.6
50°-60°	948.4	15.2
60°-70°	409.6	6.5
70°-80°	44.2	0.7
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2220.1	35.5
0°-40°	3565.4	57.0
0°-60°	5803.6	92.7
0°-90°	6258.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6258.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2930	2930	2930	2930	2930	
5°	2871	2900	2909	2913	2917	274
15°	2759	2776	2763	2767	2771	778
25°	2518	2513	2518	2522	2534	1153
35°	2143	2156	2164	2160	2126	1340
45°	1669	1673	1706	1681	1652	1268
55°	965	1065	1186	1061	970	869
65°	316	395	516	391	308	325
75°	8	13	46	8	8	26
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6
2.5°	2908.7	2942.0	2946.2	2925.3	2917.0	2904.6	2933.6	2912.9	2921.2	2912.9	2908.7
5°	2871.3	2908.7	2912.9	2912.9	2904.6	2900.4	2912.9	2908.7	2904.6	2896.3	2908.7
7.5°	2854.7	2875.4	2896.3	2871.3	2883.7	2879.6	2908.7	2896.3	2892.0	2892.0	2883.7
10°	2863.0	2858.8	2875.4	2850.4	2858.8	2850.4	2875.4	2875.4	2867.1	2858.8	2854.7
12.5°	2796.3	2829.6	2829.6	2825.5	2817.2	2804.6	2829.6	2846.4	2821.2	2821.2	2817.2
15°	2758.9	2767.3	2771.3	2771.3	2767.3	2775.6	2788.0	2771.3	2775.6	2754.7	2763.0
17.5°	2717.3	2700.7	2713.1	2704.8	2709.0	2717.3	2734.0	2734.0	2709.0	2704.8	2713.1
20°	2621.6	2671.5	2675.7	2650.8	2654.9	2654.9	2684.1	2659.1	2675.7	2654.9	2663.2
22.5°	2575.7	2609.0	2613.3	2580.0	2600.7	2575.7	2604.9	2567.4	2609.0	2580.0	2592.4
25°	2517.5	2513.4	2525.8	2509.2	2513.4	2513.4	2534.1	2517.5	2530.1	2513.4	2517.5
27.5°	2421.9	2455.2	2451.0	2434.3	2442.6	2438.6	2480.2	2434.3	2459.3	2438.6	2446.9
30°	2338.6	2367.8	2359.4	2342.8	2342.8	2330.2	2376.1	2363.5	2359.4	2359.4	2355.2
32.5°	2255.4	2259.6	2251.3	2255.4	2259.6	2243.0	2280.3	2263.7	2259.6	2263.7	2267.9
35°	2143.0	2143.0	2151.3	2138.9	2155.5	2155.5	2188.8	2167.9	2163.9	2151.3	2163.9
37.5°	2043.1	2030.7	2034.8	2034.8	2043.1	2051.5	2068.1	2059.8	2059.8	2047.4	2055.7
40°	1910.0	1901.7	1914.1	1914.1	1926.7	1926.7	1943.3	1935.0	1947.4	1947.4	1947.4
42.5°	1793.6	1793.6	1785.2	1797.6	1801.9	1797.6	1826.8	1822.6	1826.8	1818.5	1822.6
45°	1668.6	1668.6	1660.3	1656.2	1676.9	1672.8	1706.1	1693.6	1710.2	1701.9	1706.1
47.5°	1498.0	1518.9	1506.3	1518.9	1543.8	1548.1	1568.8	1560.5	1577.1	1564.7	1581.3
50°	1335.8	1335.8	1348.2	1364.9	1389.8	1394.1	1419.0	1435.7	1444.0	1448.1	1452.3
52.5°	1165.2	1161.0	1173.5	1194.2	1215.1	1231.8	1256.7	1281.7	1298.3	1323.3	1310.7
55°	965.4	973.7	986.3	1011.2	1044.5	1065.2	1086.1	1119.4	1148.6	1161.0	1185.9
57.5°	794.7	786.4	794.7	828.0	865.5	882.2	911.4	944.7	986.3	1011.2	1019.5
60°	615.8	620.0	628.4	657.6	686.6	711.6	724.1	778.1	815.6	840.6	857.2
62.5°	453.7	462.0	470.3	495.2	524.3	545.2	565.9	611.7	645.0	670.0	686.6
65°	316.3	320.4	332.9	345.3	374.5	395.3	411.9	449.4	482.7	503.6	516.0
67.5°	195.6	199.7	208.0	224.8	245.5	262.1	278.8	303.7	332.9	353.7	357.9
70°	99.8	104.1	108.2	120.7	137.4	145.7	158.1	178.9	199.7	216.3	224.8
72.5°	33.3	33.3	37.5	45.8	54.2	62.5	66.6	87.4	104.1	112.4	116.5
75°	8.3	8.3	8.3	8.3	8.3	12.6	12.6	25.0	33.3	41.6	45.8
77.5°	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	8.3	8.3
80°	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609030 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6	2929.6
2.5°	2929.6	2921.2	2917.0	2921.2	2921.2	2917.0	2929.6	2946.2	2966.9	2912.9
5°	2925.3	2917.0	2925.3	2900.4	2912.9	2904.6	2921.2	2917.0	2933.6	2917.0
7.5°	2912.9	2896.3	2900.4	2888.0	2904.6	2883.7	2896.3	2921.2	2904.6	2879.6
10°	2871.3	2863.0	2892.0	2850.4	2842.1	2858.8	2892.0	2867.1	2858.8	2867.1
12.5°	2829.6	2829.6	2842.1	2808.9	2812.9	2821.2	2837.9	2821.2	2829.6	2850.4
15°	2783.9	2775.6	2796.3	2771.3	2767.3	2758.9	2775.6	2775.6	2783.9	2771.3
17.5°	2729.7	2717.3	2717.3	2709.0	2704.8	2725.7	2734.0	2738.1	2742.3	2725.7
20°	2663.2	2659.1	2671.5	2659.1	2663.2	2667.4	2667.4	2659.1	2696.5	2650.8
22.5°	2592.4	2604.9	2588.3	2580.0	2588.3	2596.6	2596.6	2600.7	2592.4	2584.1
25°	2521.8	2530.1	2534.1	2509.2	2521.8	2509.2	2538.4	2542.5	2525.8	2534.1
27.5°	2459.3	2446.9	2442.6	2426.0	2434.3	2430.2	2434.3	2434.3	2459.3	2426.0
30°	2363.5	2351.1	2355.2	2342.8	2346.9	2342.8	2346.9	2346.9	2363.5	2359.4
32.5°	2272.0	2259.6	2263.7	2251.3	2251.3	2255.4	2247.0	2247.0	2259.6	2251.3
35°	2184.6	2155.5	2159.6	2155.5	2159.6	2143.0	2143.0	2138.9	2147.2	2126.3
37.5°	2059.8	2047.4	2043.1	2039.1	2043.1	2034.8	2043.1	2030.7	2043.1	2026.5
40°	1947.4	1939.1	1943.3	1918.4	1918.4	1922.4	1914.1	1910.0	1914.1	1930.7
42.5°	1835.2	1818.5	1810.2	1801.9	1806.0	1793.6	1789.3	1781.0	1789.3	1772.7
45°	1701.9	1701.9	1697.8	1676.9	1681.2	1681.2	1664.5	1647.9	1652.0	1652.0
47.5°	1581.3	1573.0	1568.8	1548.1	1543.8	1539.7	1522.9	1510.5	1510.5	1498.0
50°	1448.1	1439.7	1427.3	1406.5	1398.1	1373.2	1360.8	1344.2	1327.5	1327.5
52.5°	1323.3	1294.1	1277.4	1244.2	1231.8	1219.2	1185.9	1173.5	1161.0	1148.6
55°	1173.5	1148.6	1115.3	1077.8	1061.1	1040.2	1007.0	982.0	965.4	969.6
57.5°	1027.9	986.3	953.0	903.1	882.2	869.6	836.3	803.1	786.4	786.4
60°	848.9	815.6	774.0	728.2	711.6	690.8	649.1	628.4	615.8	603.4
62.5°	678.3	653.3	615.8	557.6	545.2	524.3	495.2	470.3	457.7	457.7
65°	507.6	482.7	449.4	407.8	391.2	374.5	349.6	324.6	312.1	308.0
67.5°	357.9	328.7	299.7	266.4	253.8	245.5	220.5	203.9	195.6	191.3
70°	216.3	199.7	178.9	154.0	141.4	133.1	116.5	104.1	99.8	95.8
72.5°	112.4	99.8	83.2	66.6	58.2	49.9	41.6	33.3	29.2	29.2
75°	41.6	33.3	20.9	12.6	8.3	8.3	8.3	8.3	8.3	8.3
77.5°	8.3	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2
80°	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2	4.2
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)