

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW
 Description: 4 INCH 6000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3500K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 6346.0 lumens
 Efficiency: N/A
 Efficacy: 88.1 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 72
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

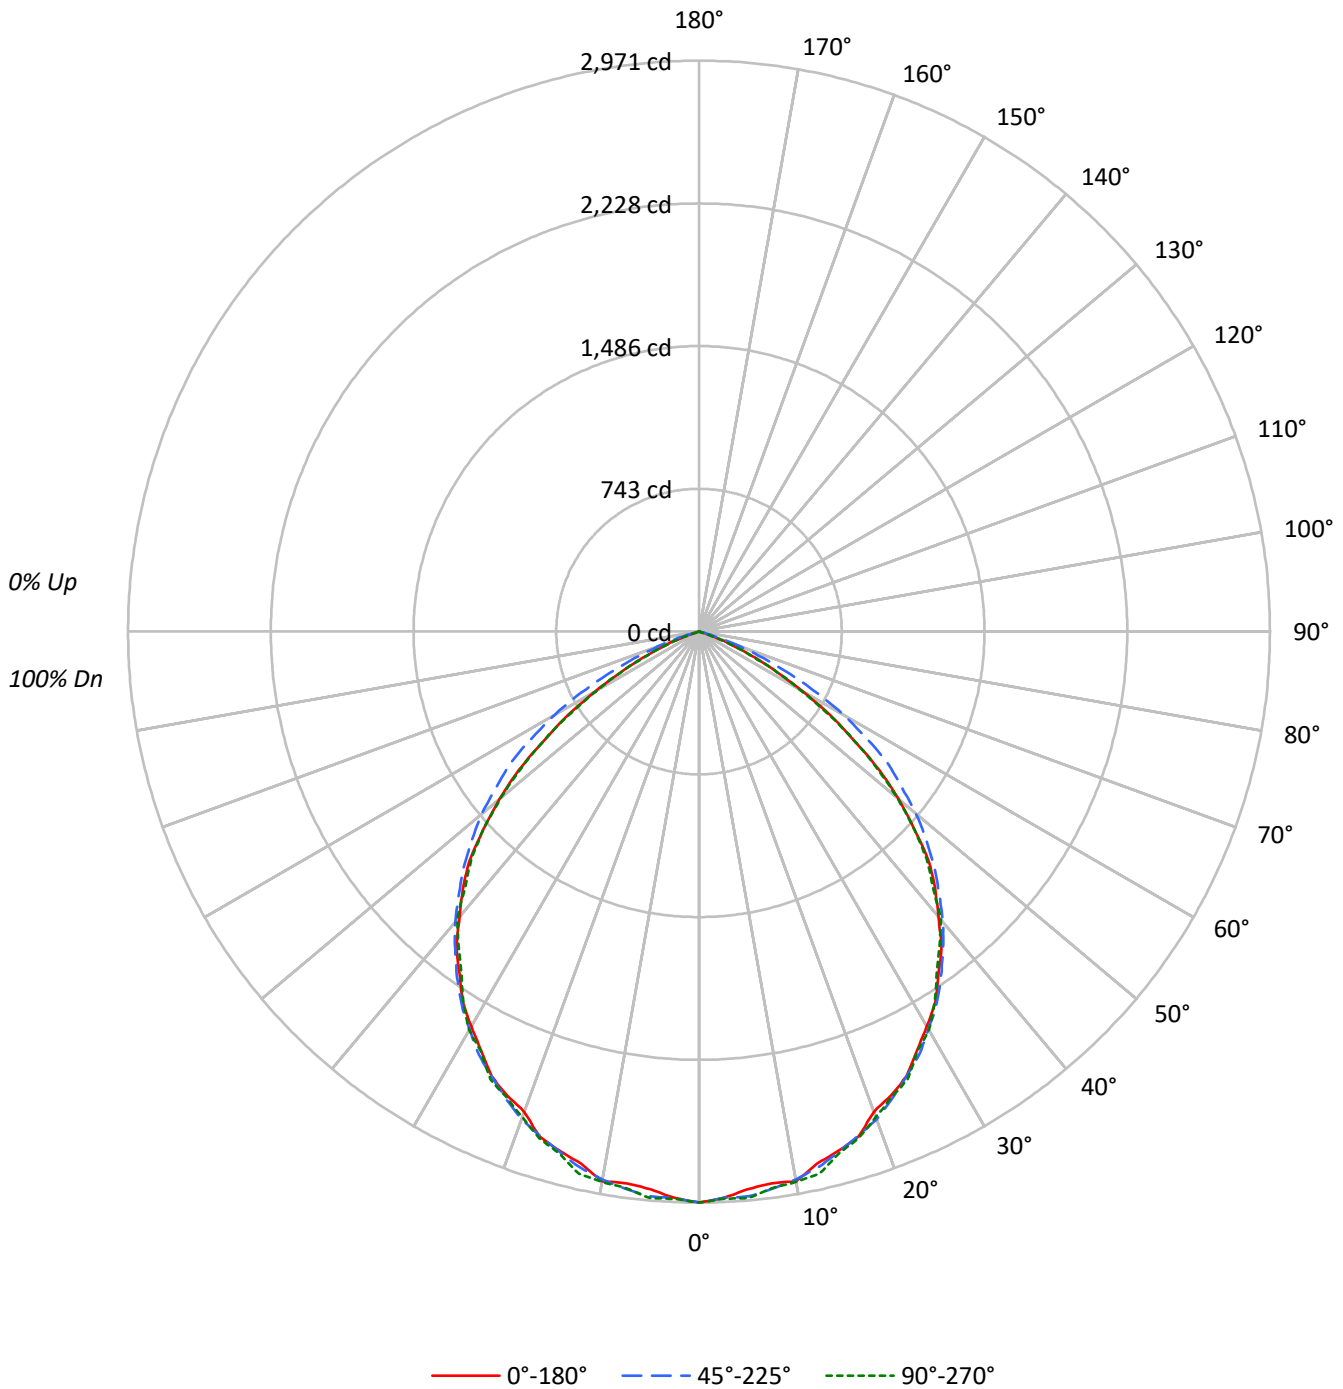

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	286649	286649	286649
5°	282020	285691	286504
10°	284458	283625	284859
15°	279470	279889	280728
20°	272968	277301	276018
25°	271791	271791	273590
30°	264211	266094	266573
35°	255972	258469	253981
40°	243967	248740	246612
45°	230897	236082	228591
50°	203339	221067	202078
55°	164674	202305	165414
60°	120515	167756	118083
65°	73220	119453	71302
70°	28550	64294	27393
75°	3132	17335	3132
80°	2389	2389	2389
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	280.4	4.4
10°-20°	793.5	12.5
20°-30°	1177.4	18.6
30°-40°	1364.2	21.5
40°-50°	1308.0	20.6
50°-60°	961.7	15.2
60°-70°	415.4	6.5
70°-80°	44.8	0.7
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2251.3	35.5
0°-40°	3615.5	57.0
0°-60°	5885.2	92.7
0°-90°	6346.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6346.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2971	2971	2971	2971	2971	
5°	2912	2941	2950	2954	2958	278
15°	2798	2815	2802	2806	2810	789
25°	2553	2549	2553	2557	2570	1169
35°	2173	2186	2194	2190	2156	1359
45°	1692	1696	1730	1705	1675	1286
55°	979	1080	1203	1076	983	881
65°	321	401	523	397	312	330
75°	8	13	46	8	8	26
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8
2.5°	2949.6	2983.3	2987.6	2966.5	2958.0	2945.4	2974.9	2953.9	2962.3	2953.9	2949.6
5°	2911.7	2949.6	2953.9	2953.9	2945.4	2941.1	2953.9	2949.6	2945.4	2937.0	2949.6
7.5°	2894.8	2915.8	2937.0	2911.7	2924.3	2920.1	2949.6	2937.0	2932.7	2932.7	2924.3
10°	2903.3	2899.0	2915.8	2890.5	2899.0	2890.5	2915.8	2915.8	2907.4	2899.0	2894.8
12.5°	2835.6	2869.4	2869.4	2865.2	2856.8	2844.0	2869.4	2886.4	2860.9	2860.9	2856.8
15°	2797.7	2806.2	2810.3	2810.3	2806.2	2814.6	2827.2	2810.3	2814.6	2793.4	2801.9
17.5°	2755.5	2738.7	2751.2	2742.8	2747.1	2755.5	2772.4	2772.4	2747.1	2742.8	2751.2
20°	2658.4	2709.1	2713.4	2688.1	2692.2	2692.2	2721.8	2696.5	2713.4	2692.2	2700.6
22.5°	2612.0	2645.7	2650.0	2616.3	2637.3	2612.0	2641.6	2603.5	2645.7	2616.3	2628.8
25°	2552.9	2548.8	2561.3	2544.5	2548.8	2548.8	2569.8	2552.9	2565.6	2548.8	2552.9
27.5°	2456.0	2489.7	2485.4	2468.5	2477.0	2472.8	2515.0	2468.5	2493.9	2472.8	2481.3
30°	2371.4	2401.1	2392.6	2375.7	2375.7	2363.0	2409.5	2396.8	2392.6	2392.6	2388.3
32.5°	2287.1	2291.4	2282.9	2287.1	2291.4	2274.5	2312.4	2295.5	2291.4	2295.5	2299.8
35°	2173.1	2173.1	2181.5	2169.0	2185.8	2185.8	2219.6	2198.4	2194.3	2181.5	2194.3
37.5°	2071.9	2059.3	2063.4	2063.4	2071.9	2080.3	2097.2	2088.7	2088.7	2076.2	2084.6
40°	1936.9	1928.5	1941.0	1941.0	1953.8	1953.8	1970.6	1962.2	1974.8	1974.8	1974.8
42.5°	1818.8	1818.8	1810.3	1822.9	1827.2	1822.9	1852.5	1848.2	1852.5	1844.1	1848.2
45°	1692.1	1692.1	1683.6	1679.5	1700.5	1696.4	1730.1	1717.4	1734.3	1725.8	1730.1
47.5°	1519.0	1540.2	1527.5	1540.2	1565.5	1569.8	1590.8	1582.4	1599.3	1586.7	1603.6
50°	1354.6	1354.6	1367.2	1384.1	1409.4	1413.7	1439.0	1455.9	1464.3	1468.4	1472.7
52.5°	1181.6	1177.3	1190.0	1211.0	1232.2	1249.1	1274.4	1299.7	1316.6	1341.9	1329.1
55°	978.9	987.4	1000.1	1025.4	1059.2	1080.2	1101.4	1135.1	1164.7	1177.3	1202.6
57.5°	805.9	797.5	805.9	839.7	877.7	894.6	924.2	957.9	1000.1	1025.4	1033.9
60°	624.5	628.8	637.2	666.8	696.2	721.6	734.3	789.0	827.1	852.4	869.3
62.5°	460.0	468.5	476.9	502.2	531.7	552.8	573.8	620.3	654.1	679.4	696.2
65°	320.7	324.9	337.6	350.2	379.8	400.8	417.7	455.7	489.5	510.6	523.2
67.5°	198.3	202.5	210.9	227.9	249.0	265.8	282.7	308.0	337.6	358.6	362.9
70°	101.2	105.5	109.7	122.4	139.3	147.7	160.3	181.5	202.5	219.3	227.9
72.5°	33.7	33.7	38.0	46.5	54.9	63.4	67.5	88.7	105.5	114.0	118.1
75°	8.4	8.4	8.4	8.4	8.4	12.7	12.7	25.3	33.7	42.2	46.5
77.5°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	8.4	8.4
80°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609035 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8	2970.8
2.5°	2970.8	2962.3	2958.0	2962.3	2962.3	2958.0	2970.8	2987.6	3008.6	2953.9
5°	2966.5	2958.0	2966.5	2941.1	2953.9	2945.4	2962.3	2958.0	2974.9	2958.0
7.5°	2953.9	2937.0	2941.1	2928.6	2945.4	2924.3	2937.0	2962.3	2945.4	2920.1
10°	2911.7	2903.3	2932.7	2890.5	2882.1	2899.0	2932.7	2907.4	2899.0	2907.4
12.5°	2869.4	2869.4	2882.1	2848.3	2852.5	2860.9	2877.8	2860.9	2869.4	2890.5
15°	2823.0	2814.6	2835.6	2810.3	2806.2	2797.7	2814.6	2814.6	2823.0	2810.3
17.5°	2768.1	2755.5	2755.5	2747.1	2742.8	2764.0	2772.4	2776.6	2780.9	2764.0
20°	2700.6	2696.5	2709.1	2696.5	2700.6	2704.9	2704.9	2696.5	2734.4	2688.1
22.5°	2628.8	2641.6	2624.7	2616.3	2624.7	2633.1	2633.1	2637.3	2628.8	2620.4
25°	2557.2	2565.6	2569.8	2544.5	2557.2	2544.5	2574.1	2578.2	2561.3	2569.8
27.5°	2493.9	2481.3	2477.0	2460.1	2468.5	2464.4	2468.5	2468.5	2493.9	2460.1
30°	2396.8	2384.2	2388.3	2375.7	2379.9	2375.7	2379.9	2379.9	2396.8	2392.6
32.5°	2304.0	2291.4	2295.5	2282.9	2282.9	2287.1	2278.6	2278.6	2291.4	2282.9
35°	2215.3	2185.8	2190.0	2185.8	2190.0	2173.1	2173.1	2169.0	2177.4	2156.2
37.5°	2088.7	2076.2	2071.9	2067.7	2071.9	2063.4	2071.9	2059.3	2071.9	2055.0
40°	1974.8	1966.3	1970.6	1945.3	1945.3	1949.5	1941.0	1936.9	1941.0	1957.9
42.5°	1861.0	1844.1	1835.7	1827.2	1831.4	1818.8	1814.5	1806.0	1814.5	1797.6
45°	1725.8	1725.8	1721.7	1700.5	1704.8	1704.8	1687.9	1671.1	1675.2	1675.2
47.5°	1603.6	1595.1	1590.8	1569.8	1565.5	1561.4	1544.4	1531.8	1531.8	1519.0
50°	1468.4	1460.0	1447.4	1426.2	1417.8	1392.5	1379.9	1363.1	1346.2	1346.2
52.5°	1341.9	1312.3	1295.4	1261.7	1249.1	1236.3	1202.6	1190.0	1177.3	1164.7
55°	1190.0	1164.7	1131.0	1092.9	1076.1	1054.9	1021.1	995.8	978.9	983.3
57.5°	1042.3	1000.1	966.4	915.8	894.6	881.8	848.1	814.4	797.5	797.5
60°	860.8	827.1	784.9	738.4	721.6	700.5	658.2	637.2	624.5	611.9
62.5°	687.8	662.5	624.5	565.4	552.8	531.7	502.2	476.9	464.2	464.2
65°	514.8	489.5	455.7	413.5	396.7	379.8	354.5	329.2	316.4	312.3
67.5°	362.9	333.3	303.9	270.1	257.4	249.0	223.6	206.8	198.3	194.0
70°	219.3	202.5	181.5	156.2	143.4	135.0	118.1	105.5	101.2	97.1
72.5°	114.0	101.2	84.4	67.5	59.1	50.6	42.2	33.7	29.6	29.6
75°	42.2	33.7	21.2	12.7	8.4	8.4	8.4	8.4	8.4	8.4
77.5°	8.4	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
80°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)