

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW
 Description: 4 INCH 6000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 5000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 6486.0 lumens
 Efficiency: N/A
 Efficacy: 90.1 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 72
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

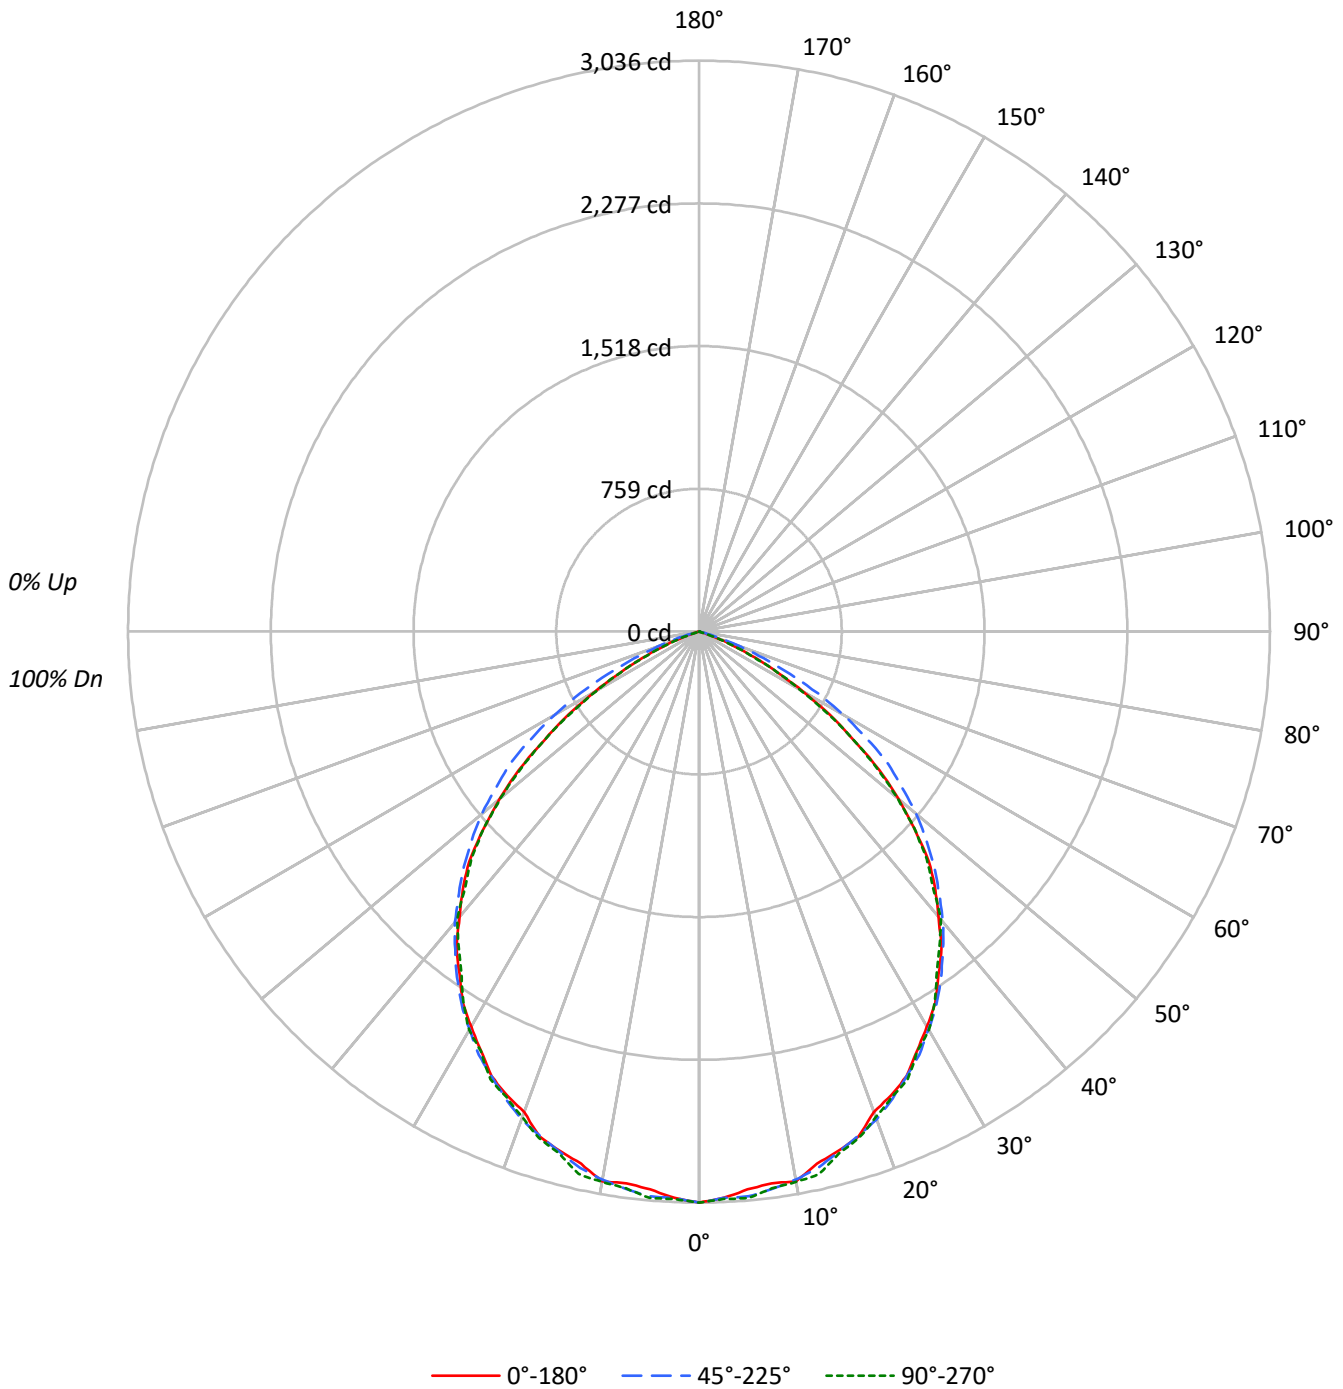

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	292969	292969	292969
5°	288238	291996	292829
10°	290728	289886	291140
15°	285643	286063	286922
20°	278995	283421	282107
25°	277785	277785	279627
30°	270050	271966	272456
35°	261614	264170	259588
40°	249345	254220	252053
45°	235987	241295	233640
50°	207827	225946	206536
55°	168307	206763	169048
60°	123158	171461	120688
65°	74841	122101	72877
70°	29199	65733	27986
75°	3206	17708	3206
80°	2445	2445	2445
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	286.6	4.4
10°-20°	811.0	12.5
20°-30°	1203.3	18.6
30°-40°	1394.3	21.5
40°-50°	1336.8	20.6
50°-60°	982.9	15.2
60°-70°	424.5	6.5
70°-80°	45.8	0.7
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2300.9	35.5
0°-40°	3695.3	57.0
0°-60°	6015.0	92.7
0°-90°	6486.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6486.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3036	3036	3036	3036	3036	
5°	2976	3006	3015	3019	3023	284
15°	2860	2877	2864	2868	2872	806
25°	2609	2605	2609	2614	2626	1195
35°	2221	2234	2243	2238	2204	1389
45°	1729	1734	1768	1742	1712	1315
55°	1000	1104	1229	1100	1005	900
65°	328	410	535	405	319	337
75°	9	13	48	9	9	26
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3
2.5°	3014.7	3049.1	3053.5	3031.9	3023.3	3010.4	3040.5	3019.1	3027.7	3019.1	3014.7
5°	2975.9	3014.7	3019.1	3019.1	3010.4	3006.0	3019.1	3014.7	3010.4	3001.8	3014.7
7.5°	2958.7	2980.2	3001.8	2975.9	2988.8	2984.6	3014.7	3001.8	2997.4	2997.4	2988.8
10°	2967.3	2962.9	2980.2	2954.3	2962.9	2954.3	2980.2	2980.2	2971.5	2962.9	2958.7
12.5°	2898.2	2932.7	2932.7	2928.4	2919.8	2906.8	2932.7	2950.1	2924.0	2924.0	2919.8
15°	2859.5	2868.1	2872.3	2872.3	2868.1	2876.7	2889.5	2872.3	2876.7	2855.1	2863.7
17.5°	2816.3	2799.1	2811.9	2803.3	2807.7	2816.3	2833.6	2833.6	2807.7	2803.3	2811.9
20°	2717.1	2768.8	2773.2	2747.4	2751.6	2751.6	2781.8	2756.0	2773.2	2751.6	2760.2
22.5°	2669.6	2704.1	2708.5	2674.0	2695.5	2669.6	2699.9	2661.0	2704.1	2674.0	2686.8
25°	2609.2	2605.0	2617.9	2600.6	2605.0	2605.0	2626.5	2609.2	2622.2	2605.0	2609.2
27.5°	2510.2	2544.6	2540.3	2523.0	2531.6	2527.4	2570.5	2523.0	2548.9	2527.4	2536.0
30°	2423.8	2454.0	2445.4	2428.2	2428.2	2415.1	2462.6	2449.6	2445.4	2445.4	2441.0
32.5°	2337.5	2341.9	2333.3	2337.5	2341.9	2324.7	2363.4	2346.2	2341.9	2346.2	2350.6
35°	2221.0	2221.0	2229.7	2216.8	2234.1	2234.1	2268.6	2246.9	2242.7	2229.7	2242.7
37.5°	2117.6	2104.7	2109.0	2109.0	2117.6	2126.2	2143.4	2134.8	2134.8	2122.0	2130.6
40°	1979.6	1971.0	1983.8	1983.8	1996.9	1996.9	2014.1	2005.5	2018.3	2018.3	2018.3
42.5°	1858.9	1858.9	1850.3	1863.1	1867.5	1863.1	1893.4	1889.0	1893.4	1884.8	1889.0
45°	1729.4	1729.4	1720.8	1716.6	1738.0	1733.8	1768.3	1755.3	1772.5	1763.9	1768.3
47.5°	1552.6	1574.2	1561.2	1574.2	1600.1	1604.5	1625.9	1617.3	1634.6	1621.7	1638.9
50°	1384.5	1384.5	1397.3	1414.6	1440.5	1444.9	1470.7	1488.0	1496.6	1500.8	1505.2
52.5°	1207.7	1203.3	1216.3	1237.7	1259.4	1276.6	1302.5	1328.4	1345.6	1371.5	1358.5
55°	1000.5	1009.2	1022.2	1048.1	1082.5	1104.0	1125.7	1160.1	1190.4	1203.3	1229.1
57.5°	823.7	815.1	823.7	858.2	897.1	914.3	944.6	979.1	1022.2	1048.1	1056.7
60°	638.2	642.6	651.3	681.5	711.6	737.5	750.5	806.5	845.3	871.2	888.5
62.5°	470.2	478.8	487.4	513.3	543.4	565.0	586.5	634.0	668.5	694.4	711.6
65°	327.8	332.1	345.1	357.9	388.2	409.7	426.9	465.8	500.3	521.9	534.8
67.5°	202.7	206.9	215.6	233.0	254.4	271.7	288.9	314.8	345.1	366.5	370.9
70°	103.5	107.9	112.1	125.1	142.4	151.0	163.8	185.5	206.9	224.2	233.0
72.5°	34.5	34.5	38.9	47.5	56.1	64.8	69.0	90.6	107.9	116.5	120.7
75°	8.6	8.6	8.6	8.6	8.6	13.0	13.0	25.9	34.5	43.1	47.5
77.5°	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	8.6	8.6
80°	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609050 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3	3036.3
2.5°	3036.3	3027.7	3023.3	3027.7	3027.7	3023.3	3036.3	3053.5	3075.0	3019.1
5°	3031.9	3023.3	3031.9	3006.0	3019.1	3010.4	3027.7	3023.3	3040.5	3023.3
7.5°	3019.1	3001.8	3006.0	2993.2	3010.4	2988.8	3001.8	3027.7	3010.4	2984.6
10°	2975.9	2967.3	2997.4	2954.3	2945.7	2962.9	2997.4	2971.5	2962.9	2971.5
12.5°	2932.7	2932.7	2945.7	2911.2	2915.4	2924.0	2941.3	2924.0	2932.7	2954.3
15°	2885.3	2876.7	2898.2	2872.3	2868.1	2859.5	2876.7	2876.7	2885.3	2872.3
17.5°	2829.2	2816.3	2816.3	2807.7	2803.3	2825.0	2833.6	2837.8	2842.2	2825.0
20°	2760.2	2756.0	2768.8	2756.0	2760.2	2764.6	2764.6	2756.0	2794.7	2747.4
22.5°	2686.8	2699.9	2682.6	2674.0	2682.6	2691.2	2691.2	2695.5	2686.8	2678.2
25°	2613.6	2622.2	2626.5	2600.6	2613.6	2600.6	2630.9	2635.1	2617.9	2626.5
27.5°	2548.9	2536.0	2531.6	2514.4	2523.0	2518.8	2523.0	2523.0	2548.9	2514.4
30°	2449.6	2436.8	2441.0	2428.2	2432.4	2428.2	2432.4	2432.4	2449.6	2445.4
32.5°	2354.8	2341.9	2346.2	2333.3	2333.3	2337.5	2328.9	2328.9	2341.9	2333.3
35°	2264.2	2234.1	2238.3	2234.1	2238.3	2221.0	2221.0	2216.8	2225.4	2203.8
37.5°	2134.8	2122.0	2117.6	2113.4	2117.6	2109.0	2117.6	2104.7	2117.6	2100.3
40°	2018.3	2009.7	2014.1	1988.2	1988.2	1992.5	1983.8	1979.6	1983.8	2001.1
42.5°	1902.0	1884.8	1876.2	1867.5	1871.8	1858.9	1854.5	1845.9	1854.5	1837.3
45°	1763.9	1763.9	1759.7	1738.0	1742.4	1742.4	1725.2	1707.9	1712.2	1712.2
47.5°	1638.9	1630.3	1625.9	1604.5	1600.1	1595.8	1578.4	1565.6	1565.6	1552.6
50°	1500.8	1492.2	1479.3	1457.7	1449.1	1423.2	1410.4	1393.1	1375.9	1375.9
52.5°	1371.5	1341.2	1324.0	1289.5	1276.6	1263.6	1229.1	1216.3	1203.3	1190.4
55°	1216.3	1190.4	1155.9	1117.0	1099.8	1078.1	1043.7	1017.8	1000.5	1004.9
57.5°	1065.3	1022.2	987.7	936.0	914.3	901.3	866.8	832.3	815.1	815.1
60°	879.8	845.3	802.2	754.7	737.5	716.0	672.7	651.3	638.2	625.4
62.5°	703.0	677.1	638.2	577.9	565.0	543.4	513.3	487.4	474.4	474.4
65°	526.1	500.3	465.8	422.7	405.4	388.2	362.3	336.4	323.4	319.2
67.5°	370.9	340.7	310.6	276.1	263.1	254.4	228.6	211.3	202.7	198.3
70°	224.2	206.9	185.5	159.6	146.6	138.0	120.7	107.9	103.5	99.2
72.5°	116.5	103.5	86.2	69.0	60.4	51.7	43.1	34.5	30.3	30.3
75°	43.1	34.5	21.6	13.0	8.6	8.6	8.6	8.6	8.6	8.6
77.5°	8.6	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4
80°	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)