

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
Report Number: P#
Test Lab: INNOVATION CENTER
Issue Date: 12/13/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW
Description: 4 INCH 6000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 4000K, 90CRI LEDS
AND F4LC-CSSQ TRIM WITH MW FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6355.0 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 72
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

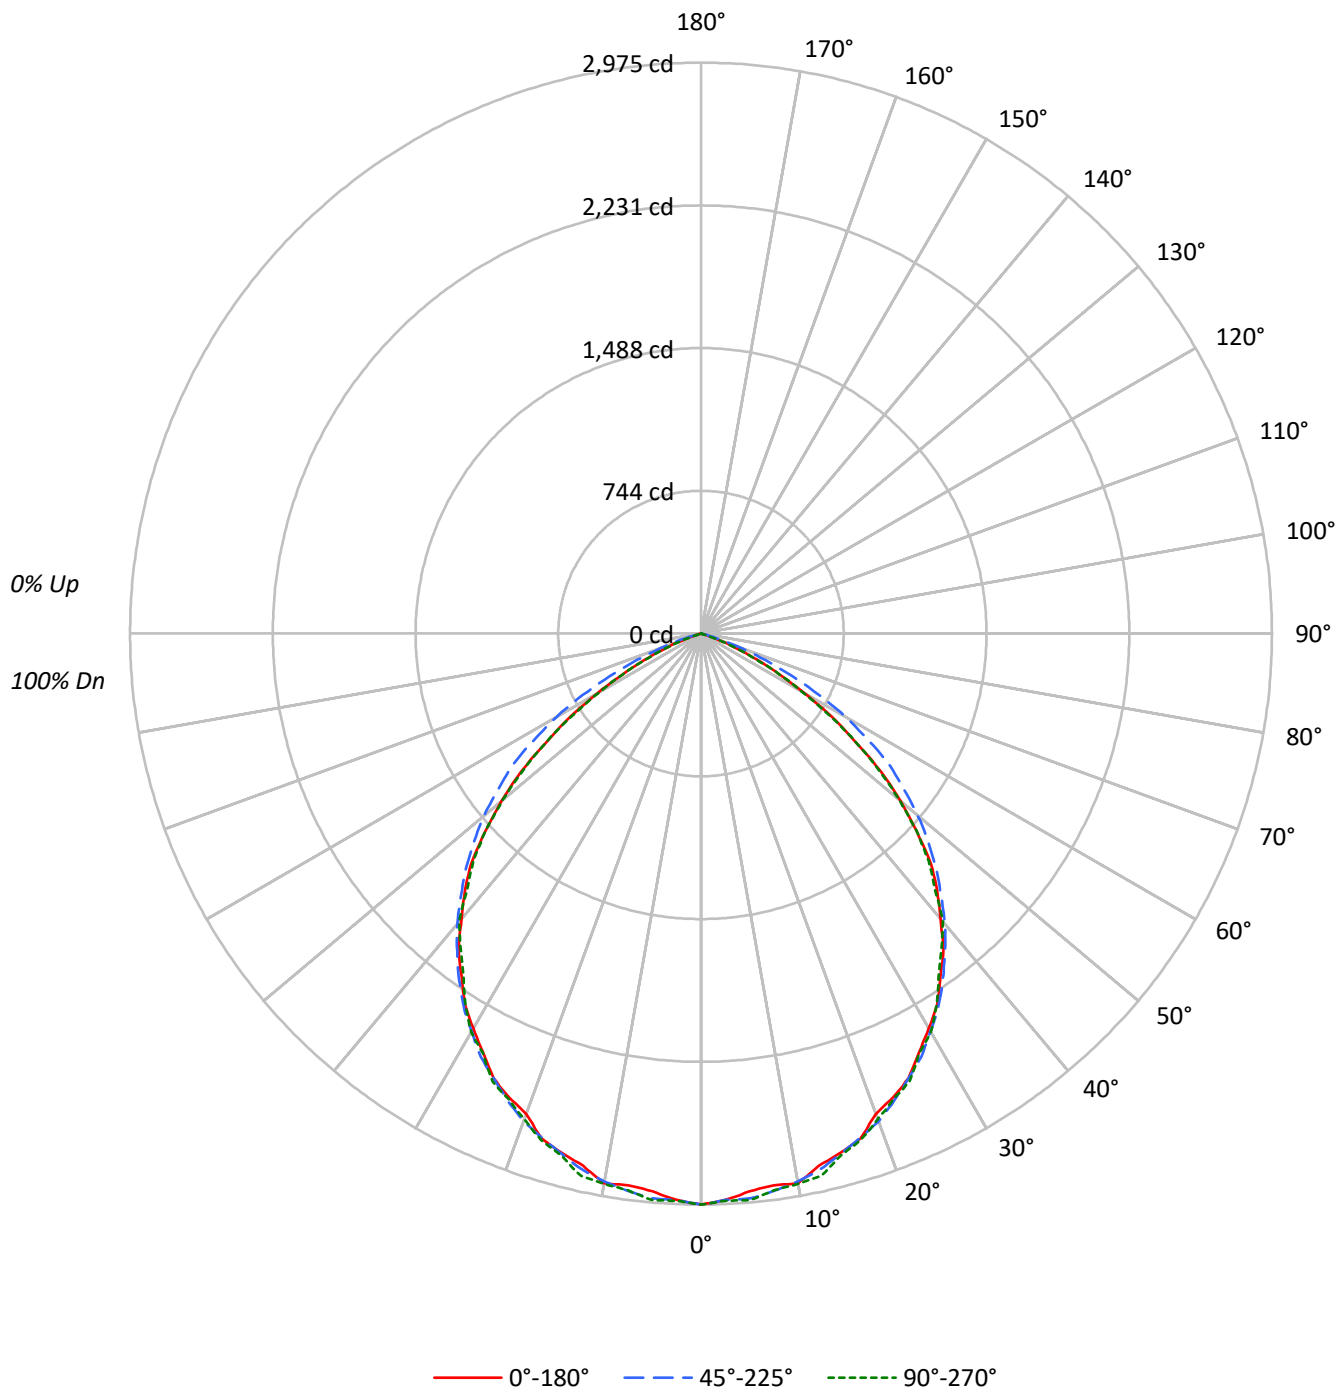

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	287054	287054	287054
5°	282417	286098	286911
10°	284859	284027	285261
15°	279869	280279	281128
20°	273358	277702	276408
25°	272174	272174	273974
30°	264590	266473	266952
35°	256337	258834	254347
40°	244307	249093	246964
45°	231225	236423	228918
50°	203624	221382	202363
55°	164909	202591	165633
60°	120669	167987	118257
65°	73334	119636	71416
70°	28606	64407	27422
75°	3132	17335	3132
80°	2389	2389	2389
85°	0	0	0

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	280.8	4.4
10°-20°	794.6	12.5
20°-30°	1179.0	18.6
30°-40°	1366.2	21.5
40°-50°	1309.8	20.6
50°-60°	963.1	15.2
60°-70°	416.0	6.5
70°-80°	44.9	0.7
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2254.5	35.5
0°-40°	3620.6	57.0
0°-60°	5893.5	92.7
0°-90°	6355.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6355.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2975	2975	2975	2975	2975	
5°	2916	2945	2954	2958	2962	278
15°	2802	2819	2806	2810	2814	790
25°	2556	2552	2556	2561	2573	1171
35°	2176	2189	2197	2193	2159	1361
45°	1694	1699	1733	1707	1678	1288
55°	980	1082	1204	1078	985	882
65°	321	401	524	397	313	330
75°	8	13	46	8	8	26
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0
2.5°	2953.8	2987.6	2991.9	2970.7	2962.2	2949.6	2979.1	2958.1	2966.5	2958.1	2953.8
5°	2915.8	2953.8	2958.1	2958.1	2949.6	2945.3	2958.1	2953.8	2949.6	2941.2	2953.8
7.5°	2898.9	2920.0	2941.2	2915.8	2928.4	2924.3	2953.8	2941.2	2936.9	2936.9	2928.4
10°	2907.4	2903.1	2920.0	2894.6	2903.1	2894.6	2920.0	2920.0	2911.5	2903.1	2898.9
12.5°	2839.6	2873.4	2873.4	2869.3	2860.8	2848.1	2873.4	2890.5	2865.0	2865.0	2860.8
15°	2801.7	2810.1	2814.3	2814.3	2810.1	2818.6	2831.2	2814.3	2818.6	2797.4	2805.8
17.5°	2759.5	2742.6	2755.1	2746.7	2751.0	2759.5	2776.4	2776.4	2751.0	2746.7	2755.1
20°	2662.2	2712.9	2717.2	2691.9	2696.0	2696.0	2725.7	2700.3	2717.2	2696.0	2704.5
22.5°	2615.7	2649.5	2653.8	2620.0	2641.0	2615.7	2645.3	2607.2	2649.5	2620.0	2632.6
25°	2556.5	2552.4	2565.0	2548.1	2552.4	2552.4	2573.4	2556.5	2569.3	2552.4	2556.5
27.5°	2459.5	2493.3	2488.9	2472.0	2480.5	2476.4	2518.6	2472.0	2497.4	2476.4	2484.8
30°	2374.8	2404.5	2396.0	2379.1	2379.1	2366.4	2412.9	2400.2	2396.0	2396.0	2391.7
32.5°	2290.3	2294.6	2286.2	2290.3	2294.6	2277.7	2315.7	2298.8	2294.6	2298.8	2303.1
35°	2176.2	2176.2	2184.6	2172.0	2188.9	2188.9	2222.7	2201.5	2197.4	2184.6	2197.4
37.5°	2074.8	2062.2	2066.4	2066.4	2074.8	2083.3	2100.2	2091.7	2091.7	2079.1	2087.6
40°	1939.6	1931.2	1943.8	1943.8	1956.5	1956.5	1973.4	1965.0	1977.6	1977.6	1977.6
42.5°	1821.4	1821.4	1812.9	1825.5	1829.8	1825.5	1855.2	1850.8	1855.2	1846.7	1850.8
45°	1694.5	1694.5	1686.0	1681.9	1702.9	1698.8	1732.6	1719.8	1736.7	1728.3	1732.6
47.5°	1521.2	1542.4	1529.6	1542.4	1567.7	1572.1	1593.1	1584.6	1601.5	1588.9	1605.8
50°	1356.5	1356.5	1369.1	1386.0	1411.4	1415.7	1441.0	1457.9	1466.4	1470.5	1474.8
52.5°	1183.3	1179.0	1191.7	1212.7	1234.0	1250.8	1276.2	1301.5	1318.4	1343.8	1331.0
55°	980.3	988.8	1001.5	1026.9	1060.7	1081.7	1102.9	1136.7	1166.4	1179.0	1204.3
57.5°	807.1	798.6	807.1	840.9	879.0	895.9	925.5	959.3	1001.5	1026.9	1035.3
60°	625.3	629.6	638.1	667.7	697.2	722.6	735.3	790.2	828.3	853.6	870.5
62.5°	460.7	469.1	477.6	502.9	532.4	553.6	574.7	621.2	655.0	680.3	697.2
65°	321.2	325.3	338.1	350.7	380.3	401.4	418.3	456.4	490.2	511.4	524.0
67.5°	198.6	202.8	211.2	228.3	249.3	266.2	283.1	308.4	338.1	359.1	363.4
70°	101.4	105.7	109.8	122.6	139.5	147.9	160.5	181.7	202.8	219.7	228.3
72.5°	33.8	33.8	38.1	46.5	55.0	63.4	67.6	88.8	105.7	114.1	118.3
75°	8.4	8.4	8.4	8.4	8.4	12.8	12.8	25.3	33.8	42.2	46.5
77.5°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	8.4	8.4
80°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C60D010 FEU4C609040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0	2975.0
2.5°	2975.0	2966.5	2962.2	2966.5	2966.5	2962.2	2975.0	2991.9	3012.9	2958.1
5°	2970.7	2962.2	2970.7	2945.3	2958.1	2949.6	2966.5	2962.2	2979.1	2962.2
7.5°	2958.1	2941.2	2945.3	2932.7	2949.6	2928.4	2941.2	2966.5	2949.6	2924.3
10°	2915.8	2907.4	2936.9	2894.6	2886.2	2903.1	2936.9	2911.5	2903.1	2911.5
12.5°	2873.4	2873.4	2886.2	2852.4	2856.5	2865.0	2881.9	2865.0	2873.4	2894.6
15°	2827.0	2818.6	2839.6	2814.3	2810.1	2801.7	2818.6	2818.6	2827.0	2814.3
17.5°	2772.0	2759.5	2759.5	2751.0	2746.7	2767.9	2776.4	2780.5	2784.8	2767.9
20°	2704.5	2700.3	2712.9	2700.3	2704.5	2708.8	2708.8	2700.3	2738.3	2691.9
22.5°	2632.6	2645.3	2628.4	2620.0	2628.4	2636.9	2636.9	2641.0	2632.6	2624.1
25°	2560.8	2569.3	2573.4	2548.1	2560.8	2548.1	2577.7	2581.9	2565.0	2573.4
27.5°	2497.4	2484.8	2480.5	2463.6	2472.0	2467.9	2472.0	2472.0	2497.4	2463.6
30°	2400.2	2387.6	2391.7	2379.1	2383.3	2379.1	2383.3	2383.3	2400.2	2396.0
32.5°	2307.2	2294.6	2298.8	2286.2	2286.2	2290.3	2281.9	2281.9	2294.6	2286.2
35°	2218.4	2188.9	2193.1	2188.9	2193.1	2176.2	2176.2	2172.0	2180.5	2159.3
37.5°	2091.7	2079.1	2074.8	2070.7	2074.8	2066.4	2074.8	2062.2	2074.8	2057.9
40°	1977.6	1969.1	1973.4	1948.1	1948.1	1952.2	1943.8	1939.6	1943.8	1960.7
42.5°	1863.6	1846.7	1838.3	1829.8	1834.0	1821.4	1817.1	1808.6	1817.1	1800.2
45°	1728.3	1728.3	1724.1	1702.9	1707.2	1707.2	1690.3	1673.4	1677.6	1677.6
47.5°	1605.8	1597.4	1593.1	1572.1	1567.7	1563.6	1546.5	1534.0	1534.0	1521.2
50°	1470.5	1462.1	1449.5	1428.3	1419.8	1394.5	1381.9	1365.0	1348.1	1348.1
52.5°	1343.8	1314.1	1297.2	1263.4	1250.8	1238.1	1204.3	1191.7	1179.0	1166.4
55°	1191.7	1166.4	1132.6	1094.5	1077.6	1056.4	1022.6	997.2	980.3	984.6
57.5°	1043.8	1001.5	967.7	917.1	895.9	883.1	849.3	815.5	798.6	798.6
60°	862.1	828.3	786.0	739.5	722.6	701.5	659.1	638.1	625.3	612.8
62.5°	688.8	663.4	625.3	566.2	553.6	532.4	502.9	477.6	464.8	464.8
65°	515.5	490.2	456.4	414.1	397.2	380.3	355.0	329.7	316.9	312.8
67.5°	363.4	333.8	304.3	270.5	257.8	249.3	224.0	207.1	198.6	194.3
70°	219.7	202.8	181.7	156.4	143.6	135.2	118.3	105.7	101.4	97.2
72.5°	114.1	101.4	84.5	67.6	59.1	50.7	42.2	33.8	29.7	29.7
75°	42.2	33.8	21.2	12.8	8.4	8.4	8.4	8.4	8.4	8.4
77.5°	8.4	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
80°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)