

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW
 Description: 4 INCH 6500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 2700K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 6295.0 lumens
 Efficiency: N/A
 Efficacy: 86.9 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 72.4
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

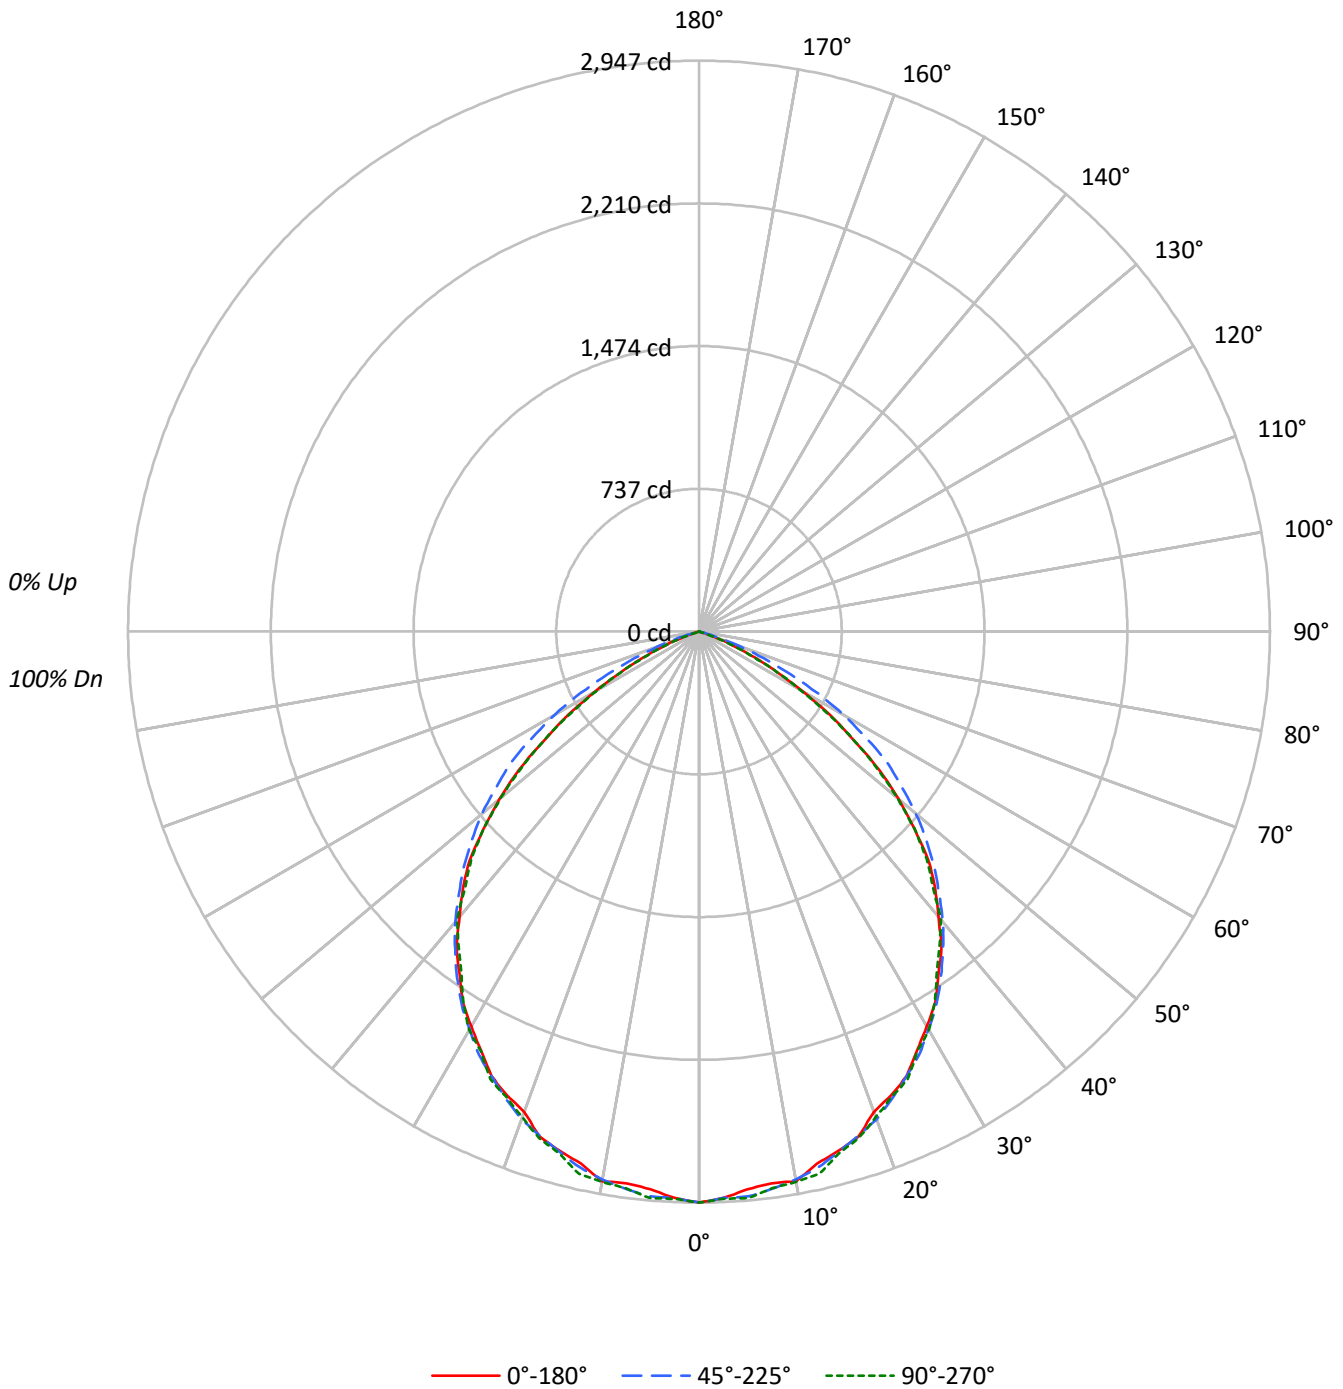

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	284343	284343	284343
5°	279753	283395	284199
10°	282165	281352	282567
15°	277222	277632	278471
20°	270781	275073	273800
25°	269609	269609	271387
30°	262094	263955	264434
35°	253911	256384	251944
40°	242002	246738	244634
45°	229041	234186	226749
50°	201703	219296	200457
55°	163362	200674	164068
60°	119530	166405	117138
65°	72649	118494	70731
70°	28324	63786	27168
75°	3132	17186	3132
80°	2389	2389	2389
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	278.2	4.4
10°-20°	787.1	12.5
20°-30°	1167.9	18.6
30°-40°	1353.3	21.5
40°-50°	1297.5	20.6
50°-60°	954.0	15.2
60°-70°	412.0	6.5
70°-80°	44.5	0.7
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2233.2	35.5
0°-40°	3586.4	57.0
0°-60°	5837.9	92.7
0°-90°	6295.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6295.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2947	2947	2947	2947	2947	
5°	2888	2918	2926	2930	2934	276
15°	2775	2792	2779	2784	2788	782
25°	2532	2528	2532	2537	2549	1159
35°	2156	2168	2177	2172	2139	1348
45°	1678	1683	1716	1691	1662	1276
55°	971	1072	1193	1067	975	874
65°	318	398	519	394	310	327
75°	8	13	46	8	8	26
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9
2.5°	2925.9	2959.4	2963.6	2942.6	2934.2	2921.8	2951.0	2930.1	2938.5	2930.1	2925.9
5°	2888.3	2925.9	2930.1	2930.1	2921.8	2917.5	2930.1	2925.9	2921.8	2913.4	2925.9
7.5°	2871.6	2892.4	2913.4	2888.3	2900.8	2896.7	2925.9	2913.4	2909.1	2909.1	2900.8
10°	2879.9	2875.7	2892.4	2867.3	2875.7	2867.3	2892.4	2892.4	2884.0	2875.7	2871.6
12.5°	2812.8	2846.3	2846.3	2842.2	2833.8	2821.2	2846.3	2863.2	2837.9	2837.9	2833.8
15°	2775.2	2783.6	2787.7	2787.7	2783.6	2792.0	2804.5	2787.7	2792.0	2771.0	2779.3
17.5°	2733.4	2716.7	2729.1	2720.8	2725.0	2733.4	2750.1	2750.1	2725.0	2720.8	2729.1
20°	2637.1	2687.3	2691.6	2666.5	2670.6	2670.6	2699.9	2674.8	2691.6	2670.6	2678.9
22.5°	2591.0	2624.4	2628.7	2595.2	2616.1	2591.0	2620.3	2582.6	2624.4	2595.2	2607.7
25°	2532.4	2528.3	2540.8	2524.0	2528.3	2528.3	2549.1	2532.4	2545.0	2528.3	2532.4
27.5°	2436.2	2469.7	2465.4	2448.7	2457.1	2453.0	2494.8	2448.7	2473.8	2453.0	2461.3
30°	2352.4	2381.8	2373.4	2356.7	2356.7	2344.0	2390.1	2377.5	2373.4	2373.4	2369.1
32.5°	2268.7	2273.0	2264.6	2268.7	2273.0	2256.2	2293.8	2277.1	2273.0	2277.1	2281.3
35°	2155.6	2155.6	2164.0	2151.5	2168.3	2168.3	2201.8	2180.8	2176.6	2164.0	2176.6
37.5°	2055.2	2042.8	2046.9	2046.9	2055.2	2063.6	2080.3	2072.0	2072.0	2059.5	2067.9
40°	1921.3	1913.0	1925.4	1925.4	1938.1	1938.1	1954.8	1946.4	1958.9	1958.9	1958.9
42.5°	1804.2	1804.2	1795.8	1808.3	1812.5	1808.3	1837.6	1833.4	1837.6	1829.3	1833.4
45°	1678.5	1678.5	1670.1	1666.0	1686.8	1682.7	1716.2	1703.6	1720.3	1711.9	1716.2
47.5°	1506.8	1527.8	1515.2	1527.8	1552.9	1557.2	1578.0	1569.7	1586.4	1573.9	1590.7
50°	1343.7	1343.7	1356.2	1372.9	1398.0	1402.3	1427.4	1444.2	1452.5	1456.6	1460.9
52.5°	1172.1	1167.8	1180.5	1201.3	1222.3	1239.0	1264.1	1289.3	1306.0	1331.1	1318.5
55°	971.1	979.5	992.1	1017.2	1050.7	1071.5	1092.5	1126.0	1155.4	1167.8	1192.9
57.5°	799.4	791.1	799.4	832.9	870.7	887.4	916.8	950.2	992.1	1017.2	1025.6
60°	619.4	623.7	632.1	661.4	690.7	715.8	728.4	782.7	820.4	845.6	862.3
62.5°	456.3	464.7	473.1	498.2	527.4	548.4	569.2	615.3	648.8	673.9	690.7
65°	318.2	322.3	334.9	347.4	376.7	397.6	414.3	452.1	485.5	506.5	519.0
67.5°	196.7	200.8	209.2	226.1	247.0	263.7	280.4	305.5	334.9	355.7	360.0
70°	100.4	104.7	108.8	121.4	138.2	146.5	159.0	180.0	200.8	217.6	226.1
72.5°	33.5	33.5	37.7	46.1	54.5	62.8	66.9	88.0	104.7	113.1	117.2
75°	8.4	8.4	8.4	8.4	8.4	12.6	12.6	25.1	33.5	41.8	46.1
77.5°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	8.4	8.4
80°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C65D010 FEU4C659027 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9	2946.9
2.5°	2946.9	2938.5	2934.2	2938.5	2938.5	2934.2	2946.9	2963.6	2984.5	2930.1
5°	2942.6	2934.2	2942.6	2917.5	2930.1	2921.8	2938.5	2934.2	2951.0	2934.2
7.5°	2930.1	2913.4	2917.5	2905.0	2921.8	2900.8	2913.4	2938.5	2921.8	2896.7
10°	2888.3	2879.9	2909.1	2867.3	2858.9	2875.7	2909.1	2884.0	2875.7	2884.0
12.5°	2846.3	2846.3	2858.9	2825.5	2829.6	2837.9	2854.7	2837.9	2846.3	2867.3
15°	2800.4	2792.0	2812.8	2787.7	2783.6	2775.2	2792.0	2792.0	2800.4	2787.7
17.5°	2745.9	2733.4	2733.4	2725.0	2720.8	2741.8	2750.1	2754.2	2758.5	2741.8
20°	2678.9	2674.8	2687.3	2674.8	2678.9	2683.2	2683.2	2674.8	2712.4	2666.5
22.5°	2607.7	2620.3	2603.6	2595.2	2603.6	2612.0	2612.0	2616.1	2607.7	2599.3
25°	2536.7	2545.0	2549.1	2524.0	2536.7	2524.0	2553.4	2557.5	2540.8	2549.1
27.5°	2473.8	2461.3	2457.1	2440.3	2448.7	2444.6	2448.7	2448.7	2473.8	2440.3
30°	2377.5	2365.0	2369.1	2356.7	2360.8	2356.7	2360.8	2360.8	2377.5	2373.4
32.5°	2285.4	2273.0	2277.1	2264.6	2264.6	2268.7	2260.3	2260.3	2273.0	2264.6
35°	2197.5	2168.3	2172.4	2168.3	2172.4	2155.6	2155.6	2151.5	2159.9	2138.9
37.5°	2072.0	2059.5	2055.2	2051.1	2055.2	2046.9	2055.2	2042.8	2055.2	2038.5
40°	1958.9	1950.5	1954.8	1929.7	1929.7	1933.8	1925.4	1921.3	1925.4	1942.2
42.5°	1846.0	1829.3	1820.9	1812.5	1816.6	1804.2	1799.9	1791.5	1799.9	1783.2
45°	1711.9	1711.9	1707.8	1686.8	1691.1	1691.1	1674.4	1657.6	1661.7	1661.7
47.5°	1590.7	1582.3	1578.0	1557.2	1552.9	1548.8	1531.9	1519.5	1519.5	1506.8
50°	1456.6	1448.3	1435.8	1414.8	1406.4	1381.3	1368.8	1352.1	1335.4	1335.4
52.5°	1331.1	1301.7	1285.0	1251.5	1239.0	1226.4	1192.9	1180.5	1167.8	1155.4
55°	1180.5	1155.4	1121.9	1084.1	1067.4	1046.4	1012.9	987.8	971.1	975.3
57.5°	1033.9	992.1	958.6	908.4	887.4	874.8	841.3	807.8	791.1	791.1
60°	853.9	820.4	778.6	732.5	715.8	694.9	652.9	632.1	619.4	607.0
62.5°	682.3	657.2	619.4	560.9	548.4	527.4	498.2	473.1	460.4	460.4
65°	510.6	485.5	452.1	410.2	393.5	376.7	351.6	326.5	313.9	309.8
67.5°	360.0	330.6	301.4	268.0	255.3	247.0	221.8	205.1	196.7	192.5
70°	217.6	200.8	180.0	154.9	142.3	133.9	117.2	104.7	100.4	96.3
72.5°	113.1	100.4	83.7	66.9	58.6	50.2	41.8	33.5	29.4	29.4
75°	41.8	33.5	21.0	12.6	8.4	8.4	8.4	8.4	8.4	8.4
77.5°	8.4	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
80°	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)