

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.



Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW
 Description: 4 INCH 6500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 6545.0 lumens
 Efficiency: N/A
 Efficacy: 90.4 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 72.4
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

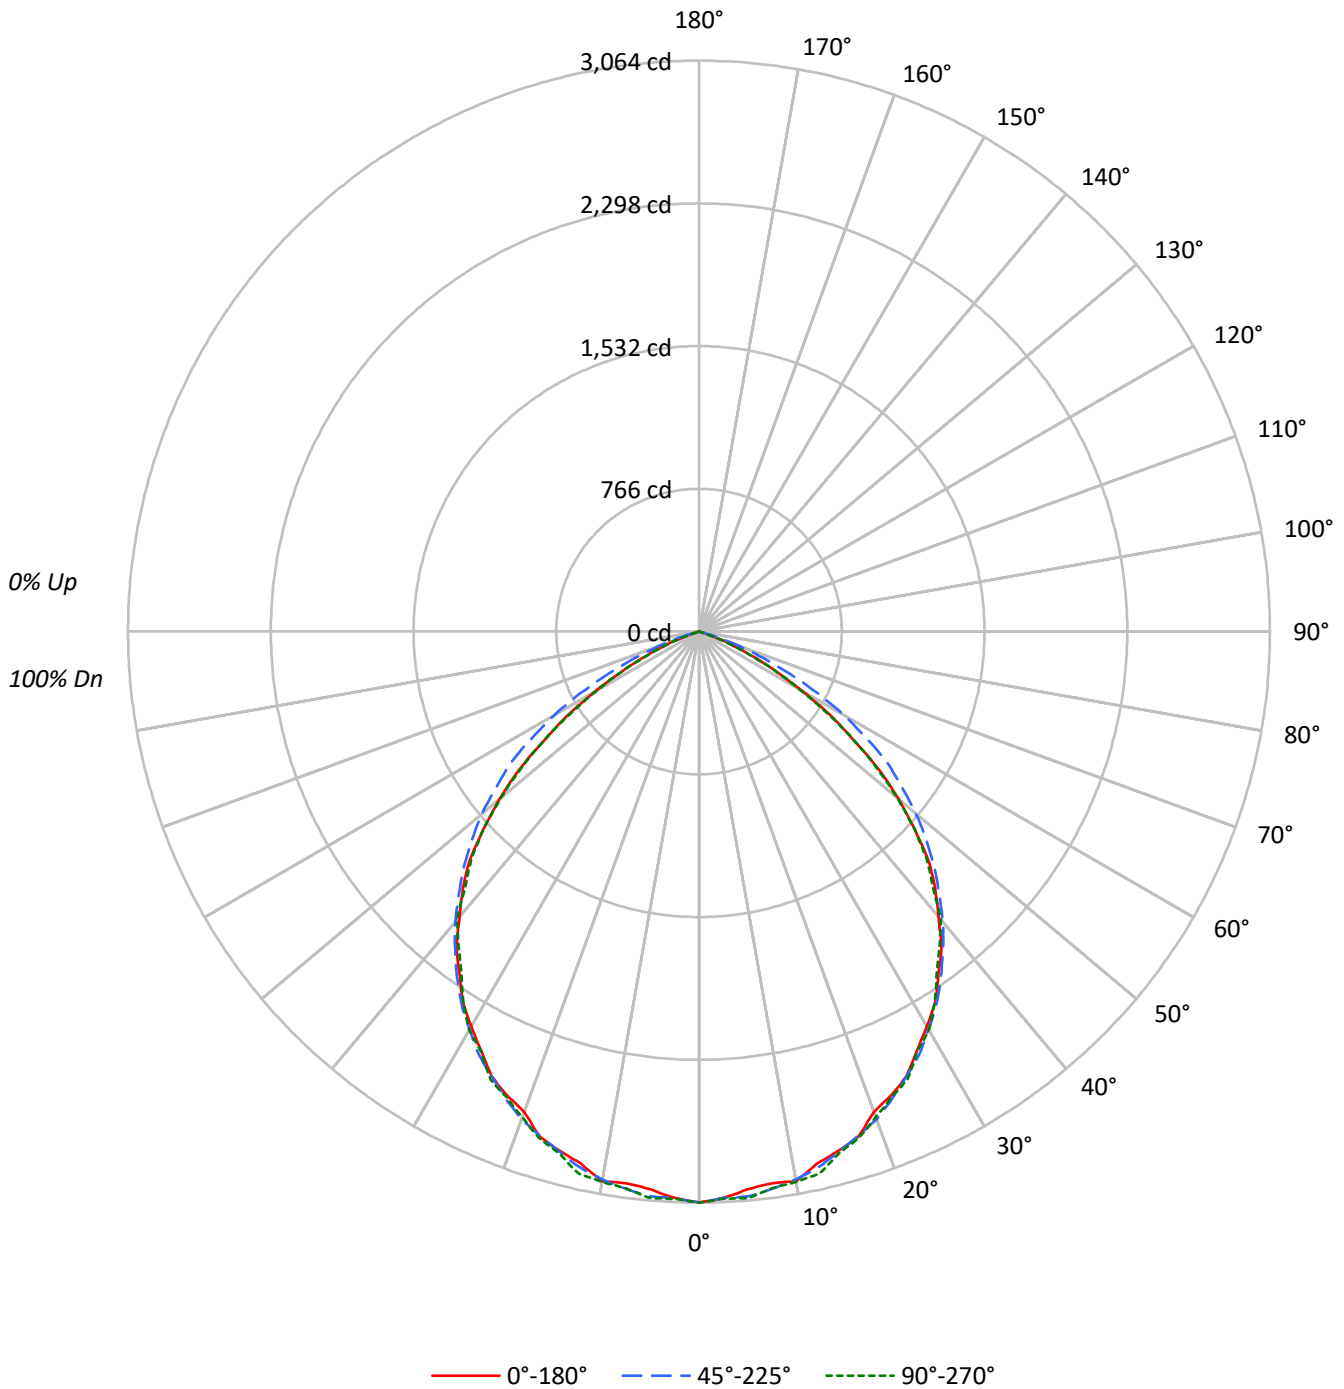

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	295632	295632	295632
5°	290863	294650	295493
10°	293374	292521	293795
15°	288240	288660	289529
20°	281532	285998	284674
25°	280319	280319	282171
30°	272501	274439	274930
35°	264005	266573	261956
40°	251612	256537	254346
45°	238129	243492	235755
50°	209719	228002	208413
55°	169838	208647	170595
60°	124278	173005	121788
65°	75526	123197	73539
70°	29453	66325	28240
75°	3243	17857	3243
80°	2445	2445	2445
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	289.2	4.4
10°-20°	818.4	12.5
20°-30°	1214.3	18.6
30°-40°	1407.0	21.5
40°-50°	1349.0	20.6
50°-60°	991.9	15.2
60°-70°	428.4	6.5
70°-80°	46.2	0.7
80°-90°	0.6	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2321.9	35.5
0°-40°	3728.9	57.0
0°-60°	6069.8	92.7
0°-90°	6545.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6545.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3064	3064	3064	3064	3064	
5°	3003	3033	3042	3046	3051	286
15°	2886	2903	2890	2894	2898	813
25°	2633	2629	2633	2637	2650	1206
35°	2241	2254	2263	2259	2224	1401
45°	1745	1750	1784	1758	1728	1327
55°	1010	1114	1240	1110	1014	909
65°	331	413	540	409	322	340
75°	9	13	48	9	9	27
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9
2.5°	3042.1	3076.9	3081.3	3059.5	3050.8	3037.8	3068.2	3046.5	3055.2	3046.5	3042.1
5°	3003.0	3042.1	3046.5	3046.5	3037.8	3033.4	3046.5	3042.1	3037.8	3029.1	3042.1
7.5°	2985.6	3007.3	3029.1	3003.0	3016.0	3011.7	3042.1	3029.1	3024.7	3024.7	3016.0
10°	2994.3	2989.9	3007.3	2981.2	2989.9	2981.2	3007.3	3007.3	2998.6	2989.9	2985.6
12.5°	2924.5	2959.3	2959.3	2955.1	2946.4	2933.2	2959.3	2976.9	2950.6	2950.6	2946.4
15°	2885.5	2894.2	2898.4	2898.4	2894.2	2902.9	2915.8	2898.4	2902.9	2881.0	2889.7
17.5°	2842.0	2824.6	2837.5	2828.8	2833.3	2842.0	2859.4	2859.4	2833.3	2828.8	2837.5
20°	2741.8	2794.0	2798.5	2772.4	2776.6	2776.6	2807.2	2781.1	2798.5	2776.6	2785.3
22.5°	2693.9	2728.7	2733.1	2698.3	2720.0	2693.9	2724.4	2685.2	2728.7	2698.3	2711.3
25°	2633.0	2628.7	2641.7	2624.3	2628.7	2628.7	2650.4	2633.0	2646.1	2628.7	2633.0
27.5°	2533.0	2567.8	2563.4	2546.0	2554.7	2550.4	2593.9	2546.0	2572.1	2550.4	2559.1
30°	2445.8	2476.3	2467.6	2450.2	2450.2	2437.1	2485.0	2471.9	2467.6	2467.6	2463.2
32.5°	2358.8	2363.2	2354.5	2358.8	2363.2	2345.8	2384.9	2367.5	2363.2	2367.5	2371.9
35°	2241.3	2241.3	2250.0	2237.0	2254.4	2254.4	2289.2	2267.4	2263.1	2250.0	2263.1
37.5°	2136.8	2123.9	2128.1	2128.1	2136.8	2145.5	2162.9	2154.2	2154.2	2141.3	2150.0
40°	1997.6	1988.9	2001.9	2001.9	2015.0	2015.0	2032.4	2023.7	2036.7	2036.7	2036.7
42.5°	1875.8	1875.8	1867.1	1880.1	1884.5	1880.1	1910.6	1906.2	1910.6	1901.9	1906.2
45°	1745.1	1745.1	1736.4	1732.2	1753.8	1749.6	1784.4	1771.2	1788.6	1779.9	1784.4
47.5°	1566.7	1588.5	1575.4	1588.5	1614.6	1619.1	1640.7	1632.0	1649.4	1636.5	1653.9
50°	1397.1	1397.1	1410.1	1427.5	1453.6	1458.0	1484.1	1501.5	1510.2	1514.5	1518.9
52.5°	1218.6	1214.2	1227.3	1249.0	1270.8	1288.2	1314.4	1340.5	1357.9	1384.0	1370.8
55°	1009.6	1018.3	1031.5	1057.6	1092.4	1114.1	1135.9	1170.7	1201.2	1214.2	1240.3
57.5°	831.2	822.5	831.2	866.0	905.2	922.6	953.2	988.0	1031.5	1057.6	1066.3
60°	644.0	648.5	657.2	687.7	718.1	744.2	757.3	813.8	853.0	879.1	896.5
62.5°	474.5	483.2	491.9	518.0	548.3	570.2	591.8	639.8	674.6	700.7	718.1
65°	330.8	335.1	348.2	361.2	391.7	413.4	430.8	470.0	504.8	526.7	539.6
67.5°	204.6	208.8	217.5	235.1	256.8	274.2	291.6	317.7	348.2	369.9	374.3
70°	104.4	108.8	113.1	126.2	143.7	152.4	165.3	187.2	208.8	226.2	235.1
72.5°	34.8	34.8	39.2	47.9	56.6	65.3	69.6	91.4	108.8	117.5	121.8
75°	8.7	8.7	8.7	8.7	8.7	13.1	13.1	26.1	34.8	43.5	47.9
77.5°	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	8.7	8.7
80°	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C65D010 FEU4C659030 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9	3063.9
2.5°	3063.9	3055.2	3050.8	3055.2	3055.2	3050.8	3063.9	3081.3	3103.0	3046.5
5°	3059.5	3050.8	3059.5	3033.4	3046.5	3037.8	3055.2	3050.8	3068.2	3050.8
7.5°	3046.5	3029.1	3033.4	3020.4	3037.8	3016.0	3029.1	3055.2	3037.8	3011.7
10°	3003.0	2994.3	3024.7	2981.2	2972.5	2989.9	3024.7	2998.6	2989.9	2998.6
12.5°	2959.3	2959.3	2972.5	2937.7	2941.9	2950.6	2968.0	2950.6	2959.3	2981.2
15°	2911.6	2902.9	2924.5	2898.4	2894.2	2885.5	2902.9	2902.9	2911.6	2898.4
17.5°	2854.9	2842.0	2842.0	2833.3	2828.8	2850.7	2859.4	2863.6	2868.1	2850.7
20°	2785.3	2781.1	2794.0	2781.1	2785.3	2789.8	2789.8	2781.1	2820.1	2772.4
22.5°	2711.3	2724.4	2707.0	2698.3	2707.0	2715.7	2715.7	2720.0	2711.3	2702.6
25°	2637.4	2646.1	2650.4	2624.3	2637.4	2624.3	2654.8	2659.1	2641.7	2650.4
27.5°	2572.1	2559.1	2554.7	2537.3	2546.0	2541.7	2546.0	2546.0	2572.1	2537.3
30°	2471.9	2458.9	2463.2	2450.2	2454.5	2450.2	2454.5	2454.5	2471.9	2467.6
32.5°	2376.2	2363.2	2367.5	2354.5	2354.5	2358.8	2350.1	2350.1	2363.2	2354.5
35°	2284.8	2254.4	2258.7	2254.4	2258.7	2241.3	2241.3	2237.0	2245.7	2223.9
37.5°	2154.2	2141.3	2136.8	2132.6	2136.8	2128.1	2136.8	2123.9	2136.8	2119.4
40°	2036.7	2028.0	2032.4	2006.3	2006.3	2010.6	2001.9	1997.6	2001.9	2019.3
42.5°	1919.3	1901.9	1893.2	1884.5	1888.8	1875.8	1871.4	1862.7	1871.4	1854.0
45°	1779.9	1779.9	1775.7	1753.8	1758.3	1758.3	1740.9	1723.5	1727.7	1727.7
47.5°	1653.9	1645.2	1640.7	1619.1	1614.6	1610.4	1592.8	1579.8	1579.8	1566.7
50°	1514.5	1505.8	1492.8	1471.0	1462.3	1436.2	1423.2	1405.8	1388.4	1388.4
52.5°	1384.0	1353.4	1336.0	1301.2	1288.2	1275.1	1240.3	1227.3	1214.2	1201.2
55°	1227.3	1201.2	1166.4	1127.2	1109.8	1088.0	1053.2	1027.0	1009.6	1014.1
57.5°	1075.0	1031.5	996.7	944.5	922.6	909.5	874.7	839.9	822.5	822.5
60°	887.8	853.0	809.5	761.6	744.2	722.5	678.8	657.2	644.0	631.1
62.5°	709.4	683.3	644.0	583.1	570.2	548.3	518.0	491.9	478.7	478.7
65°	530.9	504.8	470.0	426.5	409.1	391.7	365.6	339.5	326.4	322.1
67.5°	374.3	343.8	313.4	278.6	265.5	256.8	230.7	213.3	204.6	200.1
70°	226.2	208.8	187.2	161.1	147.9	139.2	121.8	108.8	104.4	100.1
72.5°	117.5	104.4	87.0	69.6	60.9	52.2	43.5	34.8	30.5	30.5
75°	43.5	34.8	21.8	13.1	8.7	8.7	8.7	8.7	8.7	8.7
77.5°	8.7	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4
80°	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4	4.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)