

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.



Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW
 Description: 4 INCH 7500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 5000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 8378.0 lumens
 Efficiency: N/A
 Efficacy: 102.8 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 81.5
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

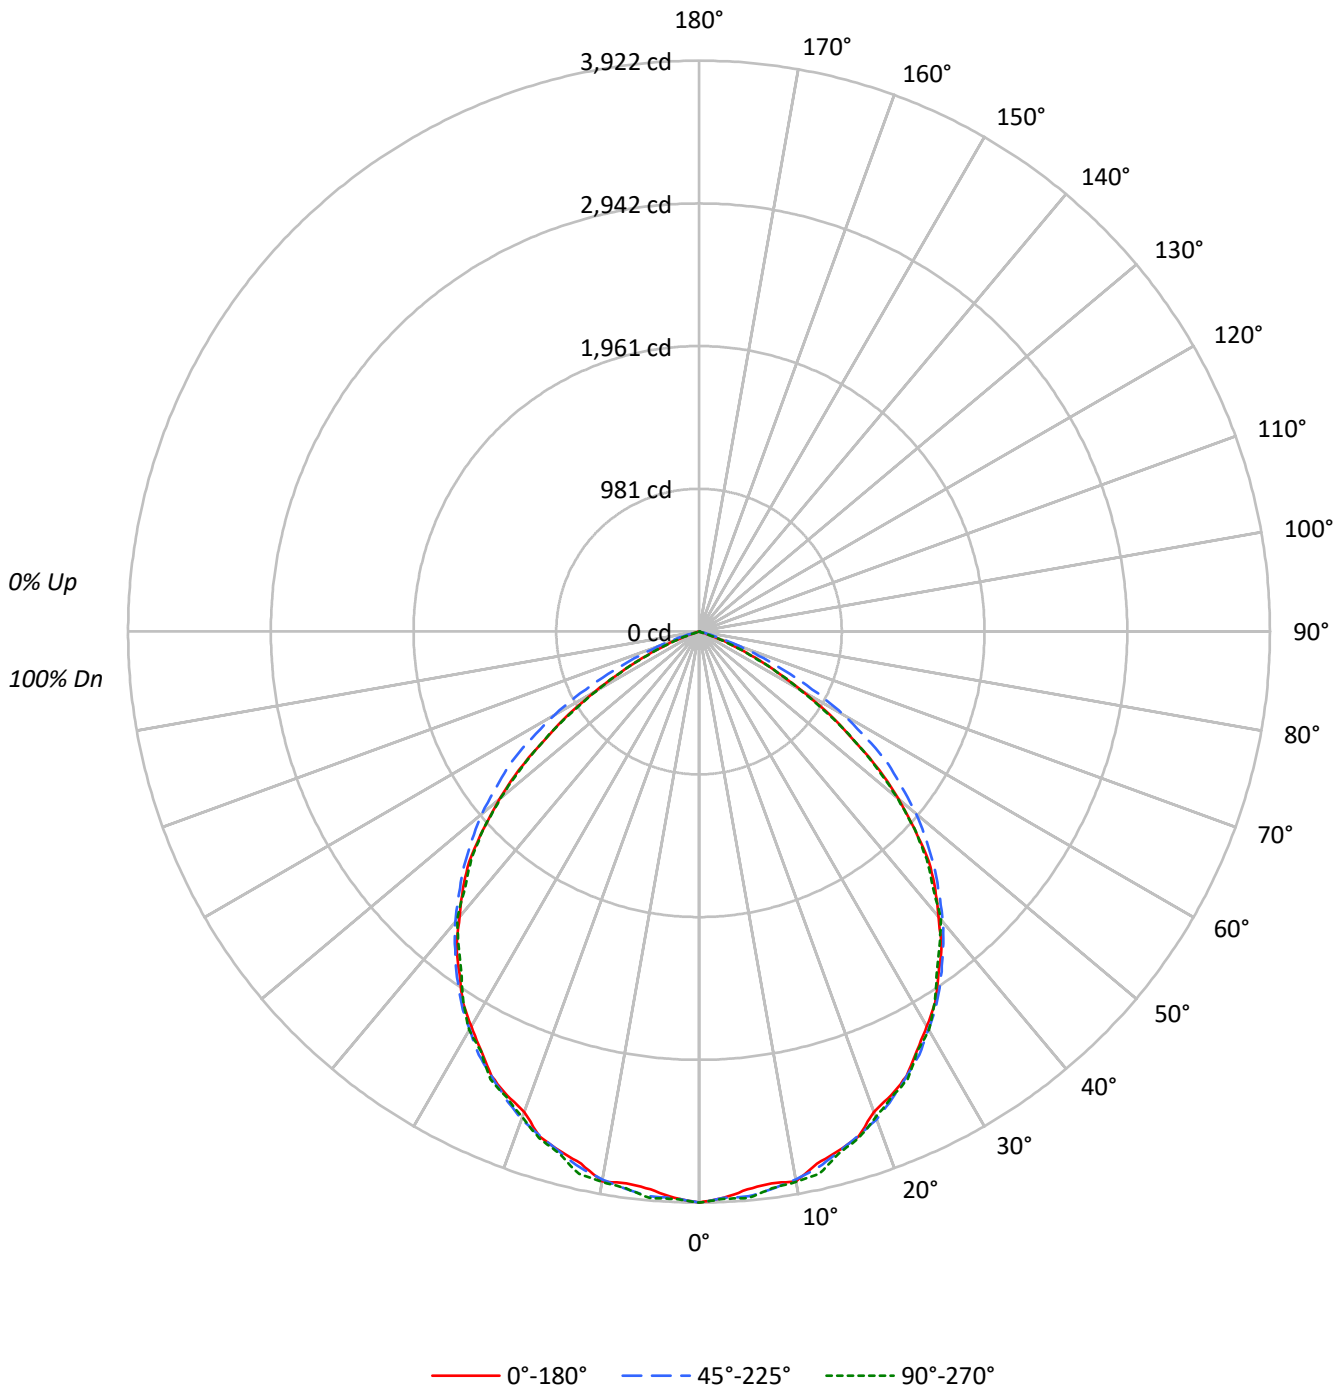

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	378429	378429	378429
5°	372320	377163	378248
10°	375538	374450	376076
15°	368964	369503	370622
20°	360381	366100	364396
25°	358825	358825	361189
30°	348821	351305	351929
35°	337931	341229	335316
40°	322085	328383	325574
45°	304829	311679	301786
50°	268457	291859	266776
55°	217412	267088	218371
60°	159091	221461	155887
65°	96690	157718	94133
70°	37719	84888	36167
75°	4138	22890	4138
80°	3167	3167	3167
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	370.2	4.4
10°-20°	1047.6	12.5
20°-30°	1554.4	18.6
30°-40°	1801.1	21.5
40°-50°	1726.8	20.6
50°-60°	1269.7	15.2
60°-70°	548.4	6.5
70°-80°	59.2	0.7
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2972.1	35.5
0°-40°	4773.2	57.0
0°-60°	7769.7	92.7
0°-90°	8378.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8378.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3922	3922	3922	3922	3922	
5°	3844	3883	3894	3900	3905	367
15°	3694	3716	3699	3705	3710	1041
25°	3370	3365	3370	3376	3393	1543
35°	2869	2886	2897	2891	2847	1794
45°	2234	2240	2284	2251	2212	1698
55°	1292	1426	1588	1421	1298	1163
65°	424	529	691	524	412	435
75°	11	17	61	11	11	34
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0
2.5°	3894.0	3938.6	3944.3	3916.3	3905.2	3888.6	3927.5	3899.7	3910.9	3899.7	3894.0
5°	3844.0	3894.0	3899.7	3899.7	3888.6	3882.9	3899.7	3894.0	3888.6	3877.4	3894.0
7.5°	3821.8	3849.5	3877.4	3844.0	3860.6	3855.2	3894.0	3877.4	3871.8	3871.8	3860.6
10°	3832.9	3827.2	3849.5	3816.1	3827.2	3816.1	3849.5	3849.5	3838.4	3827.2	3821.8
12.5°	3743.6	3788.1	3788.1	3782.7	3771.5	3754.7	3788.1	3810.6	3777.0	3777.0	3771.5
15°	3693.6	3704.7	3710.2	3710.2	3704.7	3715.8	3732.4	3710.2	3715.8	3687.9	3699.0
17.5°	3637.9	3615.6	3632.2	3621.1	3626.7	3637.9	3660.2	3660.2	3626.7	3621.1	3632.2
20°	3509.7	3576.5	3582.2	3548.8	3554.2	3554.2	3593.3	3559.9	3582.2	3554.2	3565.4
22.5°	3448.3	3492.9	3498.5	3454.0	3481.7	3448.3	3487.4	3437.2	3492.9	3454.0	3470.6
25°	3370.4	3364.9	3381.5	3359.2	3364.9	3364.9	3392.6	3370.4	3387.2	3364.9	3370.4
27.5°	3242.4	3286.9	3281.3	3259.0	3270.1	3264.7	3320.3	3259.0	3292.4	3264.7	3275.8
30°	3130.8	3169.9	3158.7	3136.5	3136.5	3119.6	3181.0	3164.2	3158.7	3158.7	3153.1
32.5°	3019.4	3025.1	3014.0	3019.4	3025.1	3002.8	3052.8	3030.5	3025.1	3030.5	3036.2
35°	2868.9	2868.9	2880.1	2863.5	2885.8	2885.8	2930.3	2902.4	2896.9	2880.1	2896.9
37.5°	2735.3	2718.7	2724.2	2724.2	2735.3	2746.4	2768.7	2757.6	2757.6	2741.0	2752.1
40°	2557.1	2545.9	2562.5	2562.5	2579.4	2579.4	2601.6	2590.5	2607.1	2607.1	2607.1
42.5°	2401.2	2401.2	2390.0	2406.6	2412.3	2406.6	2445.7	2440.0	2445.7	2434.6	2440.0
45°	2233.9	2233.9	2222.7	2217.3	2245.0	2239.6	2284.1	2267.3	2289.6	2278.4	2284.1
47.5°	2005.4	2033.4	2016.6	2033.4	2066.8	2072.5	2100.2	2089.1	2111.4	2094.8	2117.0
50°	1788.4	1788.4	1805.0	1827.2	1860.7	1866.3	1899.7	1922.0	1933.2	1938.6	1944.3
52.5°	1559.9	1554.3	1571.1	1598.8	1626.8	1649.0	1682.4	1715.9	1738.1	1771.6	1754.7
55°	1292.4	1303.5	1320.4	1353.8	1398.3	1426.1	1454.0	1498.6	1537.7	1554.3	1587.7
57.5°	1064.0	1052.8	1064.0	1108.5	1158.8	1181.0	1220.1	1264.7	1320.4	1353.8	1364.9
60°	824.4	830.1	841.2	880.3	919.2	952.6	969.4	1041.7	1091.9	1125.3	1147.6
62.5°	607.3	618.5	629.6	663.0	701.9	729.8	757.6	818.9	863.5	896.9	919.2
65°	423.5	428.9	445.7	462.3	501.4	529.2	551.4	601.7	646.2	674.2	690.8
67.5°	261.8	267.3	278.4	300.9	328.7	350.9	373.2	406.6	445.7	473.5	479.1
70°	133.7	139.3	144.8	161.6	183.9	195.0	211.6	239.6	267.3	289.6	300.9
72.5°	44.6	44.6	50.2	61.4	72.5	83.6	89.1	117.1	139.3	150.5	155.9
75°	11.1	11.1	11.1	11.1	11.1	16.8	16.8	33.4	44.6	55.7	61.4
77.5°	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	11.1	11.1
80°	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C75D010 FEU4C759050 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0	3922.0
2.5°	3922.0	3910.9	3905.2	3910.9	3910.9	3905.2	3922.0	3944.3	3972.0	3899.7
5°	3916.3	3905.2	3916.3	3882.9	3899.7	3888.6	3910.9	3905.2	3927.5	3905.2
7.5°	3899.7	3877.4	3882.9	3866.3	3888.6	3860.6	3877.4	3910.9	3888.6	3855.2
10°	3844.0	3832.9	3871.8	3816.1	3804.9	3827.2	3871.8	3838.4	3827.2	3838.4
12.5°	3788.1	3788.1	3804.9	3760.4	3765.9	3777.0	3799.3	3777.0	3788.1	3816.1
15°	3727.0	3715.8	3743.6	3710.2	3704.7	3693.6	3715.8	3715.8	3727.0	3710.2
17.5°	3654.5	3637.9	3637.9	3626.7	3621.1	3649.0	3660.2	3665.6	3671.3	3649.0
20°	3565.4	3559.9	3576.5	3559.9	3565.4	3571.1	3571.1	3559.9	3609.9	3548.8
22.5°	3470.6	3487.4	3465.1	3454.0	3465.1	3476.3	3476.3	3481.7	3470.6	3459.5
25°	3376.0	3387.2	3392.6	3359.2	3376.0	3359.2	3398.3	3403.8	3381.5	3392.6
27.5°	3292.4	3275.8	3270.1	3247.8	3259.0	3253.5	3259.0	3259.0	3292.4	3247.8
30°	3164.2	3147.6	3153.1	3136.5	3141.9	3136.5	3141.9	3141.9	3164.2	3158.7
32.5°	3041.7	3025.1	3030.5	3014.0	3014.0	3019.4	3008.3	3008.3	3025.1	3014.0
35°	2924.6	2885.8	2891.2	2885.8	2891.2	2868.9	2868.9	2863.5	2874.6	2846.7
37.5°	2757.6	2741.0	2735.3	2729.8	2735.3	2724.2	2735.3	2718.7	2735.3	2713.0
40°	2607.1	2596.0	2601.6	2568.2	2568.2	2573.7	2562.5	2557.1	2562.5	2584.8
42.5°	2456.8	2434.6	2423.4	2412.3	2417.8	2401.2	2395.5	2384.3	2395.5	2373.2
45°	2278.4	2278.4	2273.0	2245.0	2250.7	2250.7	2228.4	2206.1	2211.6	2211.6
47.5°	2117.0	2105.9	2100.2	2072.5	2066.8	2061.3	2038.9	2022.3	2022.3	2005.4
50°	1938.6	1927.5	1910.9	1882.9	1871.8	1838.4	1821.8	1799.5	1777.2	1777.2
52.5°	1771.6	1732.5	1710.2	1665.6	1649.0	1632.2	1587.7	1571.1	1554.3	1537.7
55°	1571.1	1537.7	1493.1	1442.9	1420.6	1392.6	1348.1	1314.7	1292.4	1298.1
57.5°	1376.1	1320.4	1275.8	1209.0	1181.0	1164.2	1119.7	1075.1	1052.8	1052.8
60°	1136.5	1091.9	1036.2	974.9	952.6	924.9	869.0	841.2	824.4	807.8
62.5°	908.1	874.6	824.4	746.4	729.8	701.9	663.0	629.6	612.8	612.8
65°	679.6	646.2	601.7	546.0	523.7	501.4	468.0	434.6	417.8	412.3
67.5°	479.1	440.0	401.2	356.6	339.8	328.7	295.3	273.0	261.8	256.2
70°	289.6	267.3	239.6	206.2	189.3	178.2	155.9	139.3	133.7	128.2
72.5°	150.5	133.7	111.4	89.1	78.0	66.8	55.7	44.6	39.1	39.1
75°	55.7	44.6	28.0	16.8	11.1	11.1	11.1	11.1	11.1	11.1
77.5°	11.1	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7
80°	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)