

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW
 Description: 4 INCH 8000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3500K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 8854.0 lumens
 Efficiency: N/A
 Efficacy: 98.9 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 89.5
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

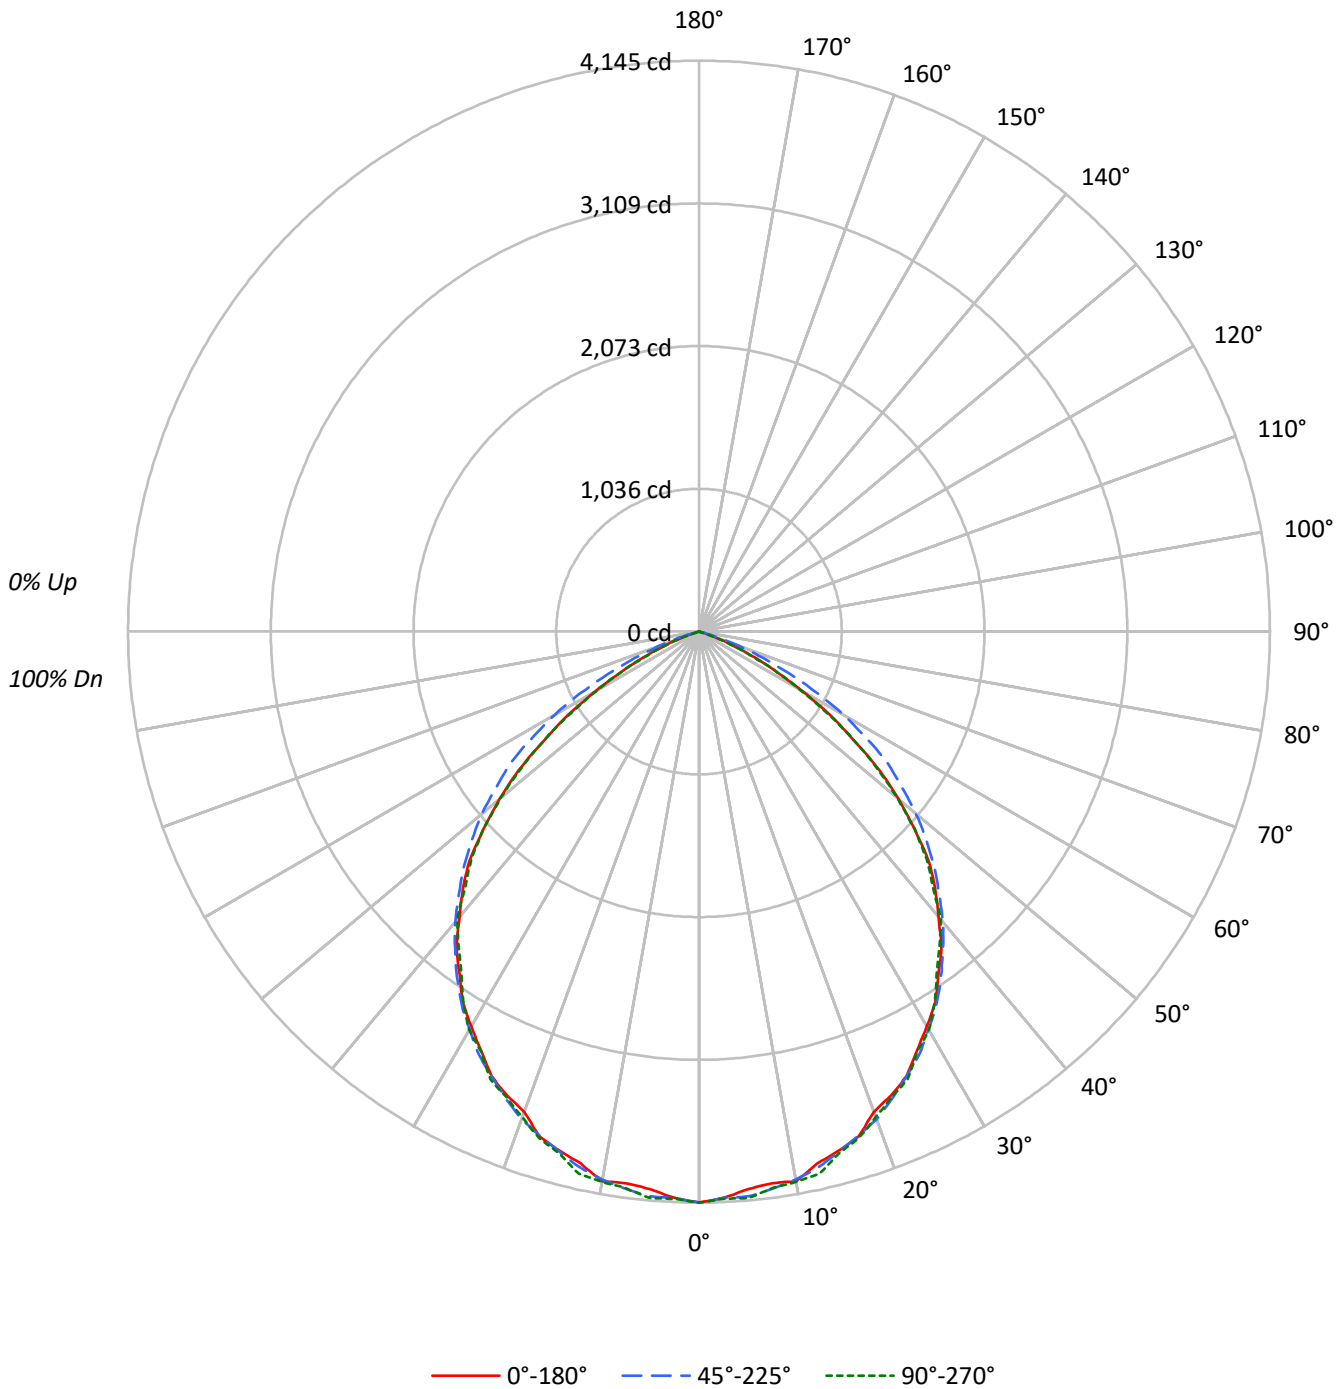

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	399927	399927	399927
5°	393474	398598	399740
10°	396877	395721	397435
15°	389921	390500	391679
20°	380855	386893	385096
25°	379202	379202	381715
30°	368641	371260	371928
35°	357131	360618	354363
40°	340387	347038	344078
45°	322145	329391	318938
50°	283708	308446	281937
55°	229759	282262	230769
60°	168122	234043	164745
65°	102170	166668	99476
70°	39835	89712	38227
75°	4399	24195	4399
80°	3334	3334	3334
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	391.2	4.4
10°-20°	1107.1	12.5
20°-30°	1642.7	18.6
30°-40°	1903.4	21.5
40°-50°	1824.9	20.6
50°-60°	1341.8	15.2
60°-70°	579.5	6.5
70°-80°	62.6	0.7
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3141.0	35.5
0°-40°	5044.4	57.0
0°-60°	8211.1	92.7
0°-90°	8854.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8854.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4145	4145	4145	4145	4145	
5°	4062	4104	4115	4121	4127	388
15°	3903	3927	3909	3915	3921	1100
25°	3562	3556	3562	3568	3585	1631
35°	3032	3050	3062	3056	3008	1896
45°	2361	2367	2414	2379	2337	1795
55°	1366	1507	1678	1501	1372	1229
65°	448	559	730	553	436	460
75°	12	18	65	12	12	36
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8
2.5°	4115.3	4162.4	4168.4	4138.8	4127.1	4109.5	4150.6	4121.3	4133.1	4121.3	4115.3
5°	4062.4	4115.3	4121.3	4121.3	4109.5	4103.5	4121.3	4115.3	4109.5	4097.7	4115.3
7.5°	4038.9	4068.2	4097.7	4062.4	4080.0	4074.2	4115.3	4097.7	4091.7	4091.7	4080.0
10°	4050.7	4044.7	4068.2	4032.9	4044.7	4032.9	4068.2	4068.2	4056.4	4044.7	4038.9
12.5°	3956.3	4003.4	4003.4	3997.6	3985.8	3968.0	4003.4	4027.1	3991.6	3991.6	3985.8
15°	3903.4	3915.2	3921.0	3921.0	3915.2	3927.0	3944.5	3921.0	3927.0	3897.4	3909.2
17.5°	3844.6	3821.0	3838.6	3826.8	3832.8	3844.6	3868.1	3868.1	3832.8	3826.8	3838.6
20°	3709.1	3779.7	3785.7	3750.4	3756.2	3756.2	3797.5	3762.2	3785.7	3756.2	3767.9
22.5°	3644.2	3691.3	3697.3	3650.2	3679.6	3644.2	3685.6	3632.5	3691.3	3650.2	3667.8
25°	3561.8	3556.1	3573.6	3550.1	3556.1	3556.1	3585.4	3561.8	3579.6	3556.1	3561.8
27.5°	3426.6	3473.7	3467.7	3444.1	3455.9	3450.1	3509.0	3444.1	3479.5	3450.1	3461.9
30°	3308.7	3350.0	3338.2	3314.7	3314.7	3296.9	3361.7	3344.0	3338.2	3338.2	3332.2
32.5°	3191.0	3197.0	3185.2	3191.0	3197.0	3173.4	3226.3	3202.7	3197.0	3202.7	3208.7
35°	3031.9	3031.9	3043.7	3026.2	3049.7	3049.7	3096.8	3067.3	3061.5	3043.7	3061.5
37.5°	2890.7	2873.2	2878.9	2878.9	2890.7	2902.5	2926.0	2914.2	2914.2	2896.7	2908.5
40°	2702.4	2690.6	2708.1	2708.1	2725.9	2725.9	2749.5	2737.7	2755.2	2755.2	2755.2
42.5°	2537.6	2537.6	2525.8	2543.4	2549.4	2543.4	2584.7	2578.7	2584.7	2572.9	2578.7
45°	2360.8	2360.8	2349.0	2343.3	2372.6	2366.8	2413.9	2396.1	2419.6	2407.9	2413.9
47.5°	2119.4	2148.9	2131.2	2148.9	2184.2	2190.2	2219.5	2207.8	2231.3	2213.8	2237.3
50°	1890.0	1890.0	1907.5	1931.1	1966.4	1972.4	2007.7	2031.2	2043.0	2048.8	2054.8
52.5°	1648.6	1642.6	1660.3	1689.6	1719.2	1742.7	1778.0	1813.3	1836.9	1872.2	1854.4
55°	1365.8	1377.6	1395.4	1430.7	1477.8	1507.1	1536.6	1583.7	1625.0	1642.6	1677.9
57.5°	1124.4	1112.7	1124.4	1171.5	1224.6	1248.1	1289.4	1336.5	1395.4	1430.7	1442.5
60°	871.2	877.2	889.0	930.3	971.4	1006.7	1024.5	1100.9	1154.0	1189.3	1212.8
62.5°	641.8	653.6	665.4	700.7	741.8	771.3	800.6	865.5	912.6	947.9	971.4
65°	447.5	453.3	471.1	488.6	529.9	559.2	582.8	635.8	682.9	712.5	730.0
67.5°	276.7	282.5	294.3	318.0	347.3	370.9	394.4	429.7	471.1	500.4	506.4
70°	141.2	147.2	153.0	170.8	194.3	206.1	223.6	253.2	282.5	306.0	318.0
72.5°	47.1	47.1	53.1	64.9	76.6	88.4	94.2	123.7	147.2	159.0	164.8
75°	11.8	11.8	11.8	11.8	11.8	17.8	17.8	35.3	47.1	58.9	64.9
77.5°	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	11.8	11.8
80°	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809035 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8	4144.8
2.5°	4144.8	4133.1	4127.1	4133.1	4133.1	4127.1	4144.8	4168.4	4197.7	4121.3
5°	4138.8	4127.1	4138.8	4103.5	4121.3	4109.5	4133.1	4127.1	4150.6	4127.1
7.5°	4121.3	4097.7	4103.5	4086.0	4109.5	4080.0	4097.7	4133.1	4109.5	4074.2
10°	4062.4	4050.7	4091.7	4032.9	4021.1	4044.7	4091.7	4056.4	4044.7	4056.4
12.5°	4003.4	4003.4	4021.1	3974.0	3979.8	3991.6	4015.1	3991.6	4003.4	4032.9
15°	3938.7	3927.0	3956.3	3921.0	3915.2	3903.4	3927.0	3927.0	3938.7	3921.0
17.5°	3862.1	3844.6	3844.6	3832.8	3826.8	3856.3	3868.1	3873.9	3879.9	3856.3
20°	3767.9	3762.2	3779.7	3762.2	3767.9	3773.9	3773.9	3762.2	3815.0	3750.4
22.5°	3667.8	3685.6	3662.0	3650.2	3662.0	3673.8	3673.8	3679.6	3667.8	3656.0
25°	3567.8	3579.6	3585.4	3550.1	3567.8	3550.1	3591.4	3597.2	3573.6	3585.4
27.5°	3479.5	3461.9	3455.9	3432.4	3444.1	3438.4	3444.1	3444.1	3479.5	3432.4
30°	3344.0	3326.4	3332.2	3314.7	3320.4	3314.7	3320.4	3320.4	3344.0	3338.2
32.5°	3214.5	3197.0	3202.7	3185.2	3185.2	3191.0	3179.2	3179.2	3197.0	3185.2
35°	3090.8	3049.7	3055.5	3049.7	3055.5	3031.9	3031.9	3026.2	3037.9	3008.4
37.5°	2914.2	2896.7	2890.7	2884.9	2890.7	2878.9	2890.7	2873.2	2890.7	2867.2
40°	2755.2	2743.4	2749.5	2714.1	2714.1	2719.9	2708.1	2702.4	2708.1	2731.7
42.5°	2596.4	2572.9	2561.1	2549.4	2555.1	2537.6	2531.6	2519.8	2531.6	2508.0
45°	2407.9	2407.9	2402.1	2372.6	2378.6	2378.6	2355.0	2331.5	2337.3	2337.3
47.5°	2237.3	2225.5	2219.5	2190.2	2184.2	2178.5	2154.7	2137.2	2137.2	2119.4
50°	2048.8	2037.0	2019.4	1989.9	1978.1	1942.8	1925.3	1901.7	1878.2	1878.2
52.5°	1872.2	1830.9	1807.3	1760.3	1742.7	1725.0	1677.9	1660.3	1642.6	1625.0
55°	1660.3	1625.0	1577.9	1524.9	1501.3	1471.8	1424.7	1389.4	1365.8	1371.8
57.5°	1454.2	1395.4	1348.3	1277.7	1248.1	1230.4	1183.3	1136.2	1112.7	1112.7
60°	1201.1	1154.0	1095.1	1030.3	1006.7	977.4	918.3	889.0	871.2	853.7
62.5°	959.6	924.3	871.2	788.9	771.3	741.8	700.7	665.4	647.6	647.6
65°	718.2	682.9	635.8	577.0	553.4	529.9	494.6	459.3	441.5	435.7
67.5°	506.4	465.1	424.0	376.9	359.1	347.3	312.0	288.5	276.7	270.7
70°	306.0	282.5	253.2	217.9	200.1	188.3	164.8	147.2	141.2	135.5
72.5°	159.0	141.2	117.7	94.2	82.4	70.6	58.9	47.1	41.3	41.3
75°	58.9	47.1	29.5	17.8	11.8	11.8	11.8	11.8	11.8	11.8
77.5°	11.8	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0
80°	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0	6.0
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)