

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

**Test Information**

Test Method: LM-79-08  
 Report Number: P#  
 Test Lab: INNOVATION CENTER  
 Issue Date: 12/13/2022  
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
 Product Line: FAIL-SAFE  
 Catalog Number: FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW  
 Description: 4 INCH 8000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 5000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH  
 Light Source: -  
 Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
 Luminaire Lumens: 9049.0 lumens  
 Efficiency: N/A  
 Efficacy: 101.1 lumens/watt  
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29  
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')  
 CIE Type: Direct

Input Watts (W): 89.5  
 Input Voltage (V):  
 Input Current (Ain): NR  
 Voltage Rise (V): NR  
 Power Factor: NR  
 Total Harmonic Distortion (THDi): NR  
 Frequency (hertz): 60  
 Stabilization Time: NR  
 Operation Time: NR  
 Ambient Temperature (°C): NR  
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#  
CATALOG NUMBER: FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW

### Luminous Intensity Polar Plot

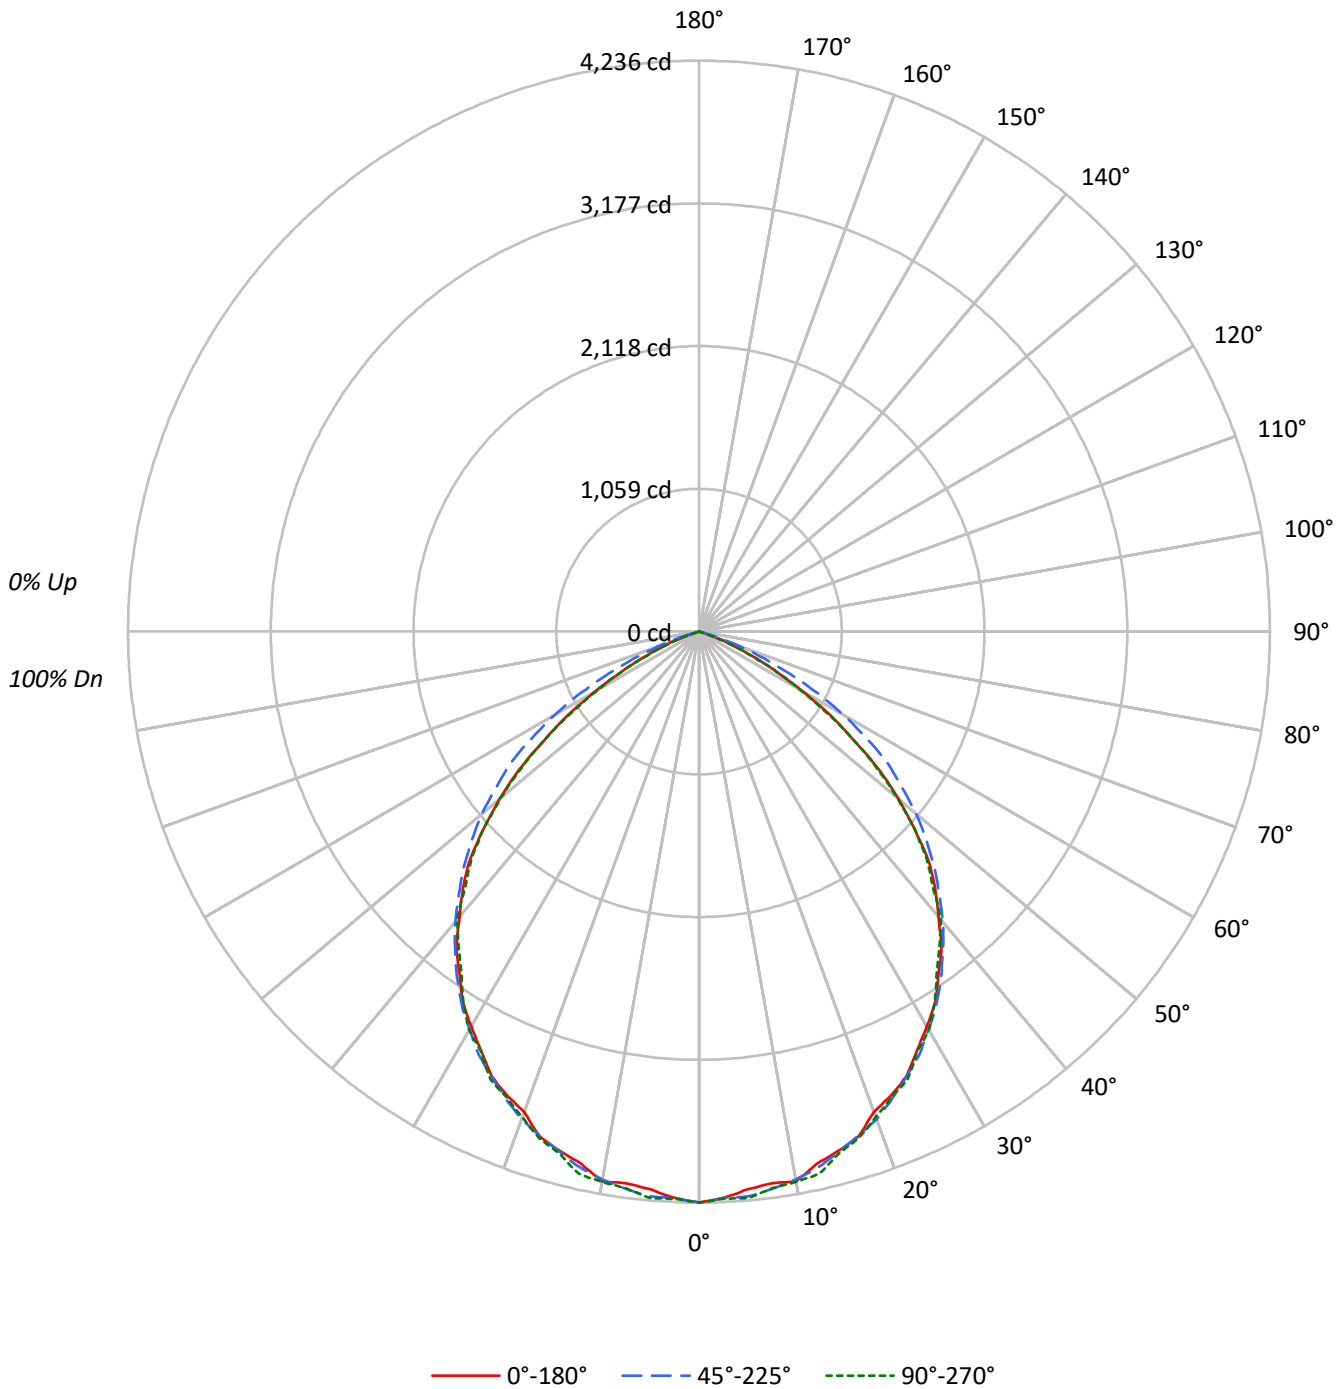

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		94	92	91	89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		85	82	79	77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		77	73	69	67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		69	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		63	58	54	52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		57	52	48	46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		53	47	43	41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		45	39	35	33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		42	36	32	31

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	408737	408737	408737
5°	402143	407373	408545
10°	405617	404431	406195
15°	398512	399101	400300
20°	389244	395416	393578
25°	387560	387560	390126
30°	376752	379438	380117
35°	365000	368557	362173
40°	347881	354683	351648
45°	329241	336637	325952
50°	289953	315231	288151
55°	234823	288469	235866
60°	171827	239196	168373
65°	104430	170344	101667
70°	40737	91687	39073
75°	4474	24717	4474
80°	3390	3390	3390
85°	0	0	0

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	399.9	4.4
10°-20°	1131.5	12.5
20°-30°	1678.9	18.6
30°-40°	1945.3	21.5
40°-50°	1865.1	20.6
50°-60°	1371.3	15.2
60°-70°	592.3	6.5
70°-80°	63.9	0.7
80°-90°	0.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3210.2	35.5
0°-40°	5155.5	57.0
0°-60°	8391.9	92.7
0°-90°	9049.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9049.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	4236	4236	4236	4236	4236	
5°	4152	4194	4206	4212	4218	396
15°	3989	4013	3995	4001	4007	1124
25°	3640	3634	3640	3646	3664	1667
35°	3099	3117	3129	3123	3075	1938
45°	2413	2419	2467	2431	2389	1834
55°	1396	1540	1715	1534	1402	1256
65°	457	572	746	566	445	470
75°	12	18	66	12	12	37
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW

**CANDELA DISTRIBUTION (FULL):**

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1
2.5°	4205.9	4254.0	4260.2	4230.0	4218.0	4200.0	4242.0	4212.1	4224.1	4212.1	4205.9
5°	4151.9	4205.9	4212.1	4212.1	4200.0	4193.9	4212.1	4205.9	4200.0	4188.0	4205.9
7.5°	4127.8	4157.8	4188.0	4151.9	4169.8	4163.9	4205.9	4188.0	4181.9	4181.9	4169.8
10°	4139.9	4133.7	4157.8	4121.7	4133.7	4121.7	4157.8	4157.8	4145.8	4133.7	4127.8
12.5°	4043.4	4091.5	4091.5	4085.6	4073.6	4055.4	4091.5	4115.8	4079.5	4079.5	4073.6
15°	3989.4	4001.4	4007.3	4007.3	4001.4	4013.4	4031.4	4007.3	4013.4	3983.3	3995.3
17.5°	3929.2	3905.2	3923.1	3911.1	3917.2	3929.2	3953.3	3953.3	3917.2	3911.1	3923.1
20°	3790.8	3863.0	3869.1	3833.0	3838.9	3838.9	3881.1	3845.0	3869.1	3838.9	3850.9
22.5°	3724.5	3772.6	3778.8	3730.6	3760.6	3724.5	3766.7	3712.5	3772.6	3730.6	3748.6
25°	3640.3	3634.4	3652.3	3628.3	3634.4	3634.4	3664.4	3640.3	3658.5	3634.4	3640.3
27.5°	3502.1	3550.2	3544.1	3520.0	3532.0	3526.1	3586.3	3520.0	3556.1	3526.1	3538.2
30°	3381.5	3423.8	3411.7	3387.7	3387.7	3369.5	3435.8	3417.6	3411.7	3411.7	3405.6
32.5°	3261.2	3267.4	3255.3	3261.2	3267.4	3243.3	3297.3	3273.3	3267.4	3273.3	3279.4
35°	3098.7	3098.7	3110.7	3092.8	3116.9	3116.9	3165.0	3134.8	3128.9	3110.7	3128.9
37.5°	2954.4	2936.4	2942.3	2942.3	2954.4	2966.4	2990.4	2978.4	2978.4	2960.5	2972.5
40°	2761.9	2749.9	2767.8	2767.8	2785.9	2785.9	2810.0	2798.0	2815.9	2815.9	2815.9
42.5°	2593.5	2593.5	2581.4	2599.4	2605.5	2599.4	2641.6	2635.5	2641.6	2629.6	2635.5
45°	2412.8	2412.8	2400.8	2394.9	2424.8	2418.9	2467.0	2448.9	2472.9	2460.9	2467.0
47.5°	2166.1	2196.3	2178.1	2196.3	2232.3	2238.5	2268.4	2256.4	2280.5	2262.5	2286.6
50°	1931.6	1931.6	1949.5	1973.6	2009.7	2015.8	2051.9	2076.0	2088.0	2093.9	2100.0
52.5°	1684.9	1678.7	1696.9	1726.9	1757.0	1781.1	1817.2	1853.3	1877.3	1913.4	1895.3
55°	1395.9	1408.0	1426.1	1462.2	1510.3	1540.3	1570.5	1618.6	1660.8	1678.7	1714.8
57.5°	1149.2	1137.2	1149.2	1197.3	1251.6	1275.6	1317.8	1366.0	1426.1	1462.2	1474.2
60°	890.4	896.6	908.6	950.8	992.8	1028.9	1047.1	1125.1	1179.4	1215.5	1239.5
62.5°	656.0	668.0	680.0	716.1	758.1	788.3	818.3	884.5	932.7	968.7	992.8
65°	457.4	463.3	481.4	499.4	541.6	571.5	595.6	649.8	698.0	728.2	746.1
67.5°	282.8	288.7	300.7	325.0	355.0	379.1	403.1	439.2	481.4	511.4	517.5
70°	144.4	150.5	156.4	174.5	198.6	210.6	228.6	258.8	288.7	312.8	325.0
72.5°	48.1	48.1	54.3	66.3	78.3	90.3	96.2	126.4	150.5	162.5	168.4
75°	12.0	12.0	12.0	12.0	12.0	18.2	18.2	36.1	48.1	60.1	66.3
77.5°	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	12.0	12.0
80°	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#  
 CATALOG NUMBER: FLDSQ4C80D010 FEU4C809050 F4LC-CSSQ-MW

**CANDELA DISTRIBUTION (continued):**

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1	4236.1
2.5°	4236.1	4224.1	4218.0	4224.1	4224.1	4218.0	4236.1	4260.2	4290.1	4212.1
5°	4230.0	4218.0	4230.0	4193.9	4212.1	4200.0	4224.1	4218.0	4242.0	4218.0
7.5°	4212.1	4188.0	4193.9	4176.0	4200.0	4169.8	4188.0	4224.1	4200.0	4163.9
10°	4151.9	4139.9	4181.9	4121.7	4109.7	4133.7	4181.9	4145.8	4133.7	4145.8
12.5°	4091.5	4091.5	4109.7	4061.6	4067.5	4079.5	4103.6	4079.5	4091.5	4121.7
15°	4025.5	4013.4	4043.4	4007.3	4001.4	3989.4	4013.4	4013.4	4025.5	4007.3
17.5°	3947.2	3929.2	3929.2	3917.2	3911.1	3941.3	3953.3	3959.2	3965.3	3941.3
20°	3850.9	3845.0	3863.0	3845.0	3850.9	3857.1	3857.1	3845.0	3899.0	3833.0
22.5°	3748.6	3766.7	3742.7	3730.6	3742.7	3754.7	3754.7	3760.6	3748.6	3736.5
25°	3646.4	3658.5	3664.4	3628.3	3646.4	3628.3	3670.5	3676.4	3652.3	3664.4
27.5°	3556.1	3538.2	3532.0	3508.0	3520.0	3514.1	3520.0	3520.0	3556.1	3508.0
30°	3417.6	3399.7	3405.6	3387.7	3393.6	3387.7	3393.6	3393.6	3417.6	3411.7
32.5°	3285.3	3267.4	3273.3	3255.3	3255.3	3261.2	3249.2	3249.2	3267.4	3255.3
35°	3158.9	3116.9	3122.8	3116.9	3122.8	3098.7	3098.7	3092.8	3104.9	3074.7
37.5°	2978.4	2960.5	2954.4	2948.5	2954.4	2942.3	2954.4	2936.4	2954.4	2930.3
40°	2815.9	2803.9	2810.0	2773.9	2773.9	2779.8	2767.8	2761.9	2767.8	2791.8
42.5°	2653.6	2629.6	2617.5	2605.5	2611.4	2593.5	2587.3	2575.3	2587.3	2563.3
45°	2460.9	2460.9	2455.0	2424.8	2430.9	2430.9	2406.9	2382.8	2388.7	2388.7
47.5°	2286.6	2274.6	2268.4	2238.5	2232.3	2226.4	2202.1	2184.2	2184.2	2166.1
50°	2093.9	2081.9	2063.9	2033.7	2021.7	1985.6	1967.7	1943.6	1919.6	1919.6
52.5°	1913.4	1871.2	1847.2	1799.0	1781.1	1762.9	1714.8	1696.9	1678.7	1660.8
55°	1696.9	1660.8	1612.7	1558.4	1534.4	1504.2	1456.1	1420.0	1395.9	1402.1
57.5°	1486.3	1426.1	1378.0	1305.8	1275.6	1257.5	1209.3	1161.2	1137.2	1137.2
60°	1227.5	1179.4	1119.2	1053.0	1028.9	998.9	938.6	908.6	890.4	872.5
62.5°	980.8	944.7	890.4	806.2	788.3	758.1	716.1	680.0	661.9	661.9
65°	734.0	698.0	649.8	589.7	565.6	541.6	505.5	469.4	451.2	445.3
67.5°	517.5	475.3	433.3	385.2	367.0	355.0	318.9	294.8	282.8	276.7
70°	312.8	288.7	258.8	222.7	204.5	192.5	168.4	150.5	144.4	138.5
72.5°	162.5	144.4	120.3	96.2	84.2	72.2	60.1	48.1	42.2	42.2
75°	60.1	48.1	30.2	18.2	12.0	12.0	12.0	12.0	12.0	12.0
77.5°	12.0	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1
80°	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)