

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW
 Description: 4 INCH 9000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3500K, 90CRI LEDS AND F4LC-DFSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 9430.0 lumens
 Efficiency: N/A
 Efficacy: 97.1 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 97.1
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW

Luminous Intensity Polar Plot

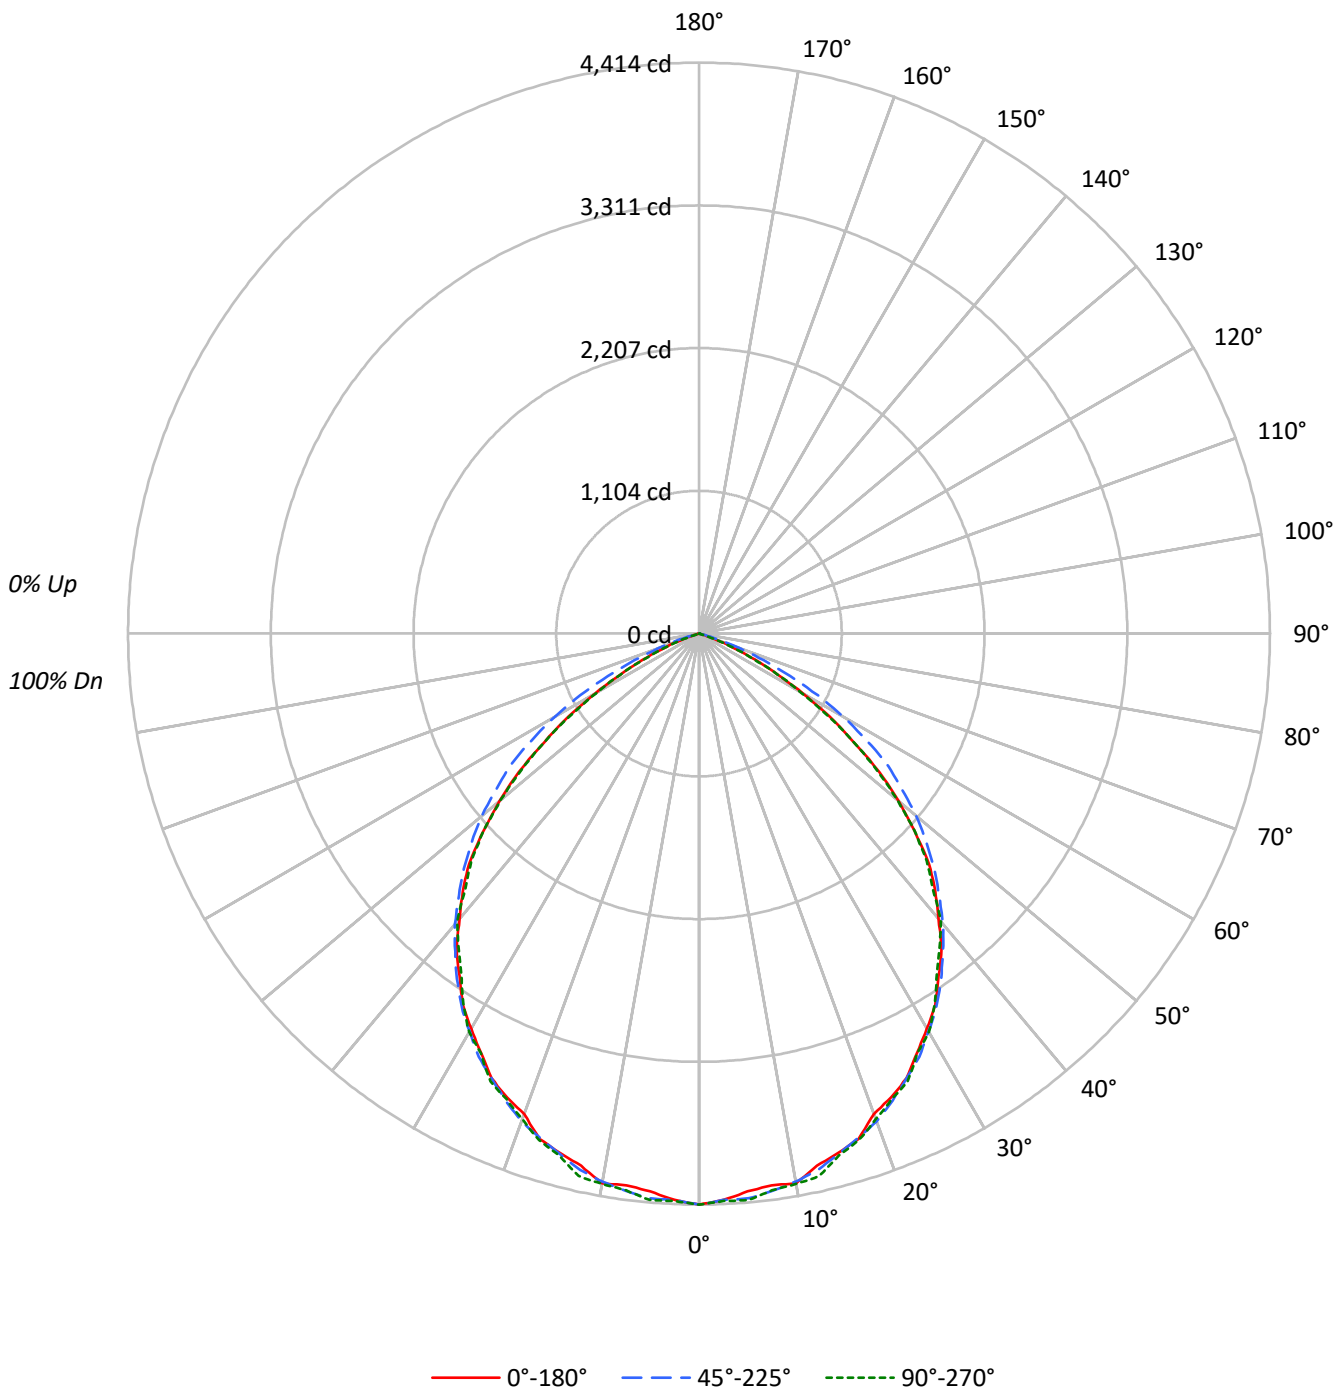

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89		
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77		
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67		
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59		
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52		
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46		
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41		
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37		
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33		
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31		

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	425950	425950	425950
5°	419073	424526	425737
10°	422694	421460	423292
15°	415294	415903	417152
20°	405632	412070	410150
25°	403881	403881	406542
30°	392618	395415	396128
35°	380371	384070	377415
40°	362530	369622	366460
45°	343105	350814	339680
50°	302157	328501	300280
55°	244714	300615	245791
60°	179064	249269	175455
65°	108814	177513	105960
70°	42430	95552	40709
75°	4660	25761	4660
80°	3556	3556	3556
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	416.7	4.4
10°-20°	1179.1	12.5
20°-30°	1749.5	18.6
30°-40°	2027.2	21.5
40°-50°	1943.6	20.6
50°-60°	1429.1	15.2
60°-70°	617.2	6.5
70°-80°	66.6	0.7
80°-90°	0.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3345.3	35.5
0°-40°	5372.5	57.0
0°-60°	8745.3	92.7
0°-90°	9430.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9430.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4414	4414	4414	4414	4414	
5°	4327	4370	4383	4389	4396	413
15°	4157	4182	4164	4170	4176	1172
25°	3794	3787	3794	3800	3819	1737
35°	3229	3248	3261	3254	3204	2019
45°	2514	2521	2571	2533	2489	1911
55°	1455	1605	1787	1599	1461	1309
65°	477	596	778	589	464	490
75°	12	19	69	12	12	38
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5
2.5°	4383.0	4433.2	4439.5	4408.1	4395.5	4376.9	4420.6	4389.4	4401.9	4389.4	4383.0
5°	4326.7	4383.0	4389.4	4389.4	4376.9	4370.5	4389.4	4383.0	4376.9	4364.3	4383.0
7.5°	4301.6	4332.9	4364.3	4326.7	4345.4	4339.3	4383.0	4364.3	4357.9	4357.9	4345.4
10°	4314.2	4307.8	4332.9	4295.3	4307.8	4295.3	4332.9	4332.9	4320.3	4307.8	4301.6
12.5°	4213.6	4263.8	4263.8	4257.6	4245.1	4226.2	4263.8	4289.1	4251.3	4251.3	4245.1
15°	4157.4	4169.9	4176.0	4176.0	4169.9	4182.4	4201.1	4176.0	4182.4	4151.0	4163.5
17.5°	4094.7	4069.6	4088.3	4075.8	4082.1	4094.7	4119.8	4119.8	4082.1	4075.8	4088.3
20°	3950.4	4025.6	4032.0	3994.4	4000.5	4000.5	4044.5	4006.9	4032.0	4000.5	4013.1
22.5°	3881.3	3931.5	3937.9	3887.7	3918.9	3881.3	3925.3	3868.8	3931.5	3887.7	3906.4
25°	3793.6	3787.4	3806.1	3781.0	3787.4	3787.4	3818.6	3793.6	3812.5	3787.4	3793.6
27.5°	3649.5	3699.7	3693.3	3668.2	3680.7	3674.6	3737.3	3668.2	3705.8	3674.6	3687.1
30°	3523.9	3567.9	3555.4	3530.3	3530.3	3511.4	3580.4	3561.5	3555.4	3555.4	3549.0
32.5°	3398.5	3404.9	3392.4	3398.5	3404.9	3379.9	3436.2	3411.1	3404.9	3411.1	3417.5
35°	3229.2	3229.2	3241.7	3223.0	3248.1	3248.1	3298.3	3266.8	3260.6	3241.7	3260.6
37.5°	3078.8	3060.1	3066.2	3066.2	3078.8	3091.3	3116.4	3103.8	3103.8	3085.1	3097.7
40°	2878.2	2865.6	2884.3	2884.3	2903.2	2903.2	2928.3	2915.8	2934.5	2934.5	2934.5
42.5°	2702.7	2702.7	2690.1	2708.8	2715.2	2708.8	2752.8	2746.4	2752.8	2740.3	2746.4
45°	2514.4	2514.4	2501.8	2495.7	2526.9	2520.8	2570.9	2552.0	2577.1	2564.5	2570.9
47.5°	2257.3	2288.7	2269.8	2288.7	2326.3	2332.7	2363.9	2351.4	2376.5	2357.8	2382.9
50°	2012.9	2012.9	2031.6	2056.7	2094.3	2100.7	2138.3	2163.4	2175.9	2182.0	2188.4
52.5°	1755.8	1749.4	1768.3	1799.6	1831.0	1856.1	1893.7	1931.3	1956.4	1994.0	1975.1
55°	1454.7	1467.2	1486.2	1523.8	1573.9	1605.1	1636.6	1686.7	1730.7	1749.4	1787.0
57.5°	1197.6	1185.0	1197.6	1247.7	1304.3	1329.3	1373.3	1423.5	1486.2	1523.8	1536.3
60°	927.9	934.3	946.9	990.9	1034.6	1072.2	1091.1	1172.5	1229.0	1266.7	1291.7
62.5°	683.6	696.1	708.7	746.3	790.0	821.5	852.7	921.8	971.9	1009.5	1034.6
65°	476.6	482.8	501.7	520.4	564.4	595.6	620.7	677.2	727.3	758.8	777.5
67.5°	294.7	300.9	313.4	338.7	369.9	395.0	420.1	457.7	501.7	532.9	539.3
70°	150.4	156.8	163.0	181.9	207.0	219.5	238.2	269.7	300.9	325.9	338.7
72.5°	50.1	50.1	56.5	69.1	81.6	94.1	100.3	131.8	156.8	169.4	175.5
75°	12.5	12.5	12.5	12.5	12.5	18.9	18.9	37.6	50.1	62.7	69.1
77.5°	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	12.5	12.5
80°	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909035 F4LC-DFSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5	4414.5
2.5°	4414.5	4401.9	4395.5	4401.9	4401.9	4395.5	4414.5	4439.5	4470.8	4389.4
5°	4408.1	4395.5	4408.1	4370.5	4389.4	4376.9	4401.9	4395.5	4420.6	4395.5
7.5°	4389.4	4364.3	4370.5	4351.8	4376.9	4345.4	4364.3	4401.9	4376.9	4339.3
10°	4326.7	4314.2	4357.9	4295.3	4282.7	4307.8	4357.9	4320.3	4307.8	4320.3
12.5°	4263.8	4263.8	4282.7	4232.6	4238.7	4251.3	4276.3	4251.3	4263.8	4295.3
15°	4195.0	4182.4	4213.6	4176.0	4169.9	4157.4	4182.4	4182.4	4195.0	4176.0
17.5°	4113.4	4094.7	4094.7	4082.1	4075.8	4107.2	4119.8	4125.9	4132.3	4107.2
20°	4013.1	4006.9	4025.6	4006.9	4013.1	4019.5	4019.5	4006.9	4063.2	3994.4
22.5°	3906.4	3925.3	3900.2	3887.7	3900.2	3912.8	3912.8	3918.9	3906.4	3893.9
25°	3800.0	3812.5	3818.6	3781.0	3800.0	3781.0	3825.0	3831.2	3806.1	3818.6
27.5°	3705.8	3687.1	3680.7	3655.7	3668.2	3662.1	3668.2	3668.2	3705.8	3655.7
30°	3561.5	3542.8	3549.0	3530.3	3536.4	3530.3	3536.4	3536.4	3561.5	3555.4
32.5°	3423.6	3404.9	3411.1	3392.4	3392.4	3398.5	3386.0	3386.0	3404.9	3392.4
35°	3291.9	3248.1	3254.3	3248.1	3254.3	3229.2	3229.2	3223.0	3235.6	3204.1
37.5°	3103.8	3085.1	3078.8	3072.6	3078.8	3066.2	3078.8	3060.1	3078.8	3053.7
40°	2934.5	2921.9	2928.3	2890.7	2890.7	2896.9	2884.3	2878.2	2884.3	2909.4
42.5°	2765.3	2740.3	2727.7	2715.2	2721.3	2702.7	2696.3	2683.7	2696.3	2671.2
45°	2564.5	2564.5	2558.4	2526.9	2533.3	2533.3	2508.2	2483.2	2489.3	2489.3
47.5°	2382.9	2370.3	2363.9	2332.7	2326.3	2320.2	2294.9	2276.2	2276.2	2257.3
50°	2182.0	2169.5	2150.8	2119.4	2106.8	2069.2	2050.5	2025.5	2000.4	2000.4
52.5°	1994.0	1950.0	1924.9	1874.8	1856.1	1837.2	1787.0	1768.3	1749.4	1730.7
55°	1768.3	1730.7	1680.6	1624.1	1599.0	1567.5	1517.4	1479.8	1454.7	1461.1
57.5°	1548.8	1486.2	1436.0	1360.8	1329.3	1310.4	1260.3	1210.1	1185.0	1185.0
60°	1279.2	1229.0	1166.4	1097.3	1072.2	1041.0	978.1	946.9	927.9	909.2
62.5°	1022.1	984.5	927.9	840.2	821.5	790.0	746.3	708.7	689.7	689.7
65°	765.0	727.3	677.2	614.5	589.4	564.4	526.8	489.2	470.2	464.1
67.5°	539.3	495.3	451.6	401.4	382.5	369.9	332.3	307.3	294.7	288.3
70°	325.9	300.9	269.7	232.0	213.1	200.6	175.5	156.8	150.4	144.3
72.5°	169.4	150.4	125.4	100.3	87.8	75.2	62.7	50.1	44.0	44.0
75°	62.7	50.1	31.5	18.9	12.5	12.5	12.5	12.5	12.5	12.5
77.5°	12.5	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
80°	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)