

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW
 Description: 4 INCH 9000 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 4000K, 90CRI LEDS AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 9444.0 lumens
 Efficiency: N/A
 Efficacy: 97.3 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 97.1
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

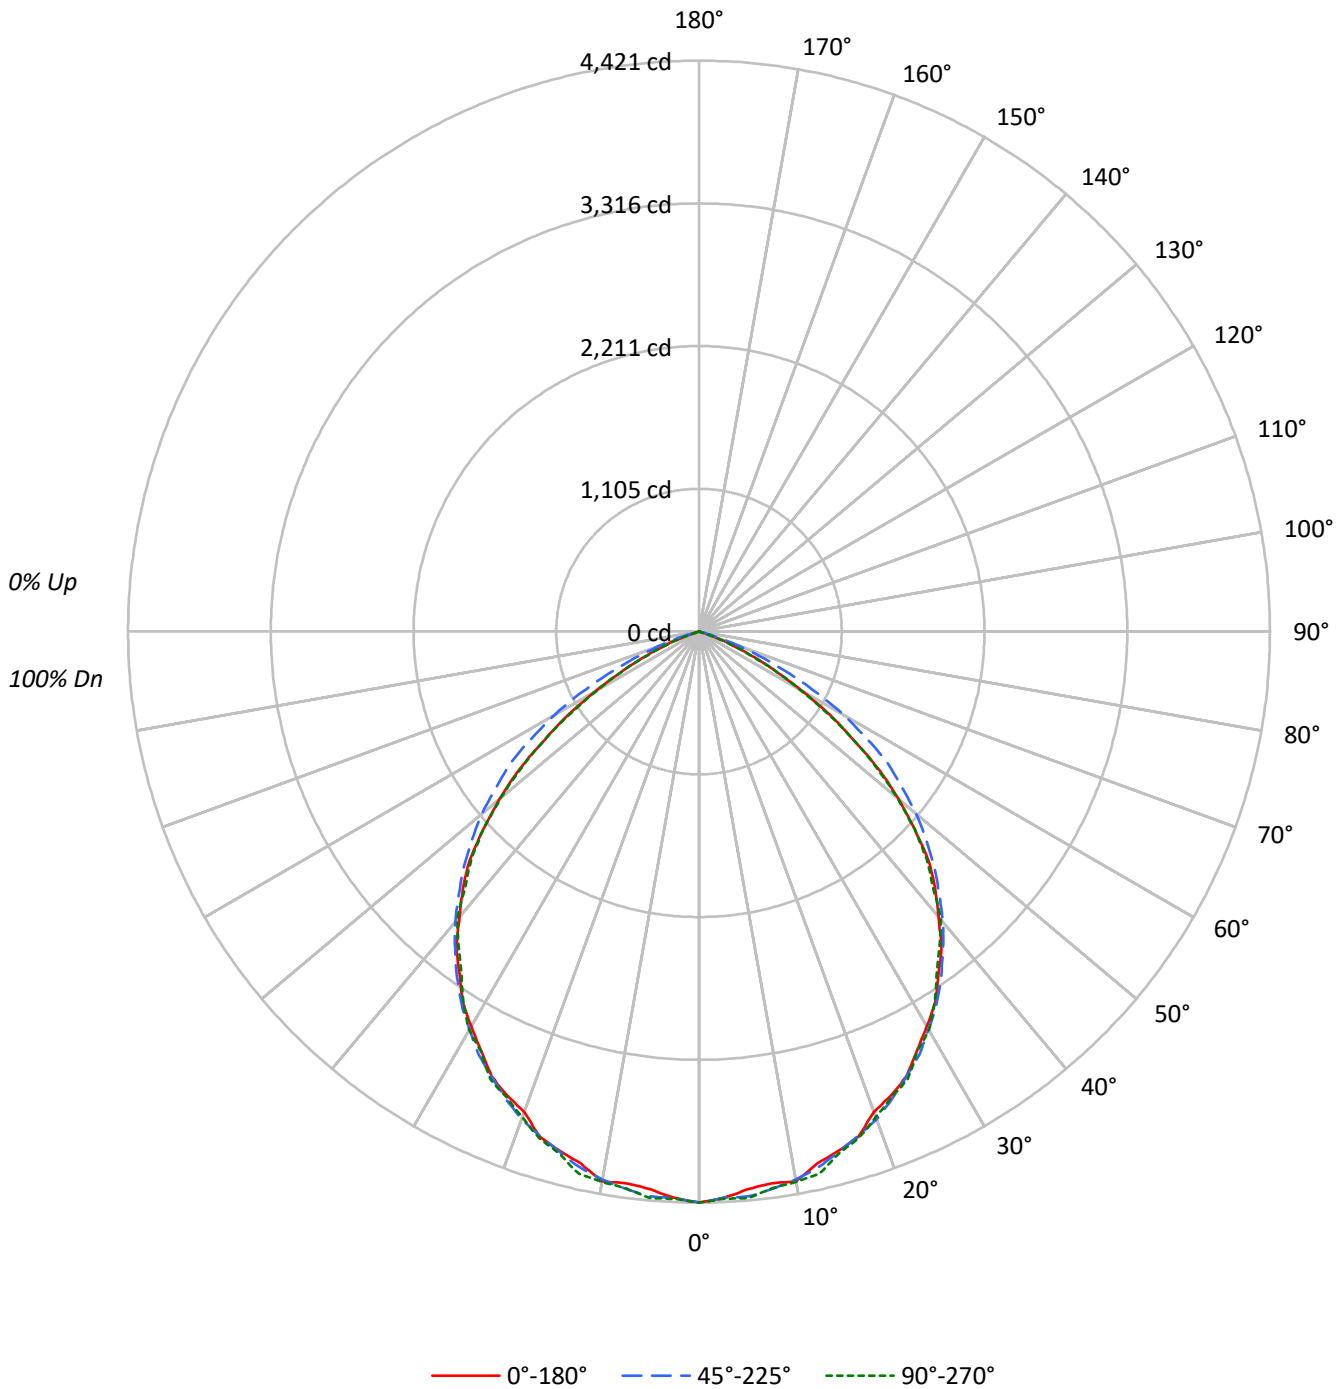

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89				89
2	103	96	91	86	100	94	89	85	91	87	83	88	84	81	85	82	79	77				77
3	95	86	79	74	93	85	78	73	82	76	72	79	74	71	77	73	69	67				67
4	88	77	70	64	86	76	69	63	74	67	63	71	66	62	69	65	61	59				59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	54	63	58	54	52				52
6	75	63	55	49	73	62	55	49	61	54	49	59	53	48	57	52	48	46				46
7	70	58	50	44	68	57	49	44	55	49	44	54	48	43	53	47	43	41				41
8	65	53	45	40	64	52	45	39	51	44	39	50	44	39	49	43	39	37				37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	33				33
10	57	45	38	33	56	44	37	33	44	37	32	43	37	32	42	36	32	31				31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	426577	426577	426577
5°	419693	425156	426376
10°	423321	422087	423919
15°	415903	416522	417771
20°	406238	412676	410756
25°	404477	404477	407149
30°	393197	396005	396718
35°	380937	384647	377980
40°	363059	370163	367002
45°	343610	351333	340185
50°	302607	328996	300731
55°	245084	301069	246161
60°	179334	249636	175726
65°	108973	177764	106119
70°	42515	95693	40766
75°	4697	25798	4697
80°	3556	3556	3556
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	417.3	4.4
10°-20°	1180.9	12.5
20°-30°	1752.1	18.6
30°-40°	2030.2	21.5
40°-50°	1946.5	20.6
50°-60°	1431.2	15.2
60°-70°	618.1	6.5
70°-80°	66.7	0.7
80°-90°	0.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3350.3	35.5
0°-40°	5380.5	57.0
0°-60°	8758.2	92.7
0°-90°	9444.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9444.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4421	4421	4421	4421	4421	
5°	4333	4377	4390	4396	4402	413
15°	4164	4189	4170	4176	4182	1173
25°	3799	3793	3799	3806	3824	1739
35°	3234	3253	3266	3259	3209	2022
45°	2518	2524	2575	2537	2493	1914
55°	1457	1608	1790	1601	1463	1311
65°	477	596	779	590	465	491
75°	13	19	69	13	13	39
85°	0	0	0	0	0	1
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0
2.5°	4389.5	4439.7	4446.1	4414.6	4402.1	4383.4	4427.2	4395.9	4408.5	4395.9	4389.5
5°	4333.1	4389.5	4395.9	4395.9	4383.4	4377.0	4395.9	4389.5	4383.4	4370.8	4389.5
7.5°	4308.0	4339.3	4370.8	4333.1	4351.9	4345.7	4389.5	4370.8	4364.4	4364.4	4351.9
10°	4320.6	4314.2	4339.3	4301.6	4314.2	4301.6	4339.3	4339.3	4326.7	4314.2	4308.0
12.5°	4219.9	4270.1	4270.1	4264.0	4251.4	4232.5	4270.1	4295.5	4257.6	4257.6	4251.4
15°	4163.5	4176.1	4182.2	4182.2	4176.1	4188.6	4207.3	4182.2	4188.6	4157.1	4169.7
17.5°	4100.8	4075.6	4094.4	4081.8	4088.2	4100.8	4125.9	4125.9	4088.2	4081.8	4094.4
20°	3956.3	4031.6	4038.0	4000.3	4006.5	4006.5	4050.5	4012.9	4038.0	4006.5	4019.0
22.5°	3887.1	3937.3	3943.7	3893.5	3924.7	3887.1	3931.1	3874.5	3937.3	3893.5	3912.2
25°	3799.2	3793.0	3811.7	3786.6	3793.0	3793.0	3824.3	3799.2	3818.1	3793.0	3799.2
27.5°	3654.9	3705.2	3698.8	3673.6	3686.2	3680.0	3742.8	3673.6	3711.3	3680.0	3692.6
30°	3529.1	3573.2	3560.7	3535.5	3535.5	3516.6	3585.8	3566.8	3560.7	3560.7	3554.3
32.5°	3403.6	3410.0	3397.4	3403.6	3410.0	3384.9	3441.3	3416.1	3410.0	3416.1	3422.5
35°	3234.0	3234.0	3246.5	3227.8	3252.9	3252.9	3303.2	3271.6	3265.5	3246.5	3265.5
37.5°	3083.3	3064.6	3070.8	3070.8	3083.3	3095.9	3121.0	3108.4	3108.4	3089.7	3102.3
40°	2882.4	2869.9	2888.6	2888.6	2907.6	2907.6	2932.7	2920.1	2938.8	2938.8	2938.8
42.5°	2706.7	2706.7	2694.1	2712.8	2719.2	2712.8	2756.9	2750.5	2756.9	2744.3	2750.5
45°	2518.1	2518.1	2505.6	2499.4	2530.7	2524.5	2574.7	2555.8	2580.9	2568.3	2574.7
47.5°	2260.6	2292.1	2273.2	2292.1	2329.8	2336.2	2367.4	2354.9	2380.0	2361.3	2386.4
50°	2015.9	2015.9	2034.6	2059.7	2097.4	2103.8	2141.5	2166.6	2179.1	2185.3	2191.7
52.5°	1758.4	1752.0	1771.0	1802.2	1833.7	1858.9	1896.5	1934.2	1959.3	1997.0	1978.0
55°	1456.9	1469.4	1488.4	1526.0	1576.2	1607.5	1639.0	1689.2	1733.3	1752.0	1789.7
57.5°	1199.4	1186.8	1199.4	1249.6	1306.2	1331.3	1375.4	1425.6	1488.4	1526.0	1538.6
60°	929.3	935.7	948.3	992.3	1036.1	1073.8	1092.8	1174.2	1230.9	1268.5	1293.6
62.5°	684.6	697.2	709.7	747.4	791.2	822.7	854.0	923.2	973.4	1011.0	1036.1
65°	477.3	483.5	502.4	521.1	565.2	596.5	621.6	678.2	728.4	759.9	778.6
67.5°	295.2	301.3	313.9	339.2	370.5	395.6	420.7	458.4	502.4	533.7	540.1
70°	150.7	157.1	163.2	182.2	207.3	219.8	238.5	270.1	301.3	326.4	339.2
72.5°	50.2	50.2	56.6	69.2	81.7	94.3	100.4	131.9	157.1	169.6	175.8
75°	12.6	12.6	12.6	12.6	12.6	19.0	19.0	37.7	50.2	62.8	69.2
77.5°	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	12.6	12.6
80°	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C90D010 FEU4C909040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0	4421.0
2.5°	4421.0	4408.5	4402.1	4408.5	4408.5	4402.1	4421.0	4446.1	4477.4	4395.9
5°	4414.6	4402.1	4414.6	4377.0	4395.9	4383.4	4408.5	4402.1	4427.2	4402.1
7.5°	4395.9	4370.8	4377.0	4358.3	4383.4	4351.9	4370.8	4408.5	4383.4	4345.7
10°	4333.1	4320.6	4364.4	4301.6	4289.1	4314.2	4364.4	4326.7	4314.2	4326.7
12.5°	4270.1	4270.1	4289.1	4238.9	4245.0	4257.6	4282.7	4257.6	4270.1	4301.6
15°	4201.2	4188.6	4219.9	4182.2	4176.1	4163.5	4188.6	4188.6	4201.2	4182.2
17.5°	4119.5	4100.8	4100.8	4088.2	4081.8	4113.3	4125.9	4132.0	4138.4	4113.3
20°	4019.0	4012.9	4031.6	4012.9	4019.0	4025.4	4025.4	4012.9	4069.2	4000.3
22.5°	3912.2	3931.1	3906.0	3893.5	3906.0	3918.6	3918.6	3924.7	3912.2	3899.6
25°	3805.6	3818.1	3824.3	3786.6	3805.6	3786.6	3830.7	3836.9	3811.7	3824.3
27.5°	3711.3	3692.6	3686.2	3661.1	3673.6	3667.5	3673.6	3673.6	3711.3	3661.1
30°	3566.8	3548.1	3554.3	3535.5	3541.7	3535.5	3541.7	3541.7	3566.8	3560.7
32.5°	3428.7	3410.0	3416.1	3397.4	3397.4	3403.6	3391.0	3391.0	3410.0	3397.4
35°	3296.8	3252.9	3259.1	3252.9	3259.1	3234.0	3234.0	3227.8	3240.4	3208.9
37.5°	3108.4	3089.7	3083.3	3077.2	3083.3	3070.8	3083.3	3064.6	3083.3	3058.2
40°	2938.8	2926.3	2932.7	2895.0	2895.0	2901.2	2888.6	2882.4	2888.6	2913.7
42.5°	2769.5	2744.3	2731.8	2719.2	2725.4	2706.7	2700.3	2687.7	2700.3	2675.2
45°	2568.3	2568.3	2562.2	2530.7	2537.1	2537.1	2512.0	2486.8	2493.0	2493.0
47.5°	2386.4	2373.9	2367.4	2336.2	2329.8	2323.6	2298.3	2279.6	2279.6	2260.6
50°	2185.3	2172.7	2154.0	2122.5	2110.0	2072.3	2053.6	2028.5	2003.4	2003.4
52.5°	1997.0	1952.9	1927.8	1877.6	1858.9	1839.9	1789.7	1771.0	1752.0	1733.3
55°	1771.0	1733.3	1683.1	1626.5	1601.4	1569.8	1519.6	1482.0	1456.9	1463.3
57.5°	1551.1	1488.4	1438.1	1362.8	1331.3	1312.4	1262.1	1211.9	1186.8	1186.8
60°	1281.1	1230.9	1168.1	1098.9	1073.8	1042.5	979.5	948.3	929.3	910.6
62.5°	1023.6	985.9	929.3	841.4	822.7	791.2	747.4	709.7	690.8	690.8
65°	766.1	728.4	678.2	615.4	590.3	565.2	527.5	489.9	470.9	464.8
67.5°	540.1	496.0	452.2	402.0	383.0	370.5	332.8	307.7	295.2	288.8
70°	326.4	301.3	270.1	232.4	213.4	200.9	175.8	157.1	150.7	144.5
72.5°	169.6	150.7	125.5	100.4	87.9	75.3	62.8	50.2	44.1	44.1
75°	62.8	50.2	31.5	19.0	12.6	12.6	12.6	12.6	12.6	12.6
77.5°	12.6	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
80°	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)