

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726634

Luminaire Tested: **MRI-DRV-FLD4C-10-L940 F4LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726634
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-10-L940 F4LC-M-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 770.0 lumens
Efficiency: N/A
Efficacy: 79.0 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 9.75
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726634
CATALOG NUMBER: MRI-DRV-FLD4C-10-L940 F4LC-M-X-H

Luminous Intensity Polar Plot

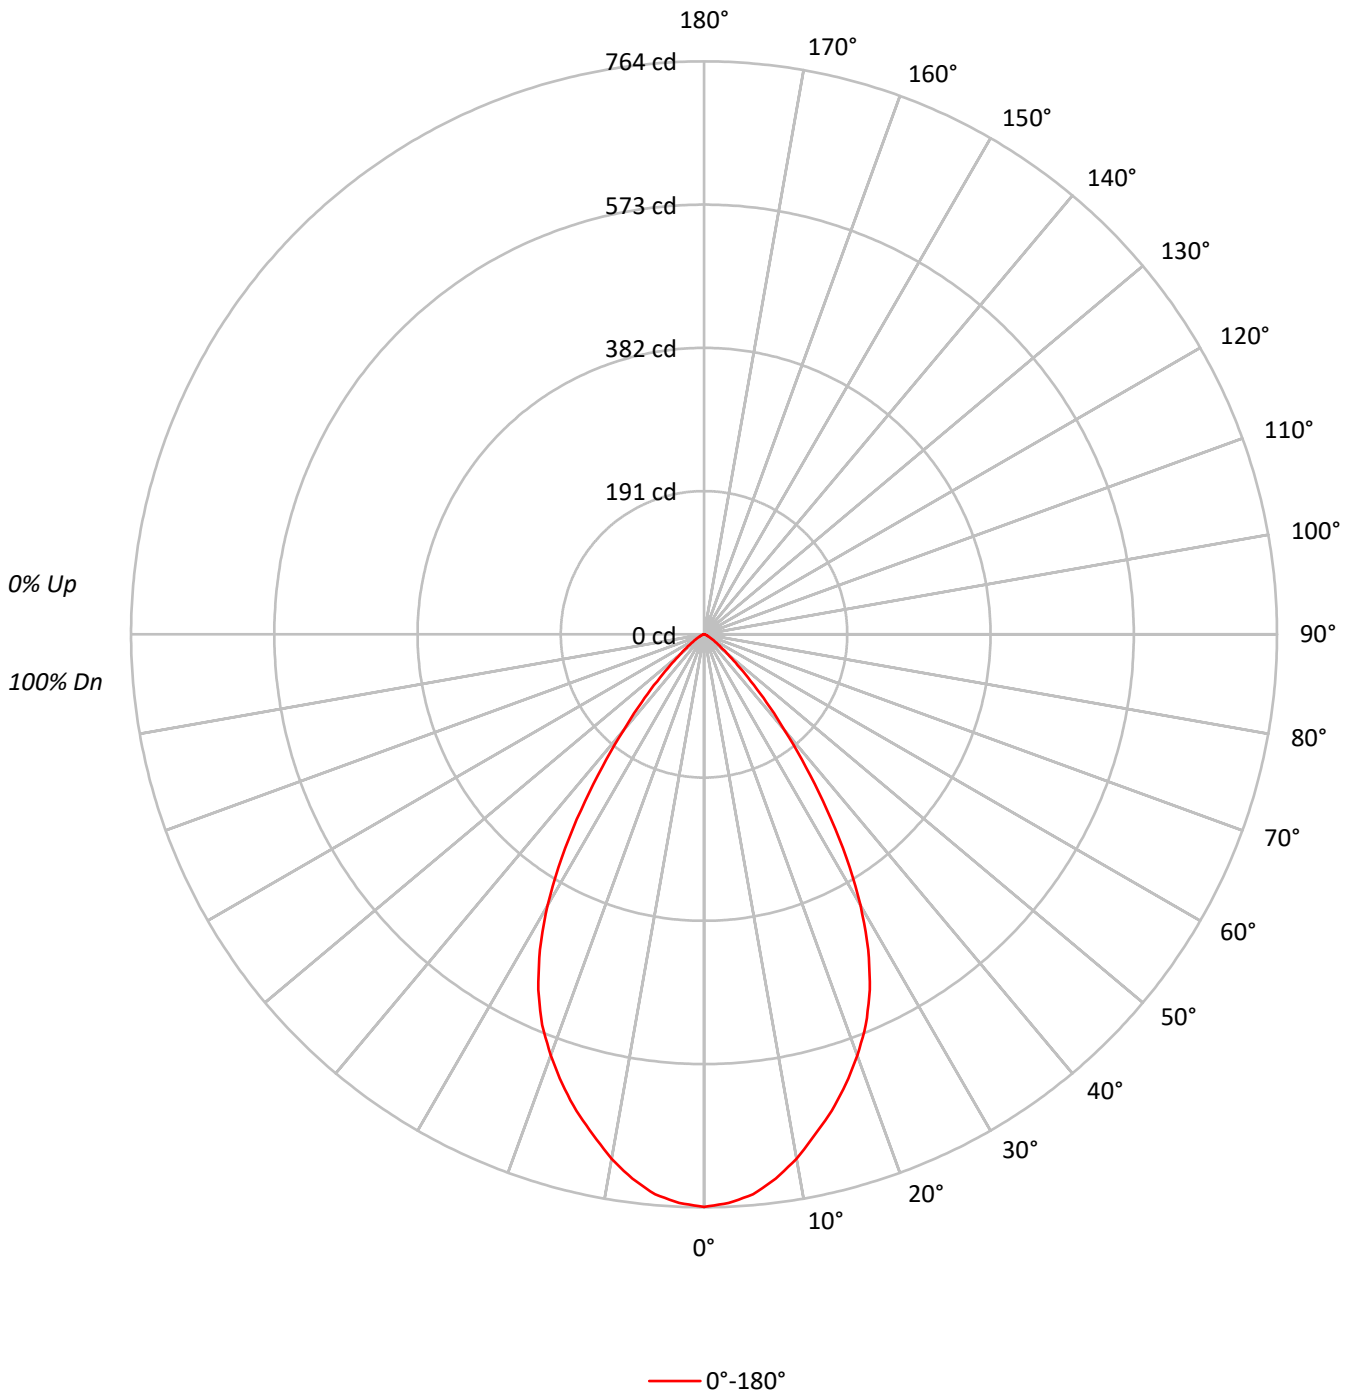



TEST NUMBER: P726634
 CATALOG NUMBER: MRI-DRV-FLD4C-10-L940 F4LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93				93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85				85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79				79
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73				73
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67				67
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62				62
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58				58
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54				54
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50				50
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47				47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	93799
5°	92443
10°	88572
15°	83664
20°	78090
25°	70895
30°	59184
35°	42878
40°	26847
45°	15341
50°	8008
55°	4477
60°	2850
65°	1686
70°	1257
75°	570
80°	849
85°	0



TEST NUMBER: P726634
 CATALOG NUMBER: MRI-DRV-FLD4C-10-L940 F4LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	70.3	9.1
10°-20°	184.3	23.9
20°-30°	236.9	30.8
30°-40°	178.2	23.1
40°-50°	71.6	9.3
50°-60°	20.3	2.6
60°-70°	6.4	0.8
70°-80°	1.9	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	491.4	63.8
0°-40°	669.6	87.0
0°-60°	761.6	98.9
0°-90°	770.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	770.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	764	
5°	750	70
15°	658	184
25°	523	237
35°	286	178
45°	88	72
55°	21	20
65°	6	6
75°	1	2
85°	0	0
90°	0	



TEST NUMBER: P726634
CATALOG NUMBER: MRI-DRV-FLD4C-10-L940 F4LC-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	763.5
2.5°	758.9
5°	749.6
7.5°	732.1
10°	710.0
12.5°	683.3
15°	657.8
17.5°	628.7
20°	597.3
22.5°	563.6
25°	523.0
27.5°	474.1
30°	417.2
32.5°	353.3
35°	285.9
37.5°	223.1
40°	167.4
42.5°	123.2
45°	88.3
47.5°	60.5
50°	41.9
52.5°	29.1
55°	20.9
57.5°	15.1
60°	11.6
62.5°	8.1
65°	5.8
67.5°	4.7
70°	3.5
72.5°	2.3
75°	1.2
77.5°	1.2
80°	1.2
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)