

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726706

Luminaire Tested: **MRI-DRV-FLD4C-15-L927 F4LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726706
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-15-L927 F4LC-M-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI
LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1117.0 lumens
Efficiency: N/A
Efficacy: 70.7 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726706
CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-M-X-H

Luminous Intensity Polar Plot

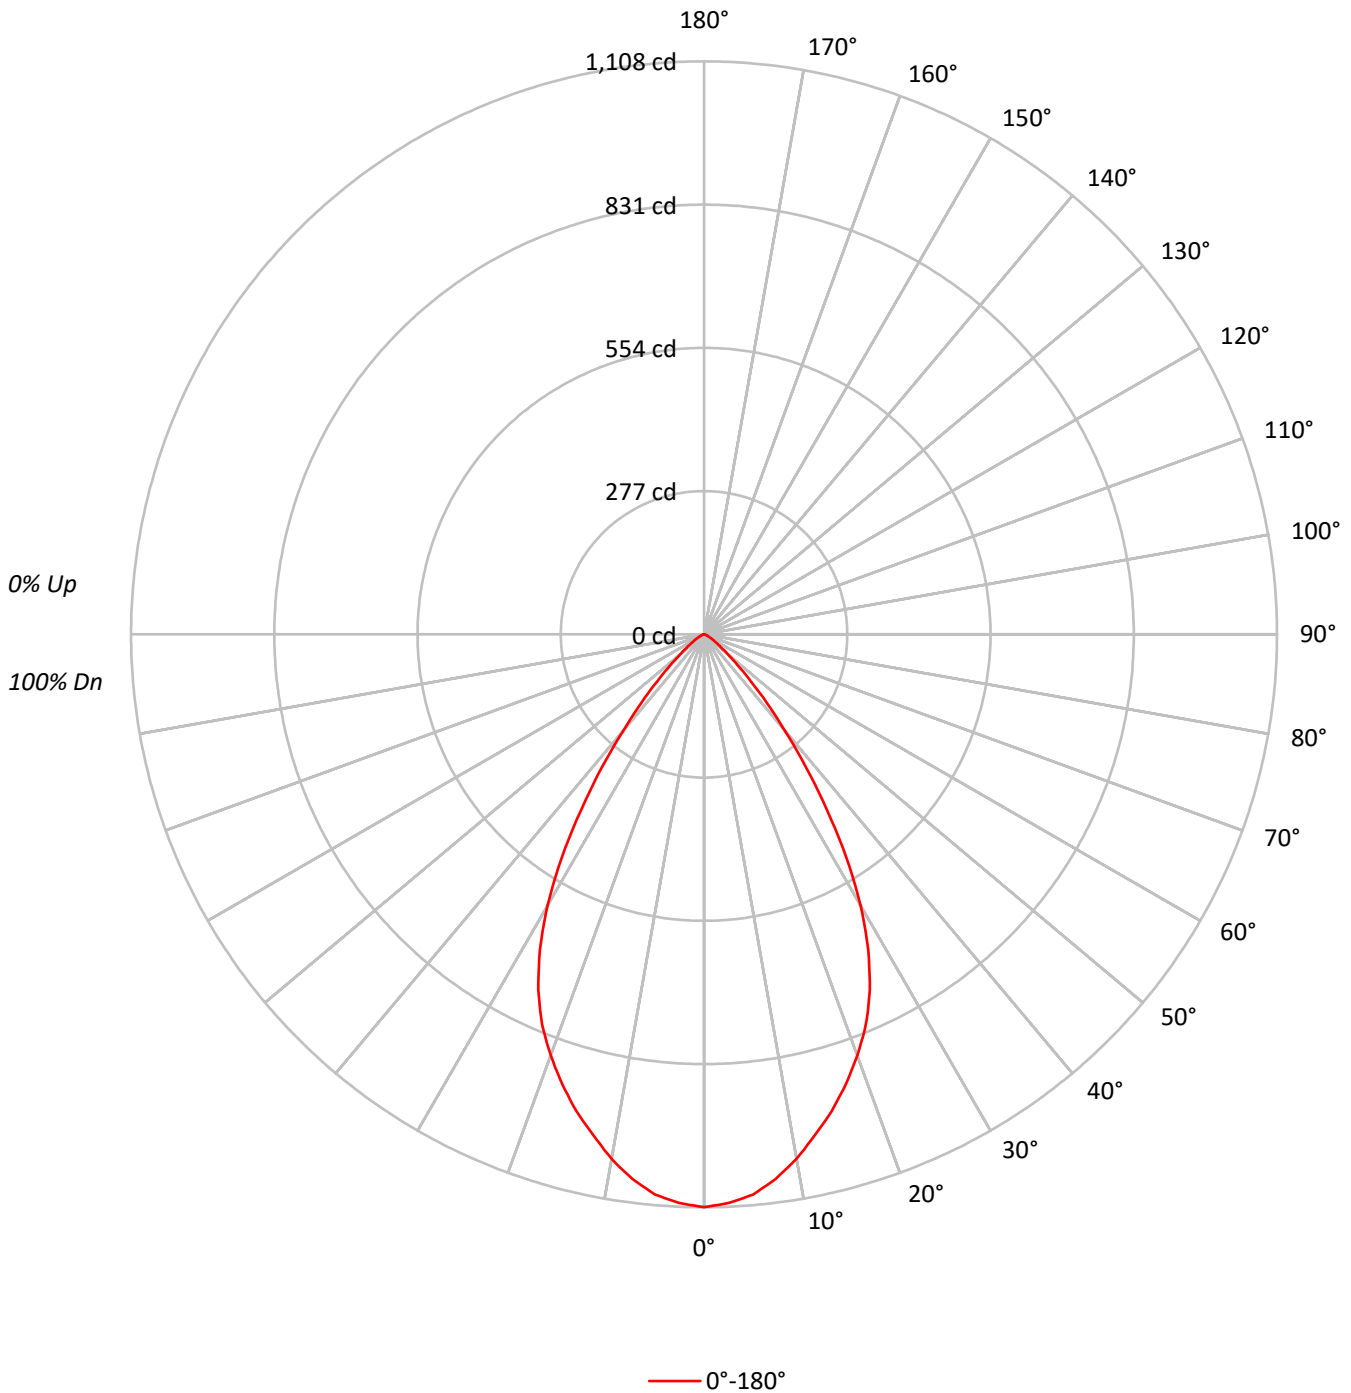



TEST NUMBER: P726706
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85	85	85	85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79	79	79	79
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73	73	73	73
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67	67	67	67
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62	62	62	62
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58	58	58	58
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54	54	54	54
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50	50	50	50
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47	47	47	47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	136073
5°	134089
10°	128491
15°	121362
20°	113284
25°	102831
30°	85853
35°	62195
40°	38939
45°	22256
50°	11601
55°	6511
60°	4152
65°	2442
70°	1832
75°	807
80°	1203
85°	0



TEST NUMBER: P726706
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	101.9	9.1
10°-20°	267.4	23.9
20°-30°	343.6	30.8
30°-40°	258.5	23.1
40°-50°	103.8	9.3
50°-60°	29.5	2.6
60°-70°	9.3	0.8
70°-80°	2.7	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	712.9	63.8
0°-40°	971.4	87.0
0°-60°	1104.8	98.9
0°-90°	1117.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1117.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1108	
5°	1087	102
15°	954	267
25°	759	344
35°	415	259
45°	128	104
55°	30	30
65°	8	9
75°	2	3
85°	0	0
90°	0	



TEST NUMBER: P726706
CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1107.6
2.5°	1100.8
5°	1087.3
7.5°	1062.0
10°	1030.0
12.5°	991.3
15°	954.2
17.5°	912.0
20°	866.5
22.5°	817.6
25°	758.6
27.5°	687.8
30°	605.2
32.5°	512.5
35°	414.7
37.5°	323.7
40°	242.8
42.5°	178.7
45°	128.1
47.5°	87.7
50°	60.7
52.5°	42.2
55°	30.4
57.5°	21.9
60°	16.9
62.5°	11.8
65°	8.4
67.5°	6.7
70°	5.1
72.5°	3.4
75°	1.7
77.5°	1.7
80°	1.7
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)