

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726724

Luminaire Tested: **MRI-DRV-FLD4C-15-L927 F4LC-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726724
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-15-L927 F4LC-N-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI
LEDS, 4LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1093.0 lumens
Efficiency: N/A
Efficacy: 69.2 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726724
CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-N-X-LI

Luminous Intensity Polar Plot

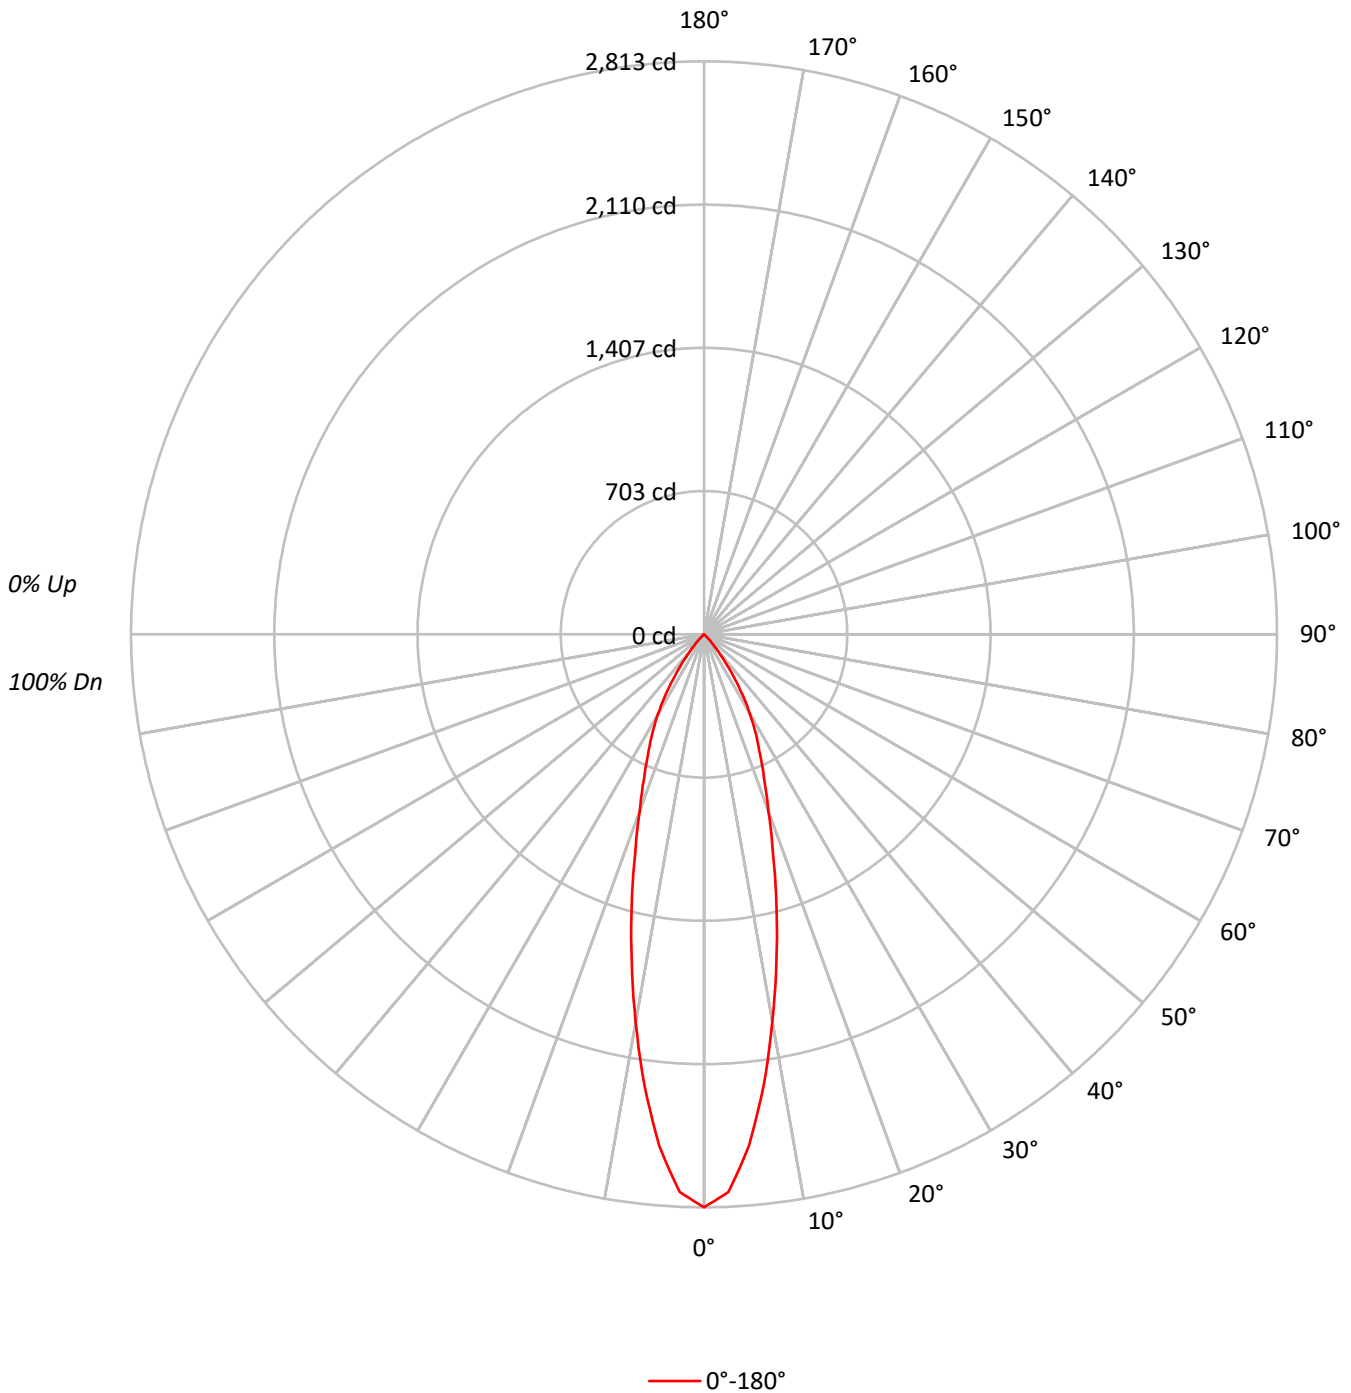



TEST NUMBER: P726724

CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	95	95	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90	90	90	90
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85	85	85	85
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81	81	81	81
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77	77	77	77
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73	73	73	73
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69	69	69	69
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66	66	66	66
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63	63	63	63
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61	61	61	61

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	345562
5°	310971
10°	241064
15°	174488
20°	120815
25°	88083
30°	63993
35°	37869
40°	15925
45°	4969
50°	650
55°	364
60°	418
65°	494
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P726724
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	20.3
10°-20°	379.5	34.7
20°-30°	301.6	27.6
30°-40°	159.7	14.6
40°-50°	27.5	2.5
50°-60°	2.1	0.2
60°-70°	1.0	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	902.7	82.6
0°-40°	1062.4	97.2
0°-60°	1092.0	99.9
0°-90°	1093.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1093.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2813	
5°	2522	222
15°	1372	379
25°	650	302
35°	252	160
45°	29	27
55°	2	2
65°	2	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P726724
CATALOG NUMBER: MRI-DRV-FLD4C-15-L927 F4LC-N-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2812.8
2.5°	2740.3
5°	2521.6
7.5°	2235.4
10°	1932.4
12.5°	1639.5
15°	1371.9
17.5°	1122.7
20°	924.1
22.5°	772.6
25°	649.8
27.5°	550.4
30°	451.1
32.5°	350.1
35°	252.5
37.5°	166.7
40°	99.3
42.5°	57.2
45°	28.6
47.5°	10.1
50°	3.4
52.5°	3.4
55°	1.7
57.5°	1.7
60°	1.7
62.5°	1.7
65°	1.7
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)