

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726748

Luminaire Tested: **MRI-DRV-FLD4C-15-L930 F4LC-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726748
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-15-L930 F4LC-M-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3000K, 90 CRI
LEDS, 4LBMLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1449.0 lumens
Efficiency: N/A
Efficacy: 91.7 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726748
CATALOG NUMBER: MRI-DRV-FLD4C-15-L930 F4LC-M-X-LI

Luminous Intensity Polar Plot

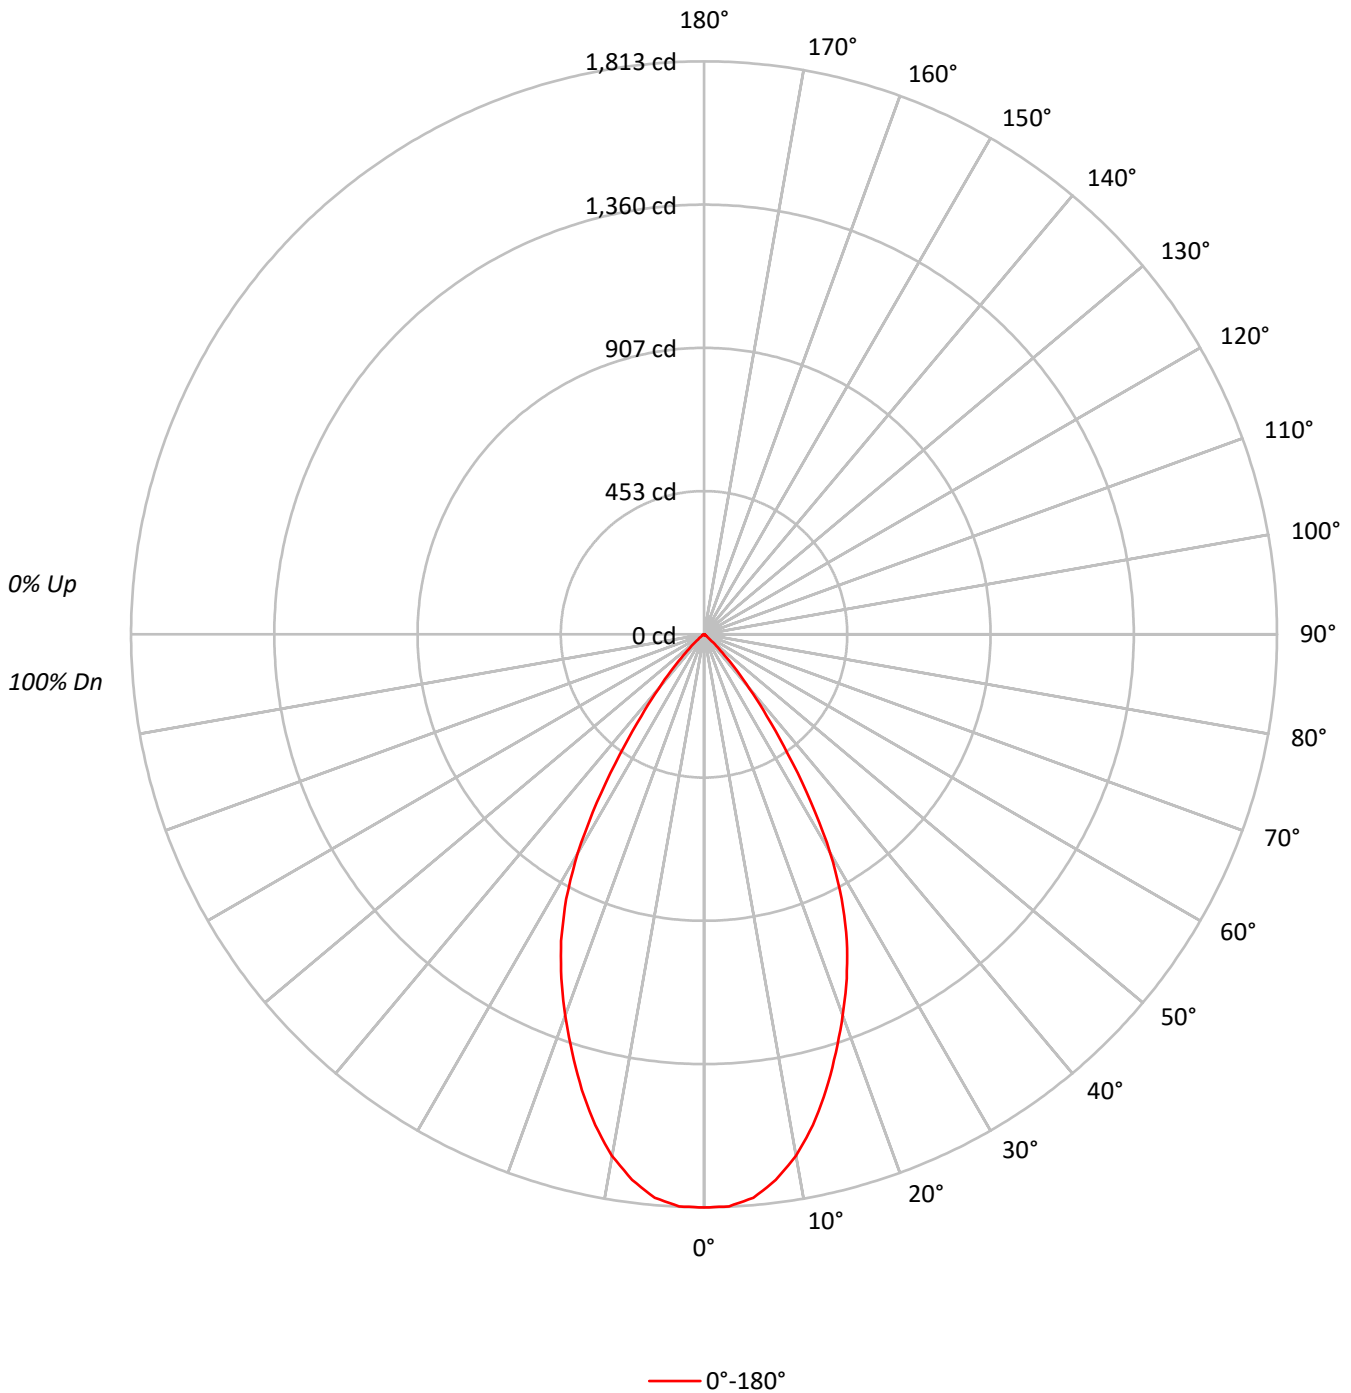



TEST NUMBER: P726748

CATALOG NUMBER: MRI-DRV-FLD4C-15-L930 F4LC-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94	94	94	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88	88	88	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82	82	82	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76	76	76	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71	71	71	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67	67	67	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63	63	63	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52	52	52	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	222782
5°	220661
10°	209091
15°	189840
20°	167750
25°	145029
30°	113360
35°	69514
40°	35683
45°	14177
50°	4606
55°	1585
60°	1351
65°	1076
70°	682
75°	902
80°	0
85°	0



TEST NUMBER: P726748
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L930 F4LC-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	167.0	11.5
10°-20°	415.9	28.7
20°-30°	483.5	33.4
30°-40°	296.0	20.4
40°-50°	73.5	5.1
50°-60°	8.6	0.6
60°-70°	3.2	0.2
70°-80°	1.2	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1066.4	73.6
0°-40°	1362.5	94.0
0°-60°	1444.5	99.7
0°-90°	1449.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1449.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1813	
5°	1789	167
15°	1493	416
25°	1070	483
35°	464	296
45°	82	74
55°	7	9
65°	4	3
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P726748
CATALOG NUMBER: MRI-DRV-FLD4C-15-L930 F4LC-M-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1813.4
2.5°	1811.5
5°	1789.3
7.5°	1741.0
10°	1676.1
12.5°	1590.9
15°	1492.6
17.5°	1386.9
20°	1283.1
22.5°	1179.2
25°	1069.9
27.5°	943.8
30°	799.1
32.5°	630.4
35°	463.5
37.5°	326.3
40°	222.5
42.5°	139.0
45°	81.6
47.5°	46.4
50°	24.1
52.5°	11.1
55°	7.4
57.5°	5.5
60°	5.5
62.5°	3.7
65°	3.7
67.5°	1.9
70°	1.9
72.5°	1.9
75°	1.9
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)