

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726778

Luminaire Tested: **MRI-DRV-FLD4C-15-L935 F4LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726778
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-15-L935 F4LC-M-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1178.0 lumens
Efficiency: N/A
Efficacy: 74.6 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726778
CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-H

Luminous Intensity Polar Plot

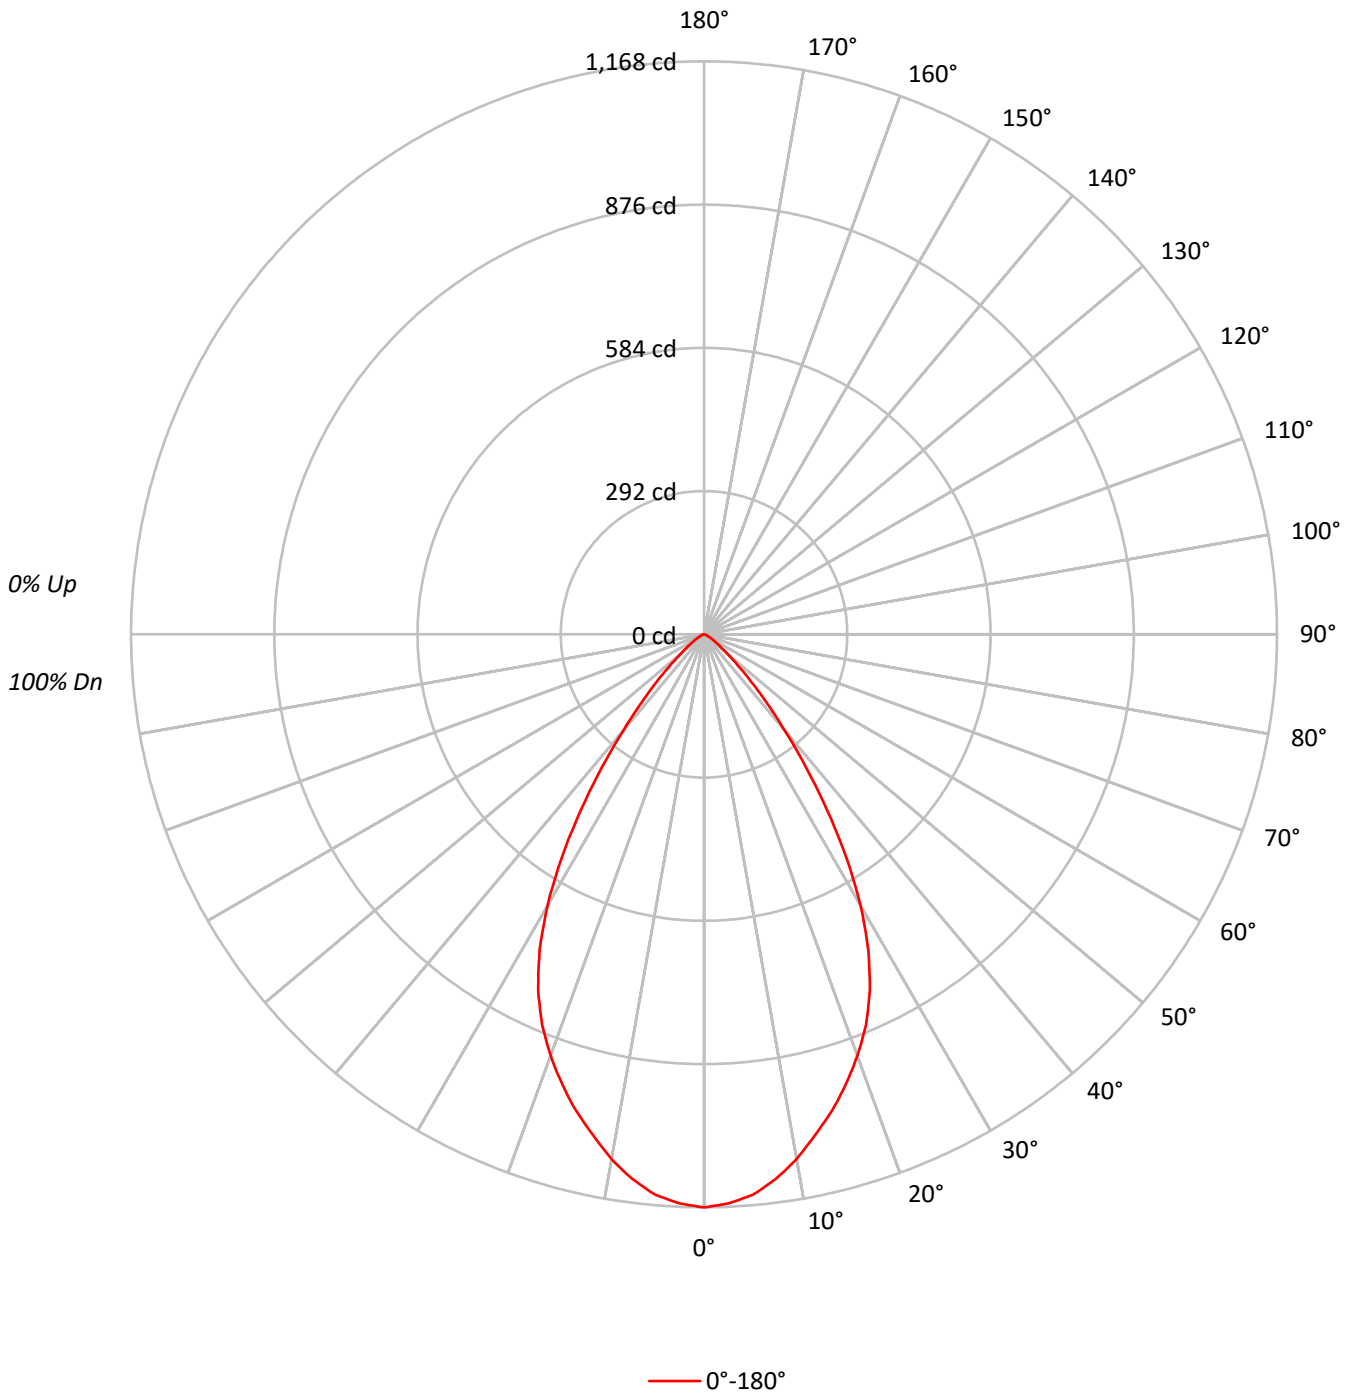



TEST NUMBER: P726778
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20	
RC	80				70				50				30				10				0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93				93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85				85
3	101	94	89	85	99	93	88	84	90	86	83	88	84	82	86	83	80	79				79
4	96	88	82	77	94	86	81	77	84	80	76	82	78	75	80	77	74	73				73
5	90	82	75	71	89	81	75	70	79	74	70	77	73	69	75	72	69	67				67
6	86	76	70	65	84	75	69	65	74	68	64	72	68	64	71	67	64	62				62
7	81	71	65	60	80	70	64	60	69	64	60	68	63	59	67	62	59	58				58
8	77	67	60	56	75	66	60	56	65	59	56	64	59	55	63	58	55	54				54
9	73	63	56	52	72	62	56	52	61	56	52	60	55	52	59	55	52	50				50
10	69	59	53	49	68	59	53	49	58	52	49	57	52	48	56	52	48	47				47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	143505
5°	141414
10°	135502
15°	127989
20°	119468
25°	108443
30°	90549
35°	65600
40°	41056
45°	23472
50°	12232
55°	6854
60°	4374
65°	2587
70°	1904
75°	854
80°	1273
85°	0



TEST NUMBER: P726778
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	107.5	9.1
10°-20°	282.0	23.9
20°-30°	362.4	30.8
30°-40°	272.6	23.1
40°-50°	109.5	9.3
50°-60°	31.1	2.6
60°-70°	9.9	0.8
70°-80°	2.8	0.2
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	751.8	63.8
0°-40°	1024.5	87.0
0°-60°	1165.1	98.9
0°-90°	1178.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1178.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1168	
5°	1147	107
15°	1006	282
25°	800	362
35°	437	273
45°	135	110
55°	32	31
65°	9	10
75°	2	3
85°	0	0
90°	0	



TEST NUMBER: P726778
CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-H

CANDELA DISTRIBUTION (FULL):

	0°
0°	1168.1
2.5°	1160.9
5°	1146.7
7.5°	1120.0
10°	1086.2
12.5°	1045.4
15°	1006.3
17.5°	961.8
20°	913.8
22.5°	862.3
25°	800.0
27.5°	725.3
30°	638.3
32.5°	540.5
35°	437.4
37.5°	341.3
40°	256.0
42.5°	188.5
45°	135.1
47.5°	92.5
50°	64.0
52.5°	44.5
55°	32.0
57.5°	23.1
60°	17.8
62.5°	12.5
65°	8.9
67.5°	7.1
70°	5.3
72.5°	3.6
75°	1.8
77.5°	1.8
80°	1.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)