

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions  
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726784

Luminaire Tested: **MRI-DRV-FLD4C-15-L935 F4LC-M-X-LI**

Issue Date: 08/03/2023



**Test Information**


Test Method: LM-79-08  
Report Number: P726784  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 08/03/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: MRI-DRV-FLD4C-15-L935 F4LC-M-X-LI  
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI  
LEDS, 4LBMLI TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1469.0 lumens  
Efficiency: N/A  
Efficacy: 93.0 lumens/watt  
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 15.8  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P726784  
CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-LI

### Luminous Intensity Polar Plot

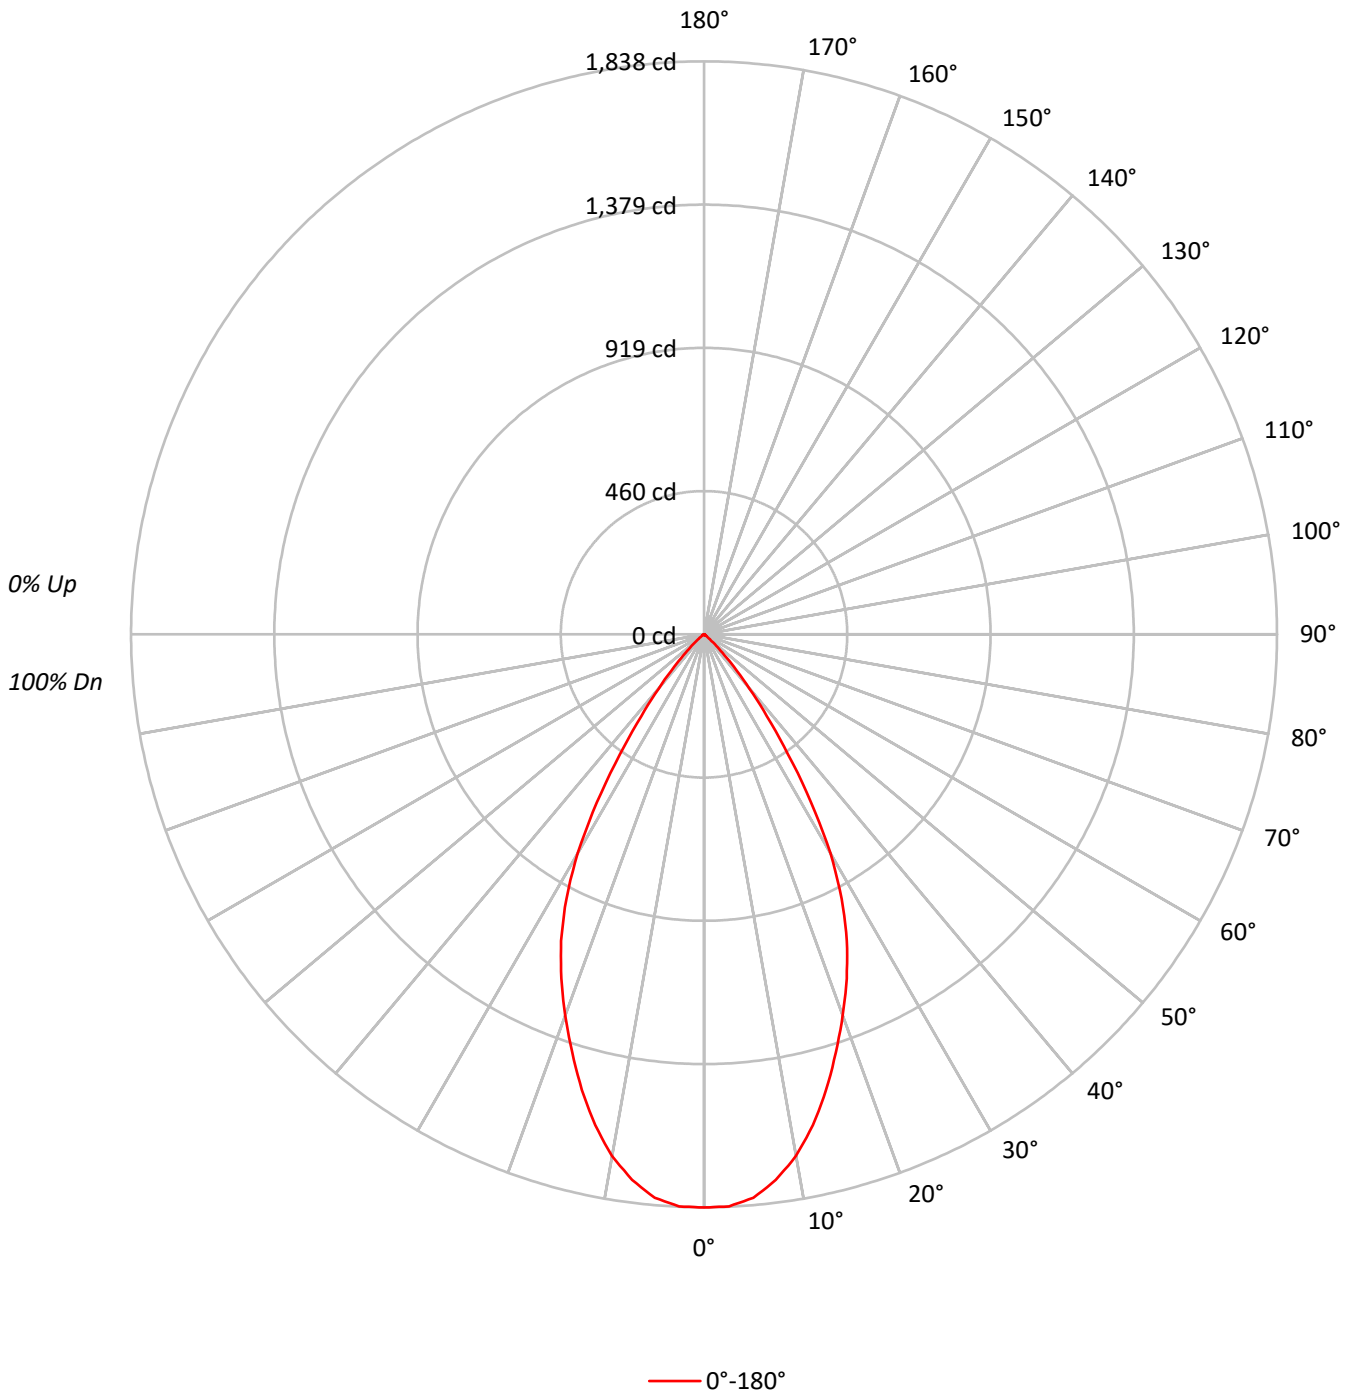



TEST NUMBER: P726784  
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94	94	94	94
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88	88	88	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82	82	82	82
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76	76	76	76
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71	71	71	71
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67	67	67	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63	63	63	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52	52	52	52

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	225854
5°	223707
10°	211985
15°	192460
20°	170064
25°	147022
30°	114934
35°	70474
40°	36180
45°	14368
50°	4663
55°	1606
60°	1376
65°	1105
70°	682
75°	902
80°	0
85°	0



TEST NUMBER: P726784  
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	169.4	11.5
10°-20°	421.6	28.7
20°-30°	490.1	33.4
30°-40°	300.1	20.4
40°-50°	74.5	5.1
50°-60°	8.7	0.6
60°-70°	3.3	0.2
70°-80°	1.2	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1081.1	73.6
0°-40°	1381.3	94.0
0°-60°	1464.5	99.7
0°-90°	1469.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1469.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1838	
5°	1814	169
15°	1513	422
25°	1085	490
35°	470	300
45°	83	75
55°	8	9
65°	4	3
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P726784  
CATALOG NUMBER: MRI-DRV-FLD4C-15-L935 F4LC-M-X-LI

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1838.4
2.5°	1836.5
5°	1814.0
7.5°	1765.1
10°	1699.3
12.5°	1612.8
15°	1513.2
17.5°	1406.0
20°	1300.8
22.5°	1195.5
25°	1084.6
27.5°	956.8
30°	810.2
32.5°	639.1
35°	469.9
37.5°	330.8
40°	225.6
42.5°	141.0
45°	82.7
47.5°	47.0
50°	24.4
52.5°	11.3
55°	7.5
57.5°	5.6
60°	5.6
62.5°	3.8
65°	3.8
67.5°	1.9
70°	1.9
72.5°	1.9
75°	1.9
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)