

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P726832

Luminaire Tested: **MRI-DRV-FLD4C-15-L940 F4LC-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P726832
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-15-L940 F4LC-N-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBNLI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1155.0 lumens
Efficiency: N/A
Efficacy: 73.1 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P726832
CATALOG NUMBER: MRI-DRV-FLD4C-15-L940 F4LC-N-X-LI

Luminous Intensity Polar Plot

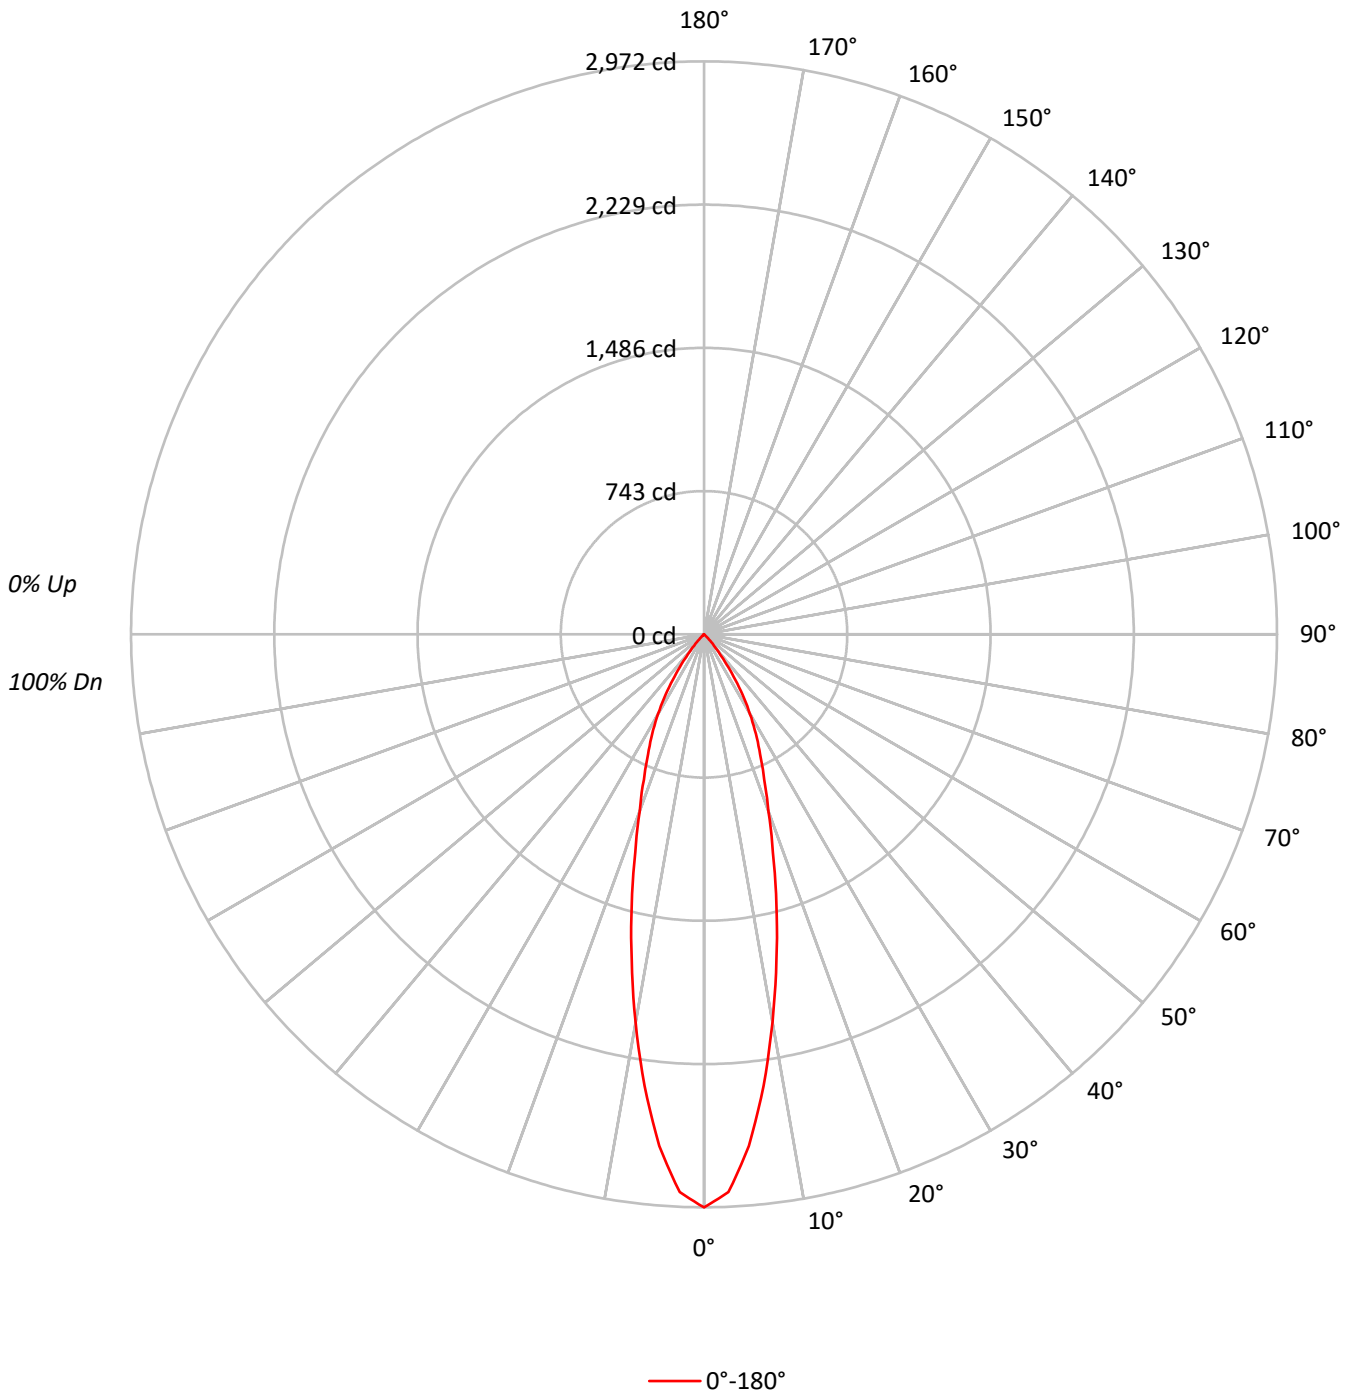



TEST NUMBER: P726832
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L940 F4LC-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	365157
5°	328606
10°	254737
15°	184383
20°	127666
25°	93071
30°	67624
35°	40014
40°	16823
45°	5247
50°	688
55°	386
60°	442
65°	523
70°	0
75°	0
80°	0
85°	0



TEST NUMBER: P726832
 CATALOG NUMBER: MRI-DRV-FLD4C-15-L940 F4LC-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	234.2	20.3
10°-20°	401.0	34.7
20°-30°	318.7	27.6
30°-40°	168.7	14.6
40°-50°	29.1	2.5
50°-60°	2.2	0.2
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	953.9	82.6
0°-40°	1122.7	97.2
0°-60°	1153.9	99.9
0°-90°	1155.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1155.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2972	
5°	2665	234
15°	1450	401
25°	687	319
35°	267	169
45°	30	29
55°	2	2
65°	2	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P726832
CATALOG NUMBER: MRI-DRV-FLD4C-15-L940 F4LC-N-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	2972.3
2.5°	2895.8
5°	2664.6
7.5°	2362.2
10°	2042.0
12.5°	1732.5
15°	1449.7
17.5°	1186.4
20°	976.5
22.5°	816.4
25°	686.6
27.5°	581.7
30°	476.7
32.5°	370.0
35°	266.8
37.5°	176.1
40°	104.9
42.5°	60.5
45°	30.2
47.5°	10.7
50°	3.6
52.5°	3.6
55°	1.8
57.5°	1.8
60°	1.8
62.5°	1.8
65°	1.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)